


BRAND	EMBOSS TYPE		
	SHORT	LONG	FLUSH
CLOPAY	9130, HDP13	9133, HDPL13	9131, HDPF13
IDEAL	8130	8133	8131
HOLMES	7130	7133	7131

SHEET:		REVISIONS				
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION	
1 OF 4	03	-	10/28/14	-	SH	CREATED TDI VERSION.

DOOR HEIGHT	# OF SECTIONS	# OF U-BARS
UP TO 7'0"	4	8
7'3" TO 8'9"	5	10
9'0" TO 10'6"	6	12
10'9" TO 12'3"	7	14
12'6" TO 14'0"	8	16
14'3" TO 15'9"	9	18
16'0"	10	20
MAX SECTION HEIGHT: 21'		

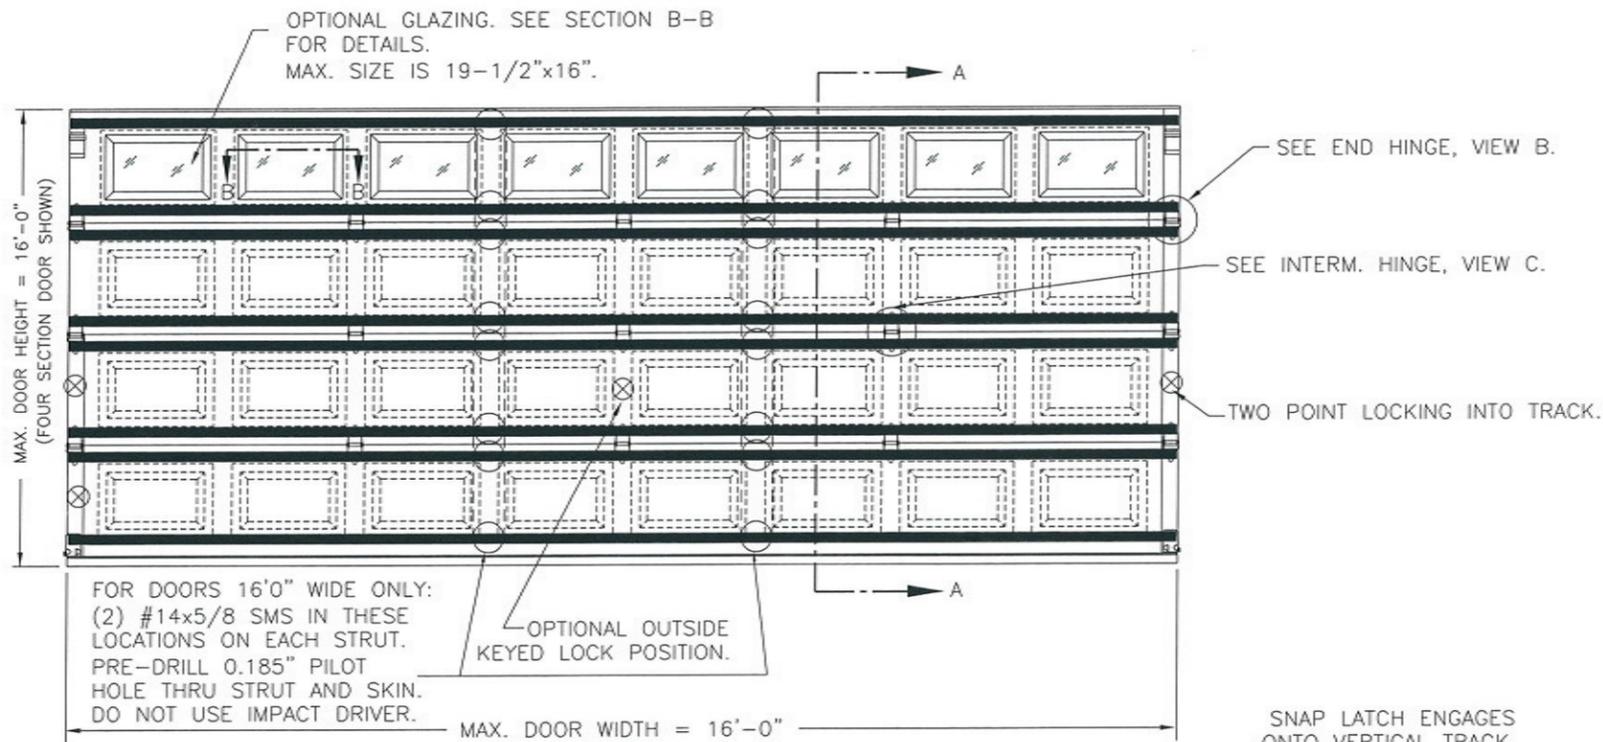




THIS DOOR MEETS OR EXCEEDS THE DESIGN LOADS FOR THE ULTIMATE WIND SPEEDS LISTED BELOW ACCORDING TO THE FLORIDA BUILDING CODE OR THE INTERNATIONAL BUILDING CODE (BASED ON ASCE7-05) FOR THE FOLLOWING CONDITIONS: 1) ENCLOSED BUILDING, 2) DOOR HAS 2' OF WIDTH IN BUILDING'S END ZONE, 3) ANY ROOF SLOPE, AND 4) TESTING IN ACCORDANCE WITH ANSI/DASMA 108. SITE-SPECIFIC CALCULATIONS BY A QUALIFIED DESIGN PROFESSIONAL MAY DIFFER.

DESIGN WIND SPEED (MPH)	115	150	135
EXPOSURE CATEGORY	B, C	B, C	B
MEAN ROOF HEIGHT	25'	15'	30'

DOOR WIDTH	# OF SHORT PANELS	# OF INTERM. HINGES/JOINT
9'2" TO 9'10"	4	1
10'0" TO 13'10"	6	2
14'0" TO 15'10"	7	4
16'0"	8	3

APPLIES TO FLUSH MODELS ALSO.

DOOR WIDTH	# OF LONG PANELS	# OF INTERM. HINGES/JOINT
9'2" TO 11'2"	2	1
11'4" TO 14'10"	3	2
15'0" TO 16'0"	4	3

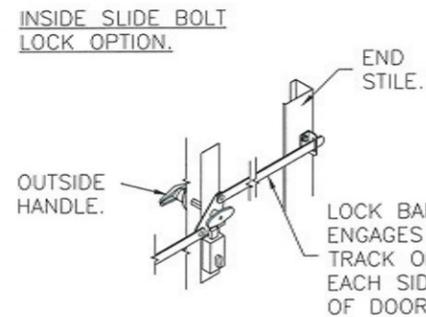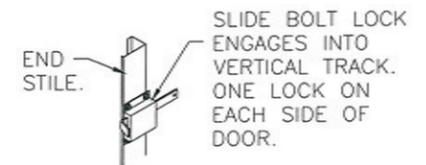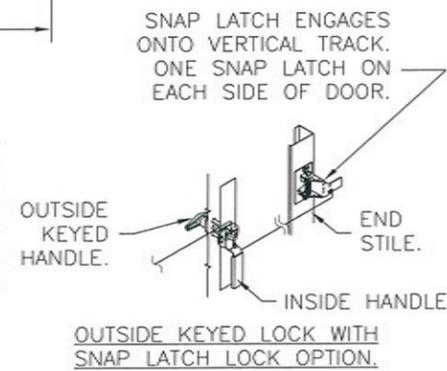

DESIGN LOADS: +32.0 P.S.F. & -32.0 P.S.F.  
TEST LOADS: +48.0 P.S.F. & -48.0 P.S.F.

Unless Stated Otherwise TOLERANCES are  
.0 = ±.031  
.00 = ±.015  
.000 = ±.005  
.0000 = ±.001  
Degrees = ±1/2°  
Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

**Clopay** Building Products Company  
8585 Duke Boulevard  
Mason, OH 45040 USA  
Tel. No. 513-770-4800  
Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE DSIU-1A171		PART NO.: N/A	
WINDLOAD RATING W5 DP32			
DESCRIPTION: CLASSIC 1-3/8" INTELICORE DC ±32 PSF	SCALE: NTS	DWG. SIZE B	
DRAWN BY: SH	DATE: 5/25/09	SHEET 1 OF 4	VER: TDI
CHECKED BY: --	DATE: --	DWG. NO.: 104191	




DESIGN ENGINEER  
MARK WESTERFIELD, P.E.  
FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

BRAND	EMBOSS TYPE		
	SHORT	LONG	FLUSH
CLOPAY	9130, HDP13	9133, HDPL13	9131, HDPF13
IDEAL	8130	8133	8131
HOLMES	7130	7133	7131

SHEET:  
2 OF 4

REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
03	-	-	-	-	SEE REVISION HISTORY ON SHEET ONE.

**STANDARD ASSEMBLY CONSTRUCTION:**  
 OPTIONAL DSB OR 1/8" ACRYLIC LITES AVAILABLE. OPTIONAL ACRYLIC GLAZING IS PLASKOLITE OPTIX OR LUCITE CP APPROVED CC2 PLASTIC IN ACCORDANCE WITH IBC/FBC 2606.  
 THE ENTIRE DOOR ASSEMBLY INSTALLED IN COMPLIANCE WITH THIS SECTION MEETS THE WIND LOAD REQUIREMENTS OF THE FLORIDA BUILDING CODE OR INTERNATIONAL BUILDING CODE BUT DOES NOT MEET THE IMPACT RESISTANT REQUIREMENT FOR WINDBORNE DEBRIS REGIONS (REF. CHAPTER 16 FBC/IBC).

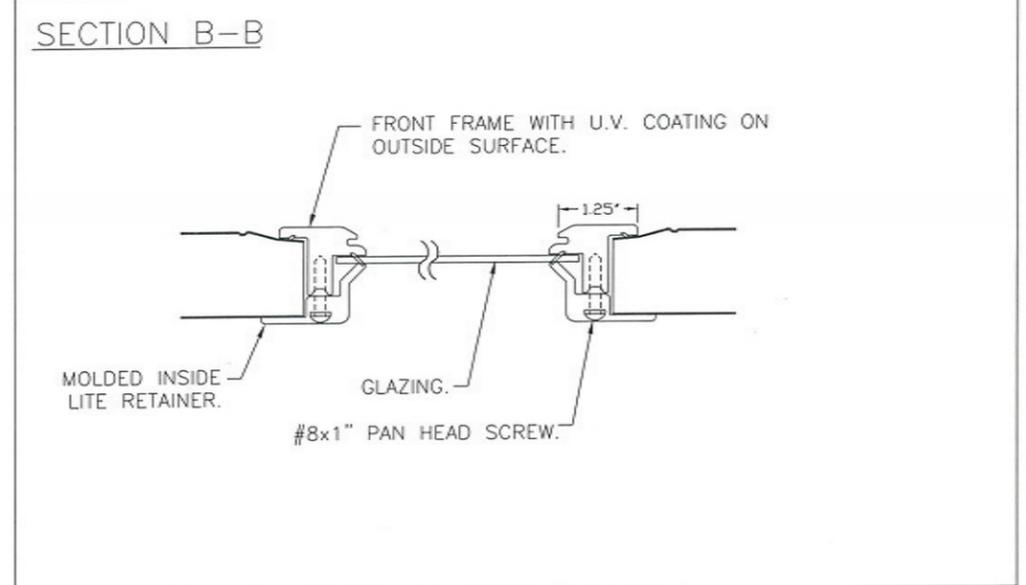

DESIGN ENGINEER:  
 MARK WESTERFIELD, P.E.  
 FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

DESIGN LOADS: +32.0 P.S.F. & -32.0 P.S.F.  
 TEST LOADS: +48.0 P.S.F. & -48.0 P.S.F.

Unless Stated Otherwise  
**TOLERANCES** are  
 .0 = ±.031  
 .00 = ±.015  
 .000 = ±.005  
 .0000 = ±.001  
 Degrees = ±1/2'  
 Unless Stated Otherwise  
 DIMENSIONS ARE IN INCHES.

**Clopay**  
 Building Products Company  
 8585 Duke Boulevard  
 Mason, OH 45040 USA  
 Tel. No. 513-770-4800  
 Fax No. 513-770-4853

DESCRIPTION: CLASSIC 1-3/8" INTELLICORE DC ±32 PSF		SCALE: NTS	DWG. B
DRAWN BY: SH	DATE: 5/25/09	SHEET 2 OF 4	SIZE B
CHECKED BY: --	DATE: --	VER: TDI	
DWG. NO.: 104191			

MANUFACTURING PRODUCT CODE  
 DSIU-1A171

PART NO.: N/A


WINDLOAD RATING  
**W5 DP32**

BRAND	EMBOSS TYPE		
	SHORT	LONG	FLUSH
CLOPAY	9130, HDP13	9133, HDPL13	9131, HDPF13
IDEAL	8130	8133	8131
HOLMES	7130	7133	7131

SHEET:		REVISIONS				
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION	
3 OF 4	03	-	-	-	SEE REVISION HISTORY ON SHEET ONE.	

IN THE CASE OF GYPSUM WALLBOARD LOCATED AT OR NEAR THE DOOR OPENING LOCATION THERE ARE TWO ACCEPTABLE ALTERNATIVES:

- 1) THE WALLBOARD CAN BE CUT AWAY FROM THE DOOR OPENING AND 2X6 SOUTHERN YELLOW PINE WOOD JAMBS MOUNTED DIRECTLY TO THE SUPPORTING STRUCTURE TO CREATE THE MOUNTING SURFACE. ALTERNATIVELY, THE BRACKETS MAY BE ATTACHED DIRECTLY TO THE SUPPORTING STRUCTURE. SEE DETAIL BELOW. THE CENTER OF SCREW HOLE MUST BE AT LEAST 1/2" FROM BOTH EDGES FOR A 5/16" LAG SCREW.
- 2) IF THE WALLBOARD IS NOT CUT AWAY TO EXPOSE THE UNDERLYING STRUCTURE (WOOD FRAMING MEMBERS), A 2X6 SOUTHERN YELLOW PINE WOOD BUCK OVER SHALL BE INSTALLED THE WALLBOARD FRAMING THE OPENING USING THE JAMB ATTACHMENT FASTENERS LISTED BELOW. HOWEVER, THE JAMB ATTACHMENT FASTENERS MUST BE OF A SUFFICIENT INCREASED LENGTH TO ACCOUNT FOR THE THICKNESS OF THE WALLBOARD TO ENSURE PROPER FASTENER EMBEDMENT INTO THE STRUCTURAL FRAMING MEMBERS OF THE SUPPORTING STRUCTURE.

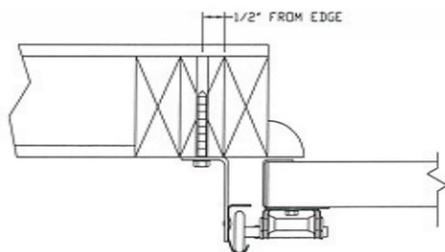

PREPARATION OF JAMBS BY OTHERS.

VERTICAL JAMB ATTACHMENT (WOOD FRAME BUILDINGS):

3/8"x3" LAG SCREWS ON 24" CENTERS. 1-1/8" O.D. WASHER REQUIRED. LAG SCREWS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.

VERTICAL JAMB ATTACHMENT (C-90 BLOCK OR 2,000 PSI MIN. CONCRETE COLUMN):


3/8"x3" SLEEVE ANCHOR BOLTS ON 17" CENTERS (2,000 PSI MIN. CONCRETE). WASHERS INCLUDED WITH SLEEVE ANCHORS.

OR  
1/4"x3" TAPCON SCREWS ON 14" CENTERS (2,000 PSI MIN. CONCRETE) OR 8" CENTERS (C-90 BLOCK), 1" O.D. WASHERS REQUIRED WITH TAPCONS.

ANCHORS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.

OTHER JAMB CONFIGURATIONS: REFER TO DASMA TDS-161. A LICENSED DESIGN PROFESSIONAL MAY ALSO BE EMPLOYED TO APPROVE ALTERNATE FASTENERS AND/OR JAMB CONFIGURATIONS.

DESIGN ENGINEER:  
MARK WESTERFIELD, P.E.  
FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

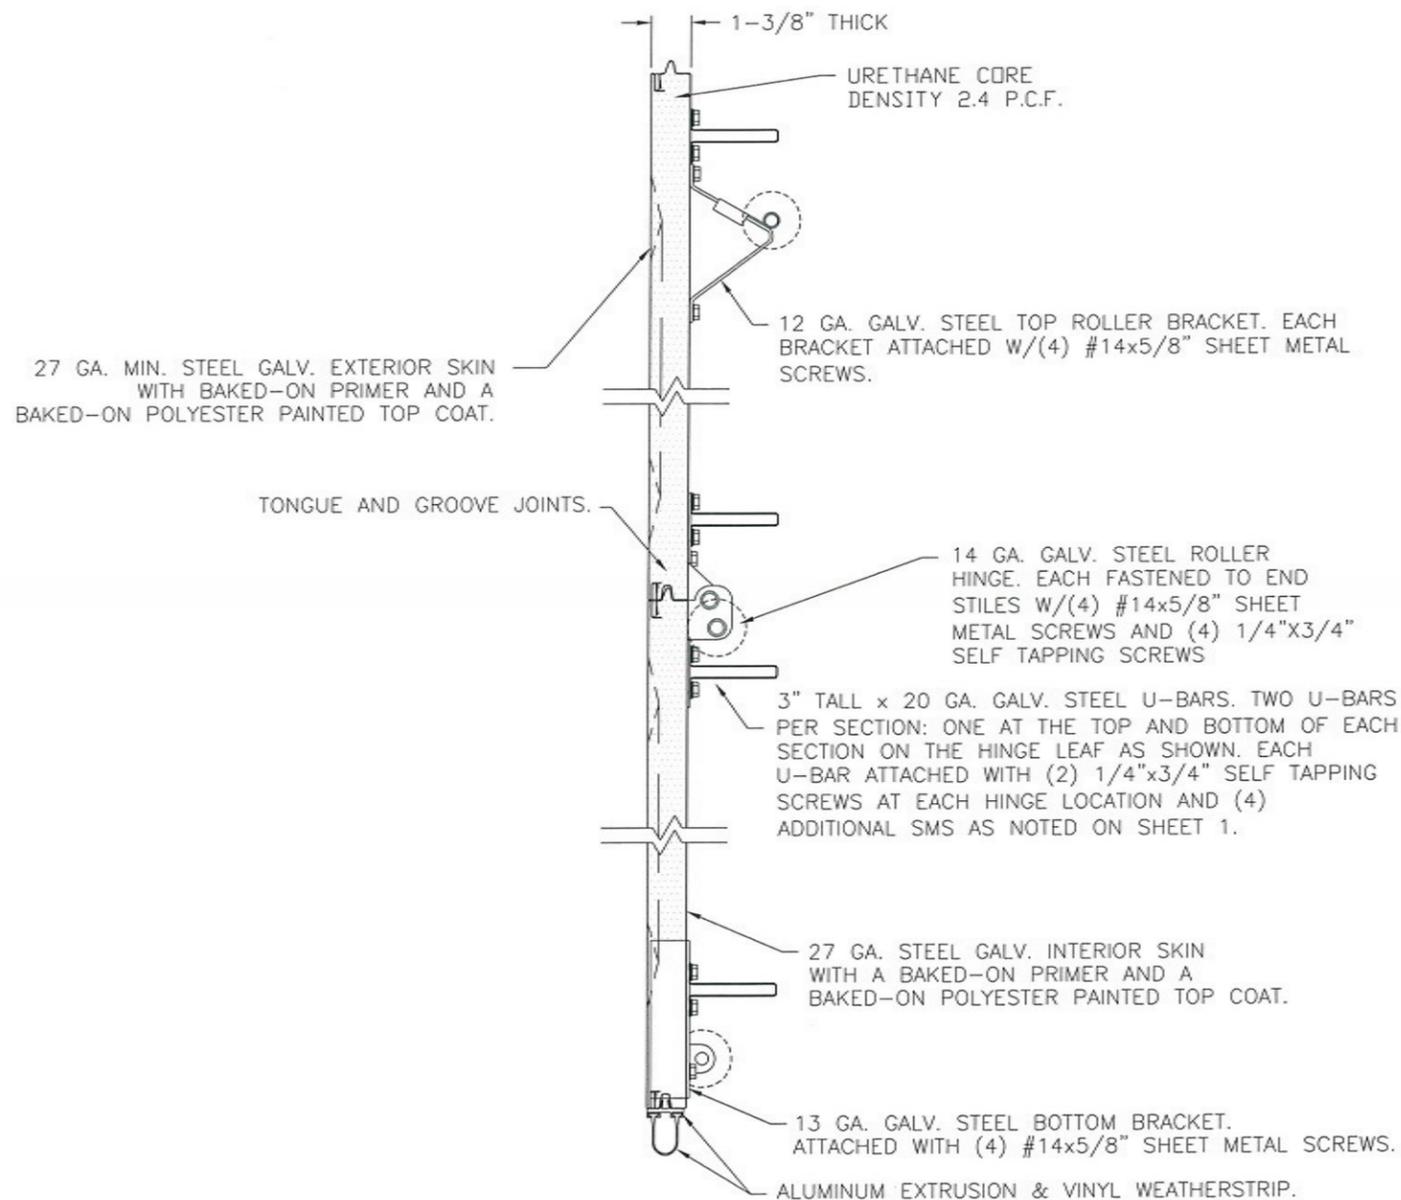

SECTION A-A (SIDE VIEW)

DESIGN LOADS: +32.0 P.S.F. & -32.0 P.S.F.  
TEST LOADS: +48.0 P.S.F. & -48.0 P.S.F.

Unless Stated Otherwise TOLERANCES are	
.0	= ±.031
.00	= ±.015
.000	= ±.005
.0000	= ±.001
Degrees	= ±1/2'

Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

**Clopay** Building Products Company  
8585 Duke Boulevard  
Mason, OH 45040 USA  
Tel. No. 513-770-4800  
Fax No. 513-770-4853

DESCRIPTION: CLASSIC 1-3/8" INTELLICORE DC ±32 PSF

DRAWN BY: SH	DATE: 5/25/09	SCALE: NTS	DWG. B
CHECKED BY: --	DATE: --	SHEET 3 OF 4	SIZE B
DWG. NO.: 104191	VER: TDI		


MANUFACTURING PRODUCT CODE  
DSIU-1A171

PART NO.: N/A

WINDLOAD RATING  
W5 DP32


BRAND	EMBOSS TYPE		
	SHORT	LONG	FLUSH
CLOPAY	9130, HDP13	9133, HDPL13	9131, HDPF13
IDEAL	8130	8133	8131
HOLMES	7130	7133	7131

SHEET:		REVISIONS				
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION	
4 OF 4	03	-	-	-	SEE REVISION HISTORY ON SHEET ONE.	

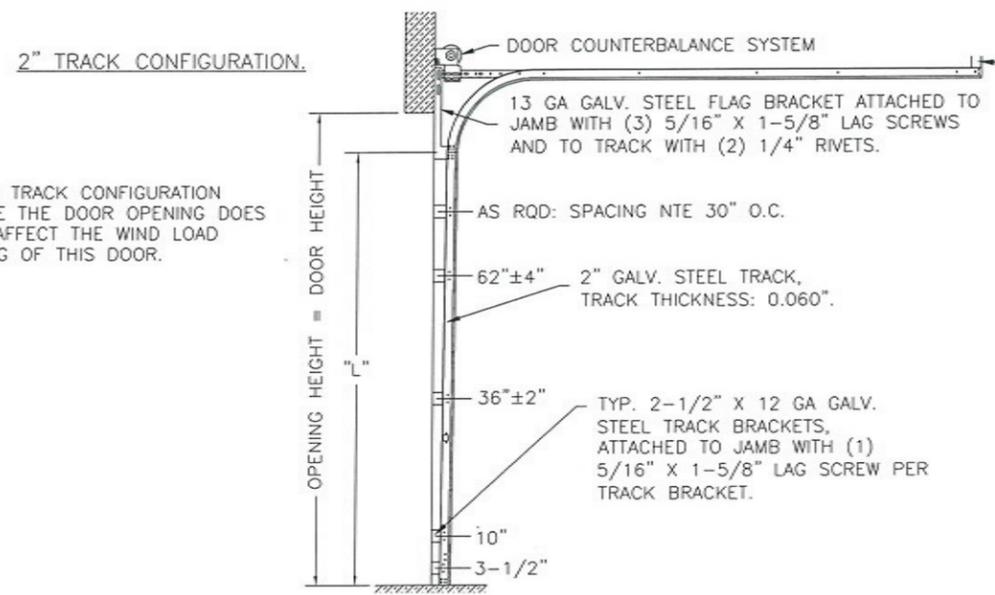


DOOR HEIGHT	"L"
6'-6"	70"
7'-0"	76"
7'-6"	82"
8'-0"	88"
8'-6"	94"
9'-0"	100"
9'-6"	106"
10'-0"	112"
10'-6"	118"
11'-0"	124"
11'-6"	130"
12'-0"	136"
12'-6"	142"
13'-0"	148"
13'-6"	154"
14'-0"	160"
14'-6"	166"
15'-0"	172"
15'-6"	178"
16'-0"	184"

HORIZONTAL TRACK SUPPORT BY DOOR INSTALLER (TO SUIT).

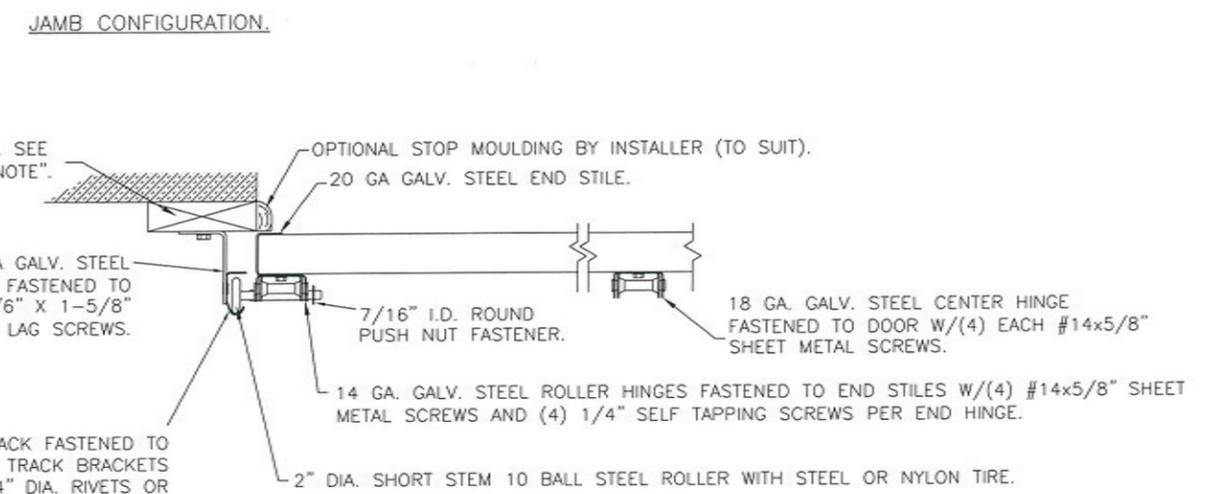

NOTE: TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING OF THIS DOOR.

SECTION C-C  
PREPARATION OF JAMBS BY OTHERS.

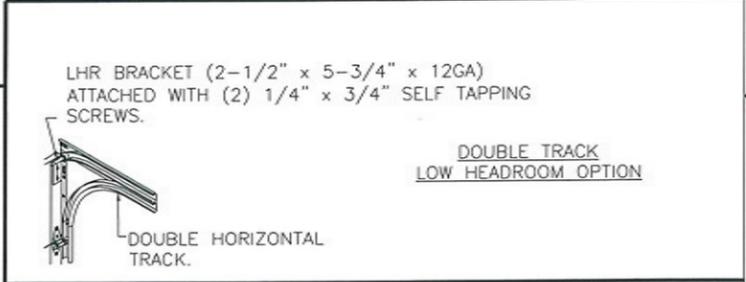

3" TRACK IS ALSO AVAILABLE.

STATE OF TEXAS  
  
 MARK W. WESTERFIELD  
 91513  
 DESIGN ENGINEER  
 FLORIDA P.E. #48495, NC, R.E. #23832, TEXAS P.E. #91513

DESIGN LOADS: +32.0 P.S.F. & -32.0 P.S.F.  
 TEST LOADS: +48.0 P.S.F. & -48.0 P.S.F.

Unless Stated Otherwise  
 TOLERANCES are  
 .0 = ±.031  
 .00 = ±.015  
 .000 = ±.005  
 .0000 = ±.001  
 Degrees = ±1/2"  
 Unless Stated Otherwise  
 DIMENSIONS ARE IN INCHES.

**Glopay**  
 Building Products Company  
 8585 Duke Boulevard  
 Mason, OH 45040 USA  
 Tel. No. 513-770-4800  
 Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE  
 DSIU-1A171  
 PART NO.: N/A

WINDLOAD RATING  
**W5 DP32**

DESCRIPTION: CLASSIC 1-3/8" INTELICORE DC ±32 PSF  
 DRAWN BY: SH DATE: 5/25/09 SCALE: NTS DWG. SIZE B  
 CHECKED BY: -- DATE: -- SHEET 4 OF 4  
 DWG. NO.: 104191 VER: TDI