
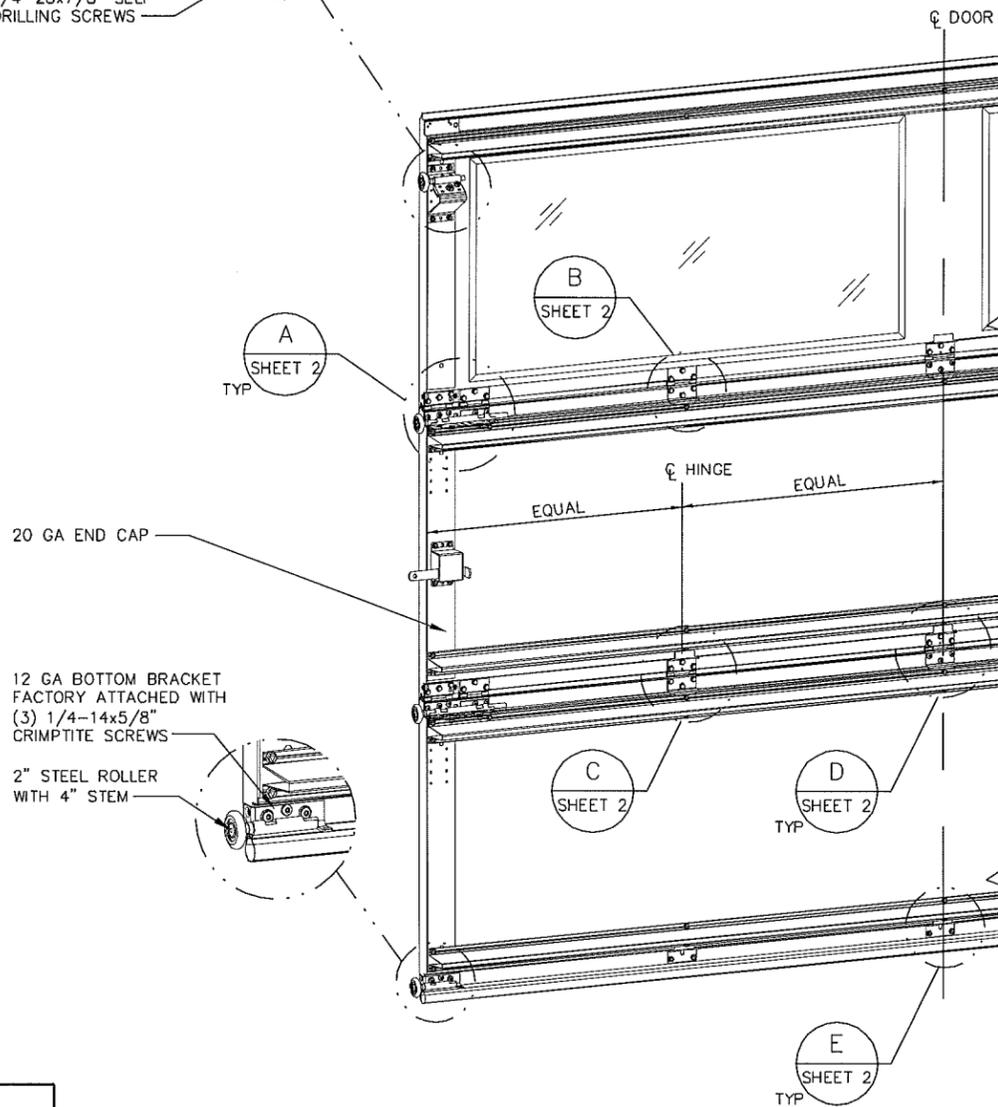
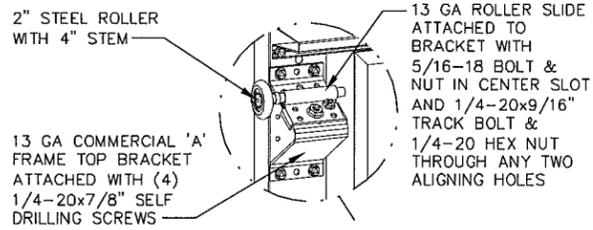


NOTES:

1. GLAZING OPTIONS - .125" MINIMUM DSB GLAZING INSTALLED IN TOP SECTION (WITH OR WITHOUT DECORATIVE LITE FRAME DIVIDERS) MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.
2. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.
3. SLIDE LOCK OR OPERATOR REQUIRED.
4. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
5. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:
EXTERIOR - 27 GA
INTERIOR - 30 GA
6. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
7. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A LHR TOP BRACKET IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. SEE LHR DETAIL SHEET 2.
8. SECTIONS SHALL HAVE A 20 GA BACKUP PLATE ACROSS THE TOP OF EACH SECTION.

NOTE: (3) SECTION DOOR SHOWN. SEE SHEET 2 FOR U-BAR LOCATIONS ON DOORS WITH OTHER SECTION QUANTITIES.

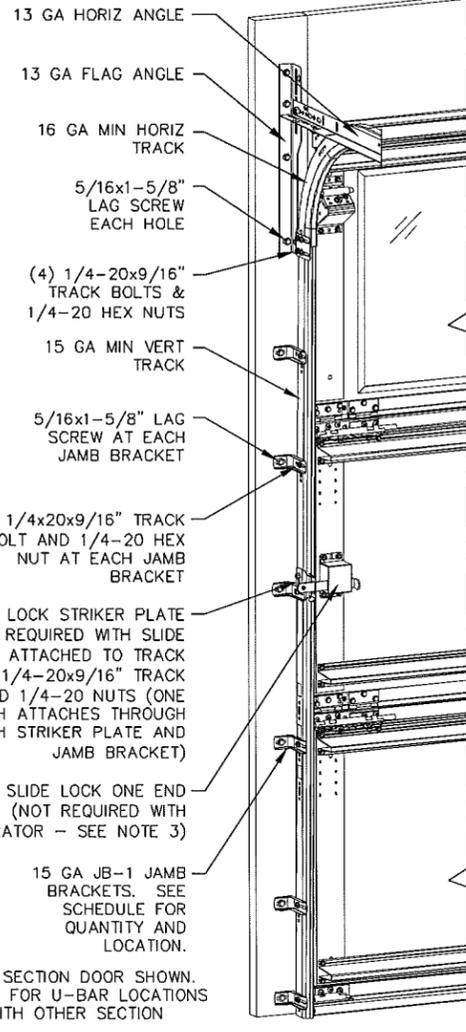

REVISIONS
P4 CHANGES MADE PER ETC LABORATORIES TESTING AND CHANGES TO GENERAL FORMAT 1/12/06 GRT
P5 UPDATED TITLE BLOCK 4/15/13 GRT

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
9'-0"	ALL	+140.4/-161.1
8'-0"	ALL	+124.8/-143.2

JAMB BRACKET SCHEDULE

DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
7'-0"	3	6	2", 10", 26", 42", 53", 63"
8'-0"	4	8	2", 10", 26", 39", 48", 57", 66", 75"
> 8'-0"			SEE NOTE BELOW


NOTE: ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

STATE OF TEXAS
JOHN E. SCATES
56308
6/15/13
JOHN E. SCATES, PE
3121 FAIRGATE DR.
CARROLLTON, TX 75007
FL PE 51737 TX PE 56308/F2203
PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.



A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890


STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+31.20/-35.80	MAX WIDTH: 9'-0"	DATE	NAME
TEST (PSF):	+46.80/-53.70	MAX HEIGHT: 10'-0"	DRAWN	1/12/06 GRT
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX SECTION HEIGHT: 28"	CHECKED	2/10/06 MRB
MODELS 9550/9700			SHEET 1 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 0507			DRAWING PART NO.	REV.
			313633	P5

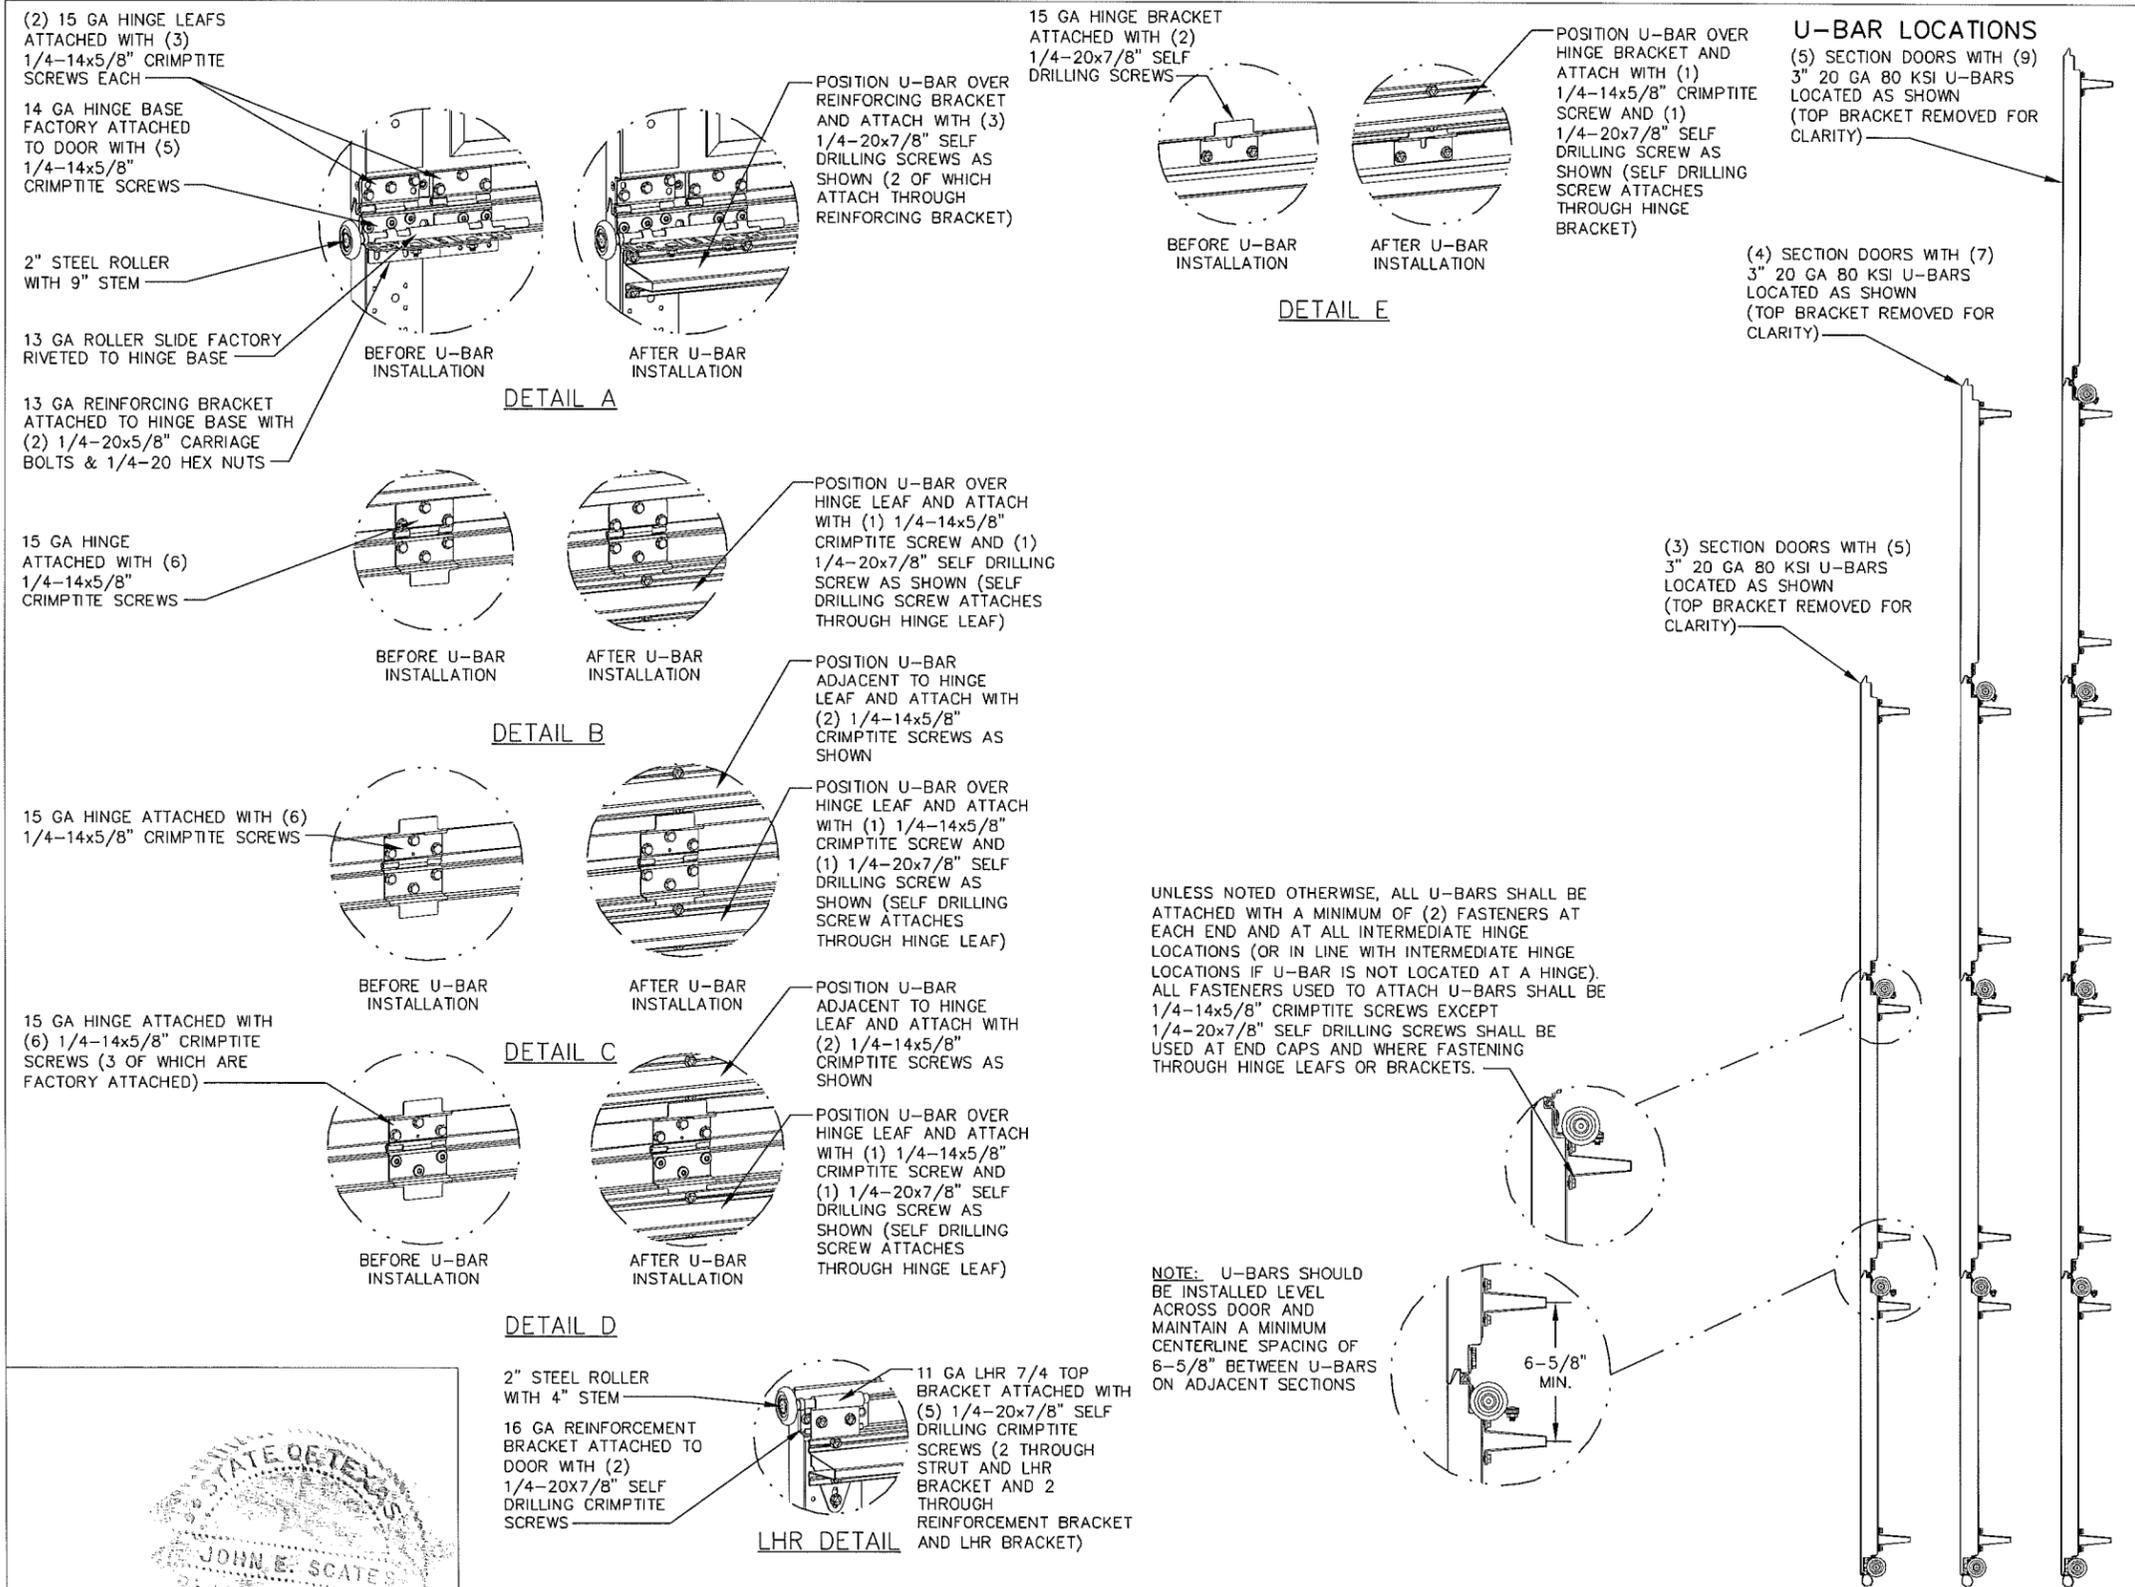

REVISIONS

P4	CHANGES MADE PER ETC LABORATORIES TESTING AND CHANGES TO GENERAL FORMAT	1/12/06	GRT
P5	UPDATED TITLE BLOCK	4/15/13	GRT

John E. Scates
 JOHN E. SCATES, PE
 3121 FAIRGATE DR.
 CARROLLTON, TX 75007
 FL PE 51737 TX PE 56308/F2203
 PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.



STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+31.20/-35.80	MAX WIDTH:	9'-0"	DATE	1/12/06	NAME	GRT
TEST (PSF):	+46.80/-53.70	MAX HEIGHT:	10'-0"	DRAWN	2/10/06	MRB	
IMPACT/CYCLIC RATED (YES/NO): NO				MAX SECTION HEIGHT: 28"	CHECKED		
MODELS 9550/9700						SHEET 2 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 0507						DRAWING PART NO.	REV.
						313633	P5