


NOTES:

- GLAZING OPTIONS - .090" MINIMUM SSB GLAZING IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS) MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. GLAZING SHALL HAVE A MAXIMUM HEIGHT OF 10.69" AND A MAXIMUM LENGTH OF 16.94". GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET WIND-BORNE DEBRIS REQUIREMENTS.
- VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.
- KEY LOCK, SLIDE LOCK, OR OPERATOR REQUIRED.
- LOUVER OPTION - .040" MINIMUM LOUVERS IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS INSTALLED IN THE BOTTOM SECTION. LOUVERS ARE NOT IMPACT RESISTANT AND DO NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.
- SECTION STEEL, TO HAVE A MINIMUM 26 GA THICKNESS.
- THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL ENGINEER OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
- DOOR JAMB TO BE MINIMUM 2x4 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.
- FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A 13 GA LHR 7/4" TOP BRACKET WITH A MINIMUM OF (3) 1/4"-14x7/8" SELF DRILLING CRIMPITTE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING.

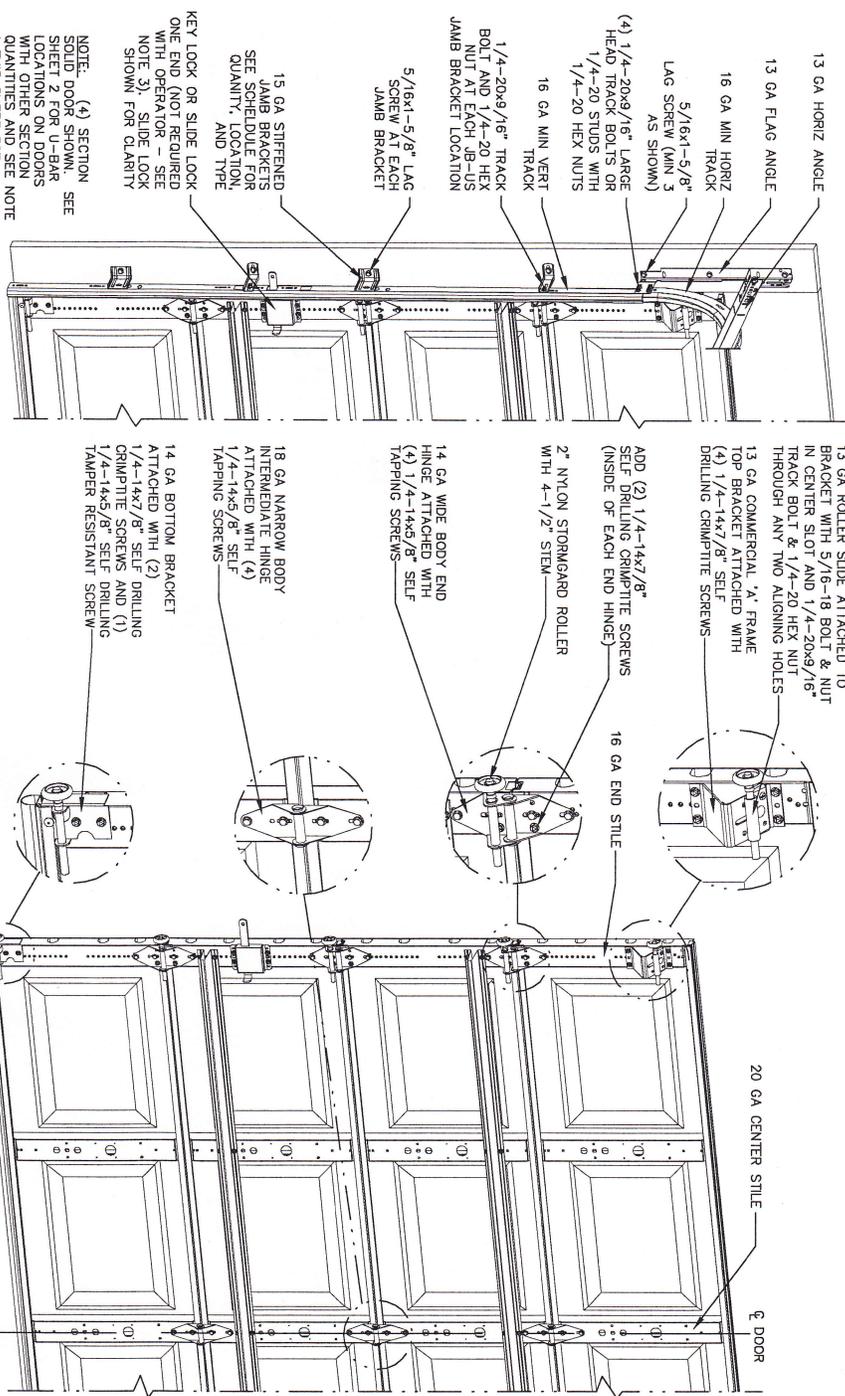

REVISIONS

- P1 MODIFIED NOTES TO STATE THAT LOUVERS ARE NOT IMPACT RESISTANT. GRT 6/29/07
- P2 MODIFIED JAMB BRACKET SCHEDULE ALLOWING REPLACEMENT OF QI WITH JB-US. ADDED MAX GLAZING DIMENSION ADDED SHEET TO FLAG CONNECTION NOTE. GRT 11/10/07
- P3 MODIFIED LOUVER OPTION. ADDED TEXAS LICENSE NUMBER TO TITLE BLOCK. GRT 9/19/08
- P4 UPDATED TITLE BLOCK GRT 4/16/12

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
8'-0"	ALL	+91.6/-105.2
9'-0"	ALL	+103.1/-118.4

JAMB BRACKET SCHEDULE

DOOR HEIGHT SECTIONS	NO. OF BRACKETS (EACH JAMB)	TRACK TYPE	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
6'-6"	4	QI	4" (Q), 34" (JB-US), 44" (Q), 56" (JB-US)
6'-6"	4	FAT	10" (JB-US), 25-3/4" (JB-US), 29" (JB-US), 57-1/4" (JB-US)
7'-0"	4	QI	4" (Q), 29-1/2" (JB-US), 44" (Q), 63-1/4" (JB-US)
7'-0"	4	FAT	10" (JB-US), 29-3/4" (JB-US), 42" (JB-US), 63-1/4" (JB-US)
7'-6"	5	QI	4" (Q), 28-1/2" (JB-US), 43" (Q), 62-1/2" (Q), 72" (JB-US)
7'-6"	5	FAT	10" (JB-US), 28-3/4" (JB-US), 45" (JB-US), 63" (JB-US), 74-1/2" (JB-US)
8'-0"	5	QI	4" (Q), 34" (JB-US), 46" (Q), 58" (JB-US), 66-1/2" (Q)
8'-0"	5	FAT	10" (JB-US), 29-3/4" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 77-1/2" (JB-US)

NOTE: (JB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4"-20x9/16" TRACK BOLT AND NUT. (QI) FOLLOWING DIMENSION DENOTES QUICK INSTALL JAMB BRACKET INSTALLED IN BUTTERFLY SLOT. NO ADDITIONAL HARDWARE NEEDED TO ATTACH TO TRACK. ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

MARK A. SAWICKI, PE
 2901 S. STATE HWY 121, SUITE 200
 LEWISVILLE, TX 76047
 TX PE 106291




STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.	
DESIGN (PSF):	+22.90/-26.30	MAX WIDTH:	9'-0"	DATE	NAME
TEST (PSF):	+34.35/-39.45	MAX HEIGHT:	14'-0"	5/10/06	GRT
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX SECTION HEIGHT:	21"	1/22/07	MRB
MODELS 8000/8100		SHEET 1 OF 2		DRAWING PART NO. P4	
WINDLOAD SPECIFICATION OPTION CODE 1101		DRAWING PART NO. 327010		REV. P4	

Handwritten signature: Hubbard


REVISIONS

- P1 MODIFIED NOTES TO STATE THAT LOWERS SHALL BE IMPACT RESISTANT.
GRT 6/29/07
- P2 MODIFIED LAMB BRACKET SCHEDULE ALLOWING REPLACEMENT OF Q1 WITH JB-US. ADDED MAX GLAZING DIMENSION TO NOTES SHEET 1. ADDED TRACK TO FLAG CONNECTION NOTE.
GRT 11/10/07
- P3 MODIFIED LOWER OPTION. ADDED TEXAS LICENSE NUMBER TO TITLE BLOCK.
GRT 9/19/08
- P4 UPDATED TITLE BLOCK
GRT 4/16/12

U-BAR LOCATIONS

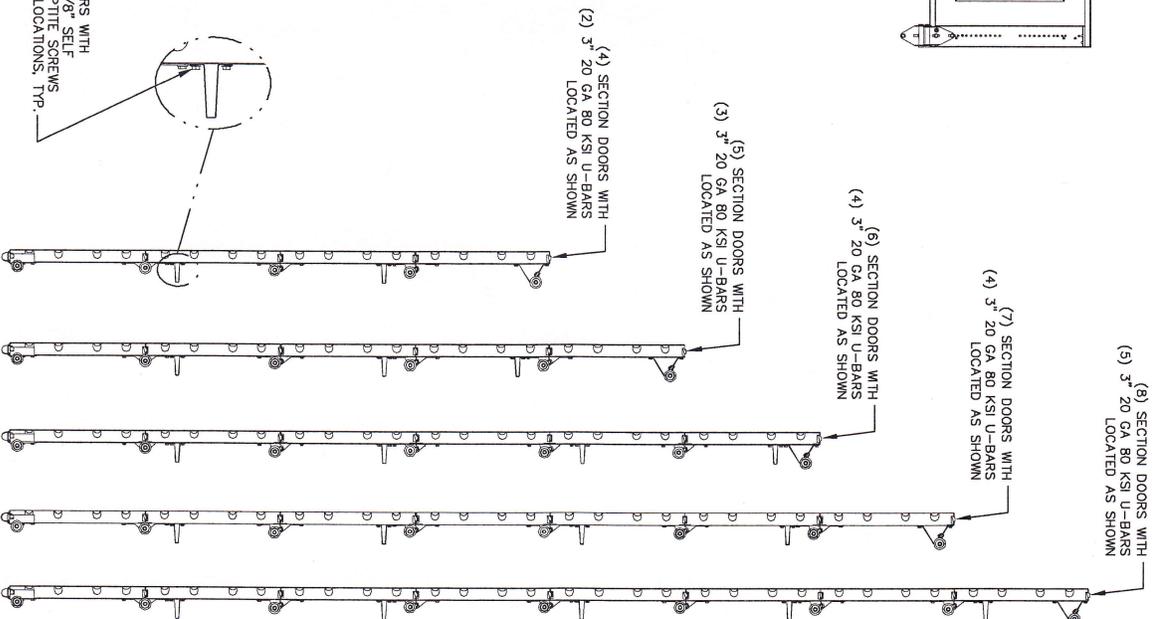

CENTER STILE & INTERMEDIATE HINGE LOCATIONS

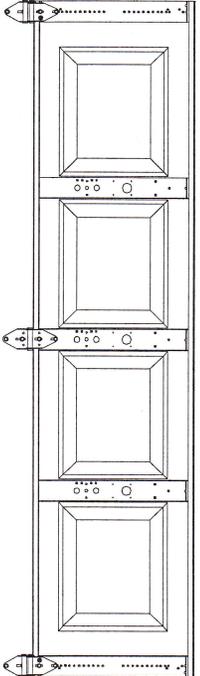

ATTACH U-BARS WITH
(2) 1/4-14x7/8\"/>

Mark A. Sawicki
7/10/11

MARK A. SAWICKI, PE
2901 S. STATE HWY 121, SUITE 200
LEWISVILLE, TX 75067
TX, PE 106291



A DIVISION OF OVERHEAD DOOR CORP.
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.	
DESIGN (PSF):	+22.90/-26.30	MAX WIDTH:	9'-0"	DATE	SIZE: A
TEST (PSF):	+34.35/-39.45	MAX HEIGHT:	14'-0"	DRAWN	NAME
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX SECTION HEIGHT:	21"	CHECKED	GRT
MODELS 8000/8100				SHEET	2 OF 2
WINDLOAD SPECIFICATION OPTION CODE 1101				DRAWING PART NO.	327010
				REV.	P4