

RESIVER PATIO DOOR

NON-IMPACT R-301 VINYL FIXED WINDOW

INSTALLATION ANCHORAGE DETAILS

O FIXED WITHOUT SASH FIN INSTALLATION

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED TO COMPLY WITH THE 2006 EDITIONS OF THE INTERNATIONAL BUILDING CODE (I.B.C.) AND INTERNATIONAL RESIDENTIAL CODE (I.R.C.) WITH THE 2006 TEXAS REVISIONS, EFFECTIVE JANUARY 1, 2008. THE PRODUCT HAS BEEN TESTED TO AAMA/WDMA/CSA 101/I.S. 2/A440-05.
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE / MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. IN AREAS WHERE WIND-BORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED WITH THIS PRODUCT.
5. DOOR FRAME AND PANEL MATERIAL: VINYL.
6. GLASS MEETS THE REQUIREMENTS OF ASTM E1300-04e01.
7. SITE CONDITIONS THAT DEVIATE FROM THE DETAILS OF THIS DRAWING REQUIRE FURTHER ENGINEERING EVALUATION BY A LICENSED ENGINEER OR REGISTERED ARCHITECT.
8. DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
X: OPERABLE
O: FIXED

INSTALLATION NOTES:

1. SEE ANCHOR SCHEDULE TABLE FOR TYPE, SIZE, EMBEDMENT AND EDGE DISTANCE OF ALLOWED ANCHORS. ANCHORS ARE TO MATCH TYPE, SIZE, AND EMBEDMENT OF THOSE SHOWN HEREIN FOR WOOD SUBSTRATE. PAN HEAD SCREWS ARE SHOWN. FLAT HEAD SCREWS ARE ACCEPTABLE FOR THE 2X4 OVER FIN. PAN HEAD SCREWS ARE REQUIRED WHEN USED THROUGH THE FIN (NAILING FIN).
2. ONE (1) INSTALLATION ANCHOR AT THE 2X4 OVER FIN INSTALLATION AND ONE (1) INSTALLATION ANCHOR AT THE NAILING FIN ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN. SEE SECTION VIEWS FOR CLARIFICATION.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION AT THE MAXIMUM SIZE SHOWN. SMALLER PRODUCT SIZES CAN HAVE LESS ANCHORS AS LONG AS THE EDGE DISTANCE AND ON CENTER (O.C.) SPACING ARE THE SAME AS OR LESS THAN THAT SHOWN.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. SHIMS MAY NOT SHOWN IN THE SECTION VIEWS OF THIS DRAWING FOR CLARITY
5. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES (INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING).

ANCHOR SCHEDULE						
SUBSTRATE	TYPE (2)	SIZE (1)	MANUFACTURER AND/OR SPECIFICATION	EMBEDMENT (IN)	EDGE DISTANCE (IN)	CAPACITIES BASED ON
WOOD	FLAT HEAD OR PAN HEAD	NO. 10	ANSI B18.6.1 (WOOD SCREW) ASME B18.6.4 (TAPPING SCREW)	1-1/4"	3/4"	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.42.
<p>NOTES:</p> <p>1) IF REQUIRED TO PREVENT SPLITTING DRILL PILOT HOLES IN WOOD FRAME AS FOLLOWS: FOR WOOD SCREWS DRILL 0.112" DIAMETER HOLE (#34 DRILL SIZE) AND FOR TAPPING SCREWS DRILL 0.121" DIAMETER HOLE (#31 DRILL SIZE).</p> <p>2) SEE INSTALLATION NOTE 2.</p>						

DESIGN PRESSURE RATING (PSF)		IMPACT RATING
MAXIMUM UNIT DIMENSIONS	FIXED UNIT DP	NON-IMPACT
48" X 96" O TAPE GLAZED	±50.0	

- NOTES:
- (1) SEE SECTION E FOR REINFORCEMENT DESCRIPTION.
 - (2) SEE SECTION A FOR OPTIONAL SILL TOWER DESCRIPTION.

TABLE OF CONTENTS		
SHEET	REV.	SHEET DESCRIPTION
1	--	GENERAL AND INSTALLATION NOTES
2	--	ELEVATION AND ANCHOR LAYOUT
3	--	SECTIONS AND GLAZING DETAIL

PROJECT #411-0706.1B

RESIVER PATIO DOOR
100, 181E RUE
BEAUCEVILLE, QUEBEC G5X 2T1

TITLE: NON-IMPACT SERIES R-301 VINYL FIXED WINDOW
GENERAL AND INSTALLATION NOTES


DRAWN BY: TJH
DATE: 07/11/12


SCALE: N.T.S.
DRAWING NO: RES1026

REV: -
SHEET: 1 OF 3


PTC PRODUCT DESIGN GROUP, LLC
PO BOX 50215
LONGWOOD, FLORIDA 32752
TX CERTIFICATE OF
REGISTRATION NO. E-13740
Phone: 321.660.1788
Fax: 321.660.1785
Email: info@ptc-con.com

Robert J. Amoruso, P.E.
TEXAS P.E. No. 80817

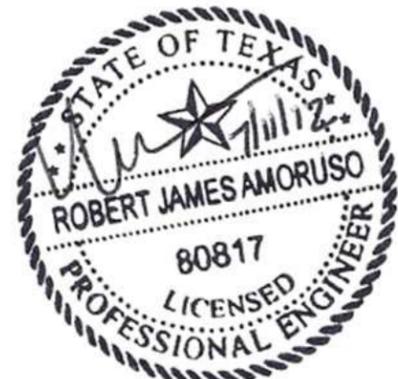

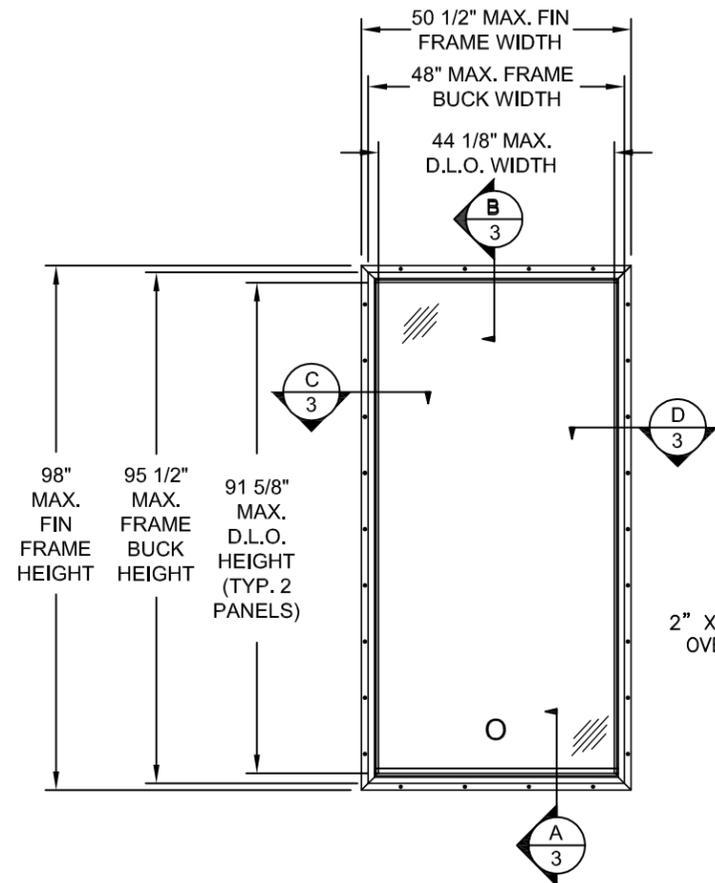

ELEVATION
EXTERIOR VIEW
48 X 96 O FIXED

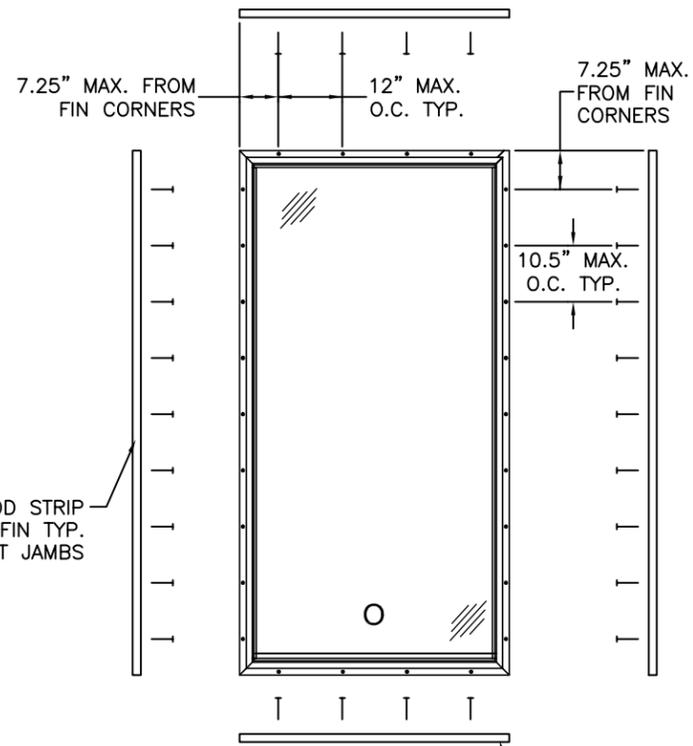

ANCHOR LAYOUT
EXTERIOR VIEW
2" X 4" WOOD STRIP OVER NAIL FIN TYP. AT HEAD & SILL.

PROJECT #411-0706.1B

RESIVER PATIO DOOR
100, 181E RUE
BEAUCEVILLE, QUEBEC G5X 2T1

TITLE: NON-IMPACT SERIES R-301 VINYL FIXED WINDOW
ELEVATION AND ANCHOR LAYOUT


PREPARED BY:	DATE:	07/11/12
DRAWN BY:	TJH	
SCALE:	N.T.S.	
DRAWING NO.:	RES1026	
REV:	-	
SHEET:	2 OF 3	

PTC PRODUCT DESIGN GROUP, LLC
100 BOYD ST. #200
LONGWOOD, FLORIDA 32752
Phone: 321.660.1788
Fax: 321.660.1785
Email: info@ptc-corp.com
REGISTRATION NO. F-13740


Robert J. Amoruso, P.E.
TEXAS P.E. No. 80817




REV	DESCRIPTION	DATE	BY
-	-	-	-

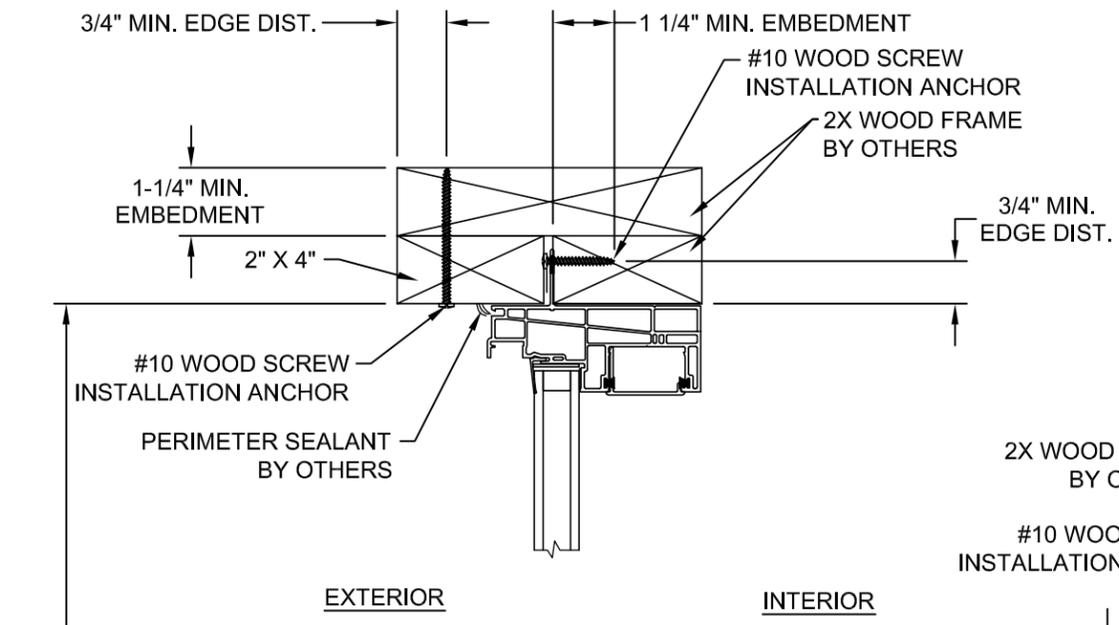


B VERTICAL SECTION
WOOD SUBSTRATE

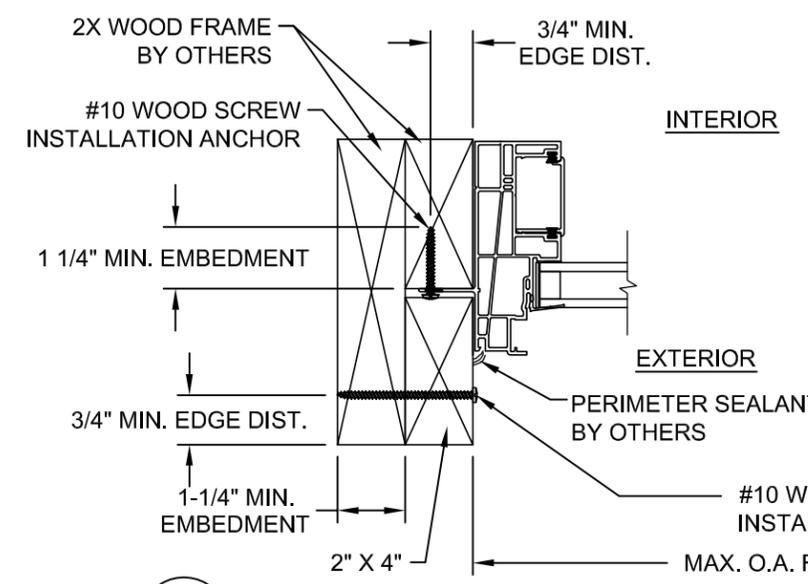


C HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

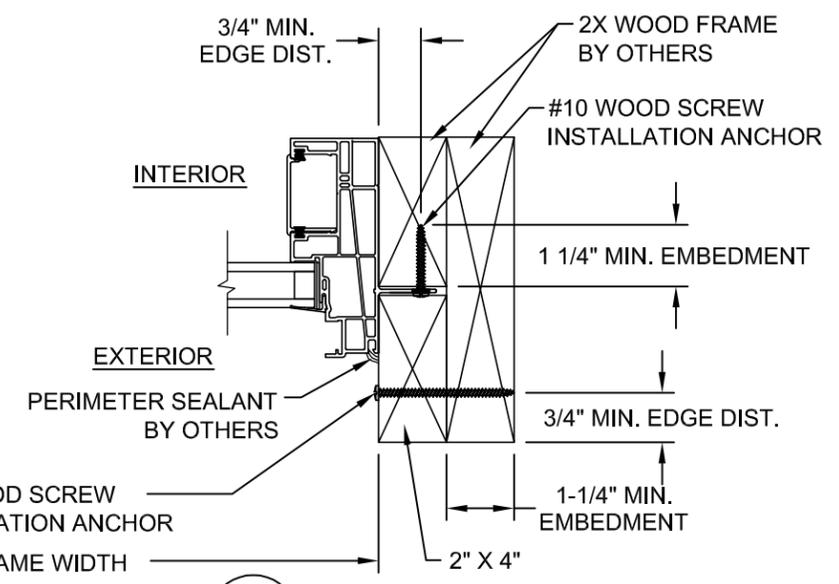

D HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

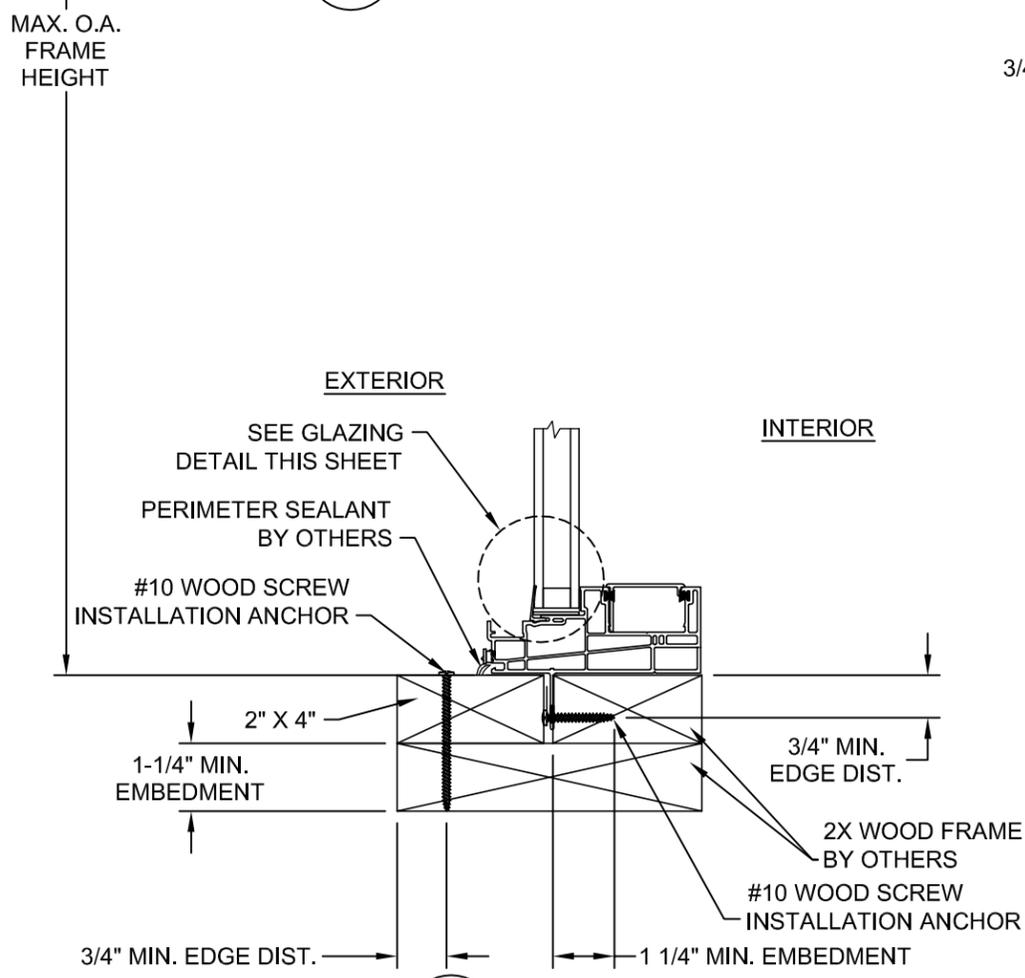

A VERTICAL SECTION
WOOD SUBSTRATE

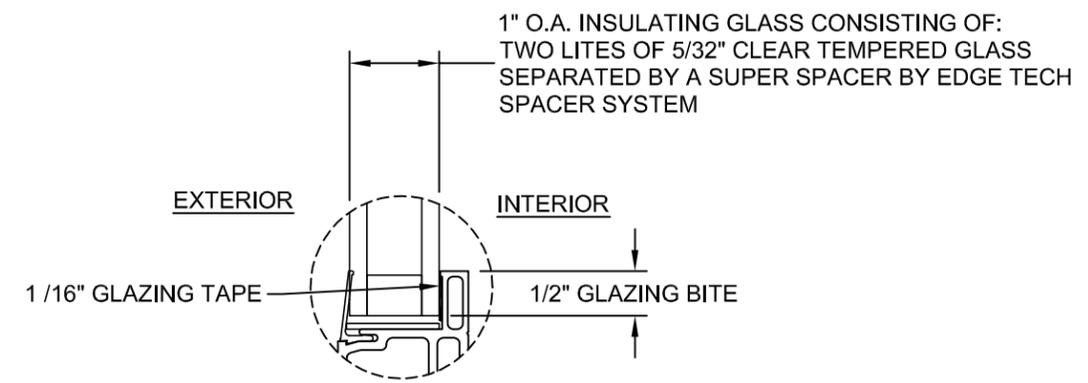

GLAZING DETAIL

PROJECT #411-0706.1B

RESIVER PATIO DOOR
100, 181E RUE
BEAUCEVILLE, QUEBEC G5X 2T1

TITLE: NON-IMPACT SERIES R-301 VINYL FIXED WINDOW SECTIONS & GLAZING DETAIL

DATE: 07/11/12
DRAWING NO: RES1026
SHEET: 3 OF 3
DRAWN BY: TJH
SCALE: N.T.S.
REV: -

PTC PRODUCT DESIGN GROUP, LLC
PO BOX 50292
LONGWOOD, FLORIDA 32752
PHONE: 321.660.1788
FAX: 321.660.1785
EMAIL: info@ptc-usa.com
REGISTRATION NO. F-13740

Robert J. Amoroso, P.E.
TEXAS P.E. No. 80817

