




SIDE VIEW

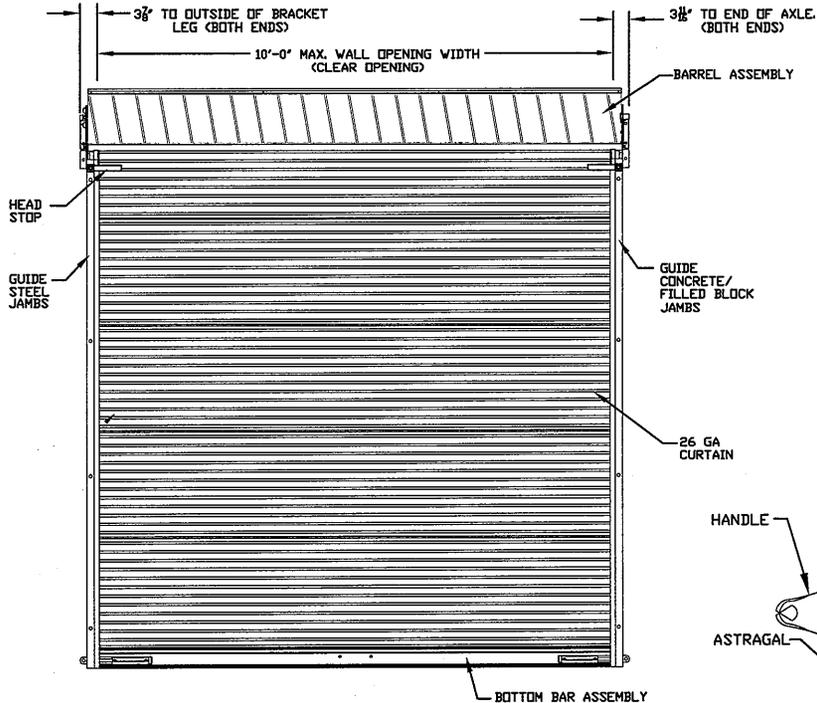

INSIDE ELEVATION

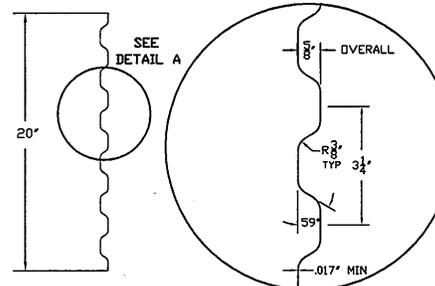


CURTAIN PANEL  
ASTM A653 GR 80 ZINC COATED STEEL  
PRE-PAINTED WITH FULL COAT OF PRIMER AND  
BAKED SILICONIZED POLYESTER FINISH COAT  
26 GA CURTAIN DETAIL

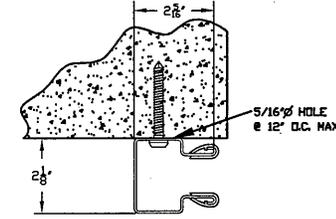


CONCRETE/FILLED BLOCK JAMBS  
USING 5/16" X 2-1/4" TAPCON XL

ALL COMPONENTS SHALL BE  
ASTM A653 STEEL W/MIN  
FY=33 KSI GALVANIZED  
PER ASTM A653 G-90




STEEL JAMBS  
USING #12-14 X 1" TEKS PANCAKE HEAD  
16 GA (.063) GUIDE MOUNTING DETAIL

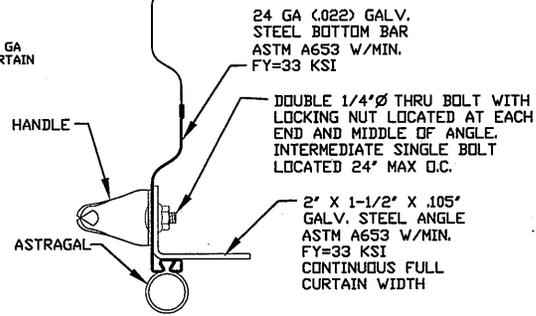

BOTTOM BAR ASSEMBLY

HEADROOM REQUIRED

OPENING HEIGHT	VERTICAL HEADROOM	HORIZONTAL HEADROOM
THRU 8'-0"	18"	17-1/2"
OVER 8'-0" THRU 10'-0"	18-1/2"	17-3/4"
OVER 10'-0" THRU 12'-0"	18-3/4"	18"
OVER 12'-0" THRU 14'-0"	19"	18-1/2"

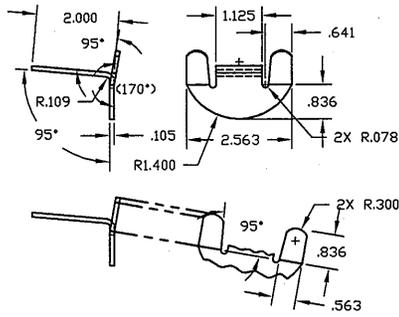

WINDLOCK  
GALV. STEEL,  
ASTM A653  
WITH MIN.  
FY=33KSI

THESE CONFIDENTIAL DOCUMENTS SUBMITTED BY JANUS CONTAIN INFORMATION OF A PROPRIETARY NATURE AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING IN PART OR IN WHOLE FOR ANY PURPOSE OTHER THAN THAT WHICH IS NECESSARY FOR PREPARATION OF BIDS OF ENGINEERING WITHOUT THE EXPRESS PERMISSION OF JANUS WHICH MAY RECALL DOCUMENTS AT ANY TIME.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE:

DECIMAL	FRACTIONS	ANGLES	HOLE DIAMETERS
.XX ±.03	1/16" ±.001	±30'	UNDER .251 +.004 -.003
.XXX ±.005	1/32" ±.0005		.251 to .500 +.006 -.003
			OVER .500 +.008 -.003


STATE OF TEXAS  
18627  
JOSEPH H. DIXON, JR.  
LICENSED PROFESSIONAL ENGINEER  
10/2/10

PART NUMBER:	
MATERIAL:	
APPLIED FINISH:	
UNIT OF MEASURE:	
APPROVALS	DATE
DRAWN: BECKY NELSON	5-30-07
CHECKED: DON MILLS	5-30-07
APPROVED: DON MILLS	5-30-07


**JANUS INTERNATIONAL CORPORATION**  
134 EAST LUKE ROAD TEMPLE, GA 30179-4435  
770-562-2850/Fax 770-562-2264  
© 2007 Janus International Corporation All Rights Reserved

CERTIFIED WIND LOAD RATED  
26 GA SERIES 1100 DOOR ASSEMBLY  
MAX. SIZE 10'-0" X 14'-0"


SIZE: B DRAWING NUMBER: T1013 REV: A  
SCALE: NONE SHEET: 1 OF 2

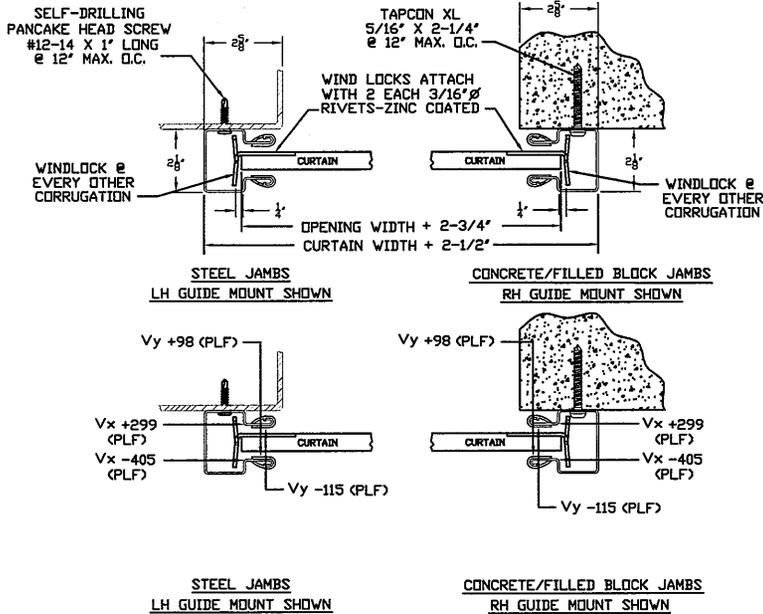

**SUPERIMPOSED LOAD DIAGRAM**

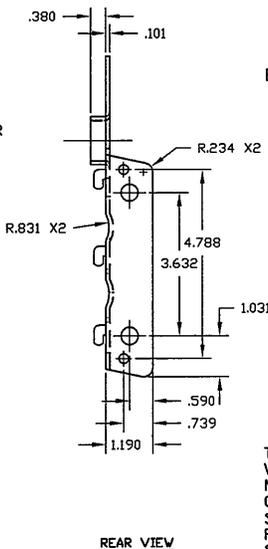

**REAR VIEW**

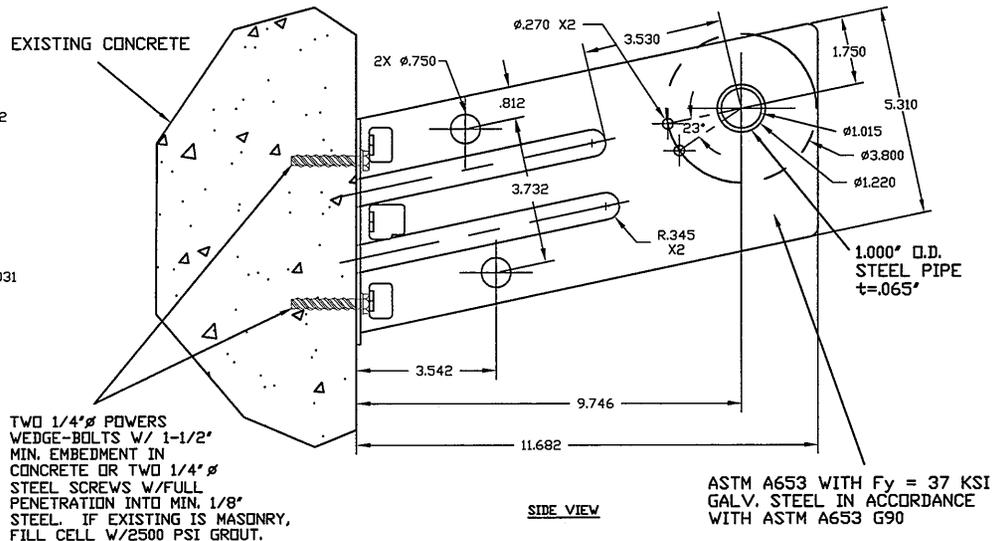

**SIDE VIEW**

**DOOR MOUNTING BRACKET DETAIL**

REVISIONS			
REV	DESCRIPTION	DATE	APPROVAL
—	DRAWING RELEASE	5-30-07	DM
A	NOTE REVISIONS	6-17-09	CS

**GENERAL NOTES**

- THIS ROLL-UP DOOR SYSTEM IS DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE.
- THIS ROLL-UP DOOR HAS BEEN TESTED IN ACCORDANCE WITH ASTM E-330 AND COMPLIES WITH ANSI/DASMA 108.  
  
DESIGN LOAD = +19.4 PSF  
                  -22.7 PSF
- WIND LOADS FOR BUILDING OPENINGS SHALL BE DETERMINED BY A PROFESSIONAL ENGINEER USING APPROPRIATE WIND SPEED AND DESIGN CRITERIA. THIS DOOR MAY BE USED WHERE THE DESIGN LOAD MEETS OR EXCEEDS THE DESIGN LOAD FOR THE BUILDING OPENING.
- SUPERIMPOSED LOADS ON THE JAMBS FROM THIS DOOR ARE DESIGNED AS Vx AND Vy HEREIN. CONTRACTORS SHALL HAVE BUILDING ENGINEER VERIFY ADEQUACY OF BUILDING STRUCTURE TO RESIST SUPERIMPOSED LOADS Vx, Vy AND BRACKET LOADS SHOWN.
- ALL WELDING SHALL BE PERFORMED BY QUALIFIED WELDERS IN ACCORDANCE WITH A.W.S. SPECIFICATIONS, LATEST EDITION. ALL WELDING ELECTRODES SHALL CONFORM TO A.W.S. A5.1 GRADE E-70.
- DOORS SHALL BE PROVIDED WITH LOCK MECHANISMS AT THE OPTION OF THE OWNER.
- ALL BOLTS AND WASHERS SHALL BE GALVANIZED OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI.

- DESIGN BASED ON CERTIFIED TESTING LABORATORIES, INC., TEST REPORT NO. CTLA - 983W-3
- ANCHOR NOTES:  
A. EMBEDMENT LENGTH DOES NOT INCLUDE STUCCO FINISH.  
B. FOR HOLLOW MASONRY, FILL ALL CELLS @ ANCHOR WITH 2500 PSI GROUT.  
C. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
- DOOR OPERATION TYPE TO BE PUSH-UP, HAND CHAIN OR ELECTRIC.

- GUIDE TO JAMB ATTACHMENT FASTENERS BEGIN 4' FROM FLOOR AND END 3-1/2' BELOW TOP OF WALL OPENING.
- TEST DOOR WALL OPENING SIZE: 10'-0" x 8'-0".

THESE CONFIDENTIAL DOCUMENTS SUBMITTED BY JANUS CONTAIN INFORMATION OF A PROPRIETARY NATURE AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING IN PART OR IN WHOLE FOR ANY PURPOSE OTHER THAN THAT WHICH IS NECESSARY FOR PREPARATION OF BIDS OF ENGINEERING WITHOUT THE EXPRESS PERMISSION OF JANUS WHICH MAY RECALL DOCUMENTS AT ANY TIME.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE:


DECIMAL	FRACTIONS	ANGLES	HOLE DIAMETERS
.XX ±.03	+		UNDER .251 +.004
.XXX ±.005			-.003
			251 to .500 +.006
			-.003
			OVER .500 +.008
			-.003

PART NUMBER	
MATERIAL	
APPLIED FINISH	
UNIT OF MEASURE	
APPROVALS	
DATE	
DRAWN	DATE
BECKY NELSON	5-30-07
CHECKED	DATE
DON MILLS	5-30-07
APPROVED	DATE
DON MILLS	5-30-07

**JANUS INTERNATIONAL CORPORATION**  
 134 EAST LUKE ROAD TEMPLE, GA 30179-4435  
 770-562-2850/Fax 770-562-2264  
 © 2007 Janus International Corporation All Rights Reserved

**CERTIFIED WIND LOAD RATED**  
 26 GA SERIES 1100 DOOR ASSEMBLY  
 MAX. SIZE 10'-0" X 14'-0"

SIZE	DRAWING NUMBER	REV
<b>B</b>	T1013	<b>A</b>
SCALE	SHEET 2 OF 2	
NONE		

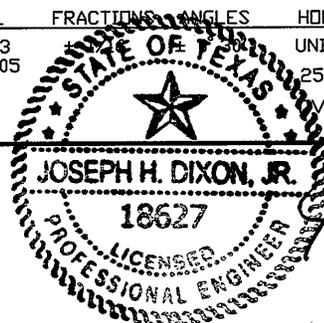

*Handwritten signature and date: 10/2/10*