
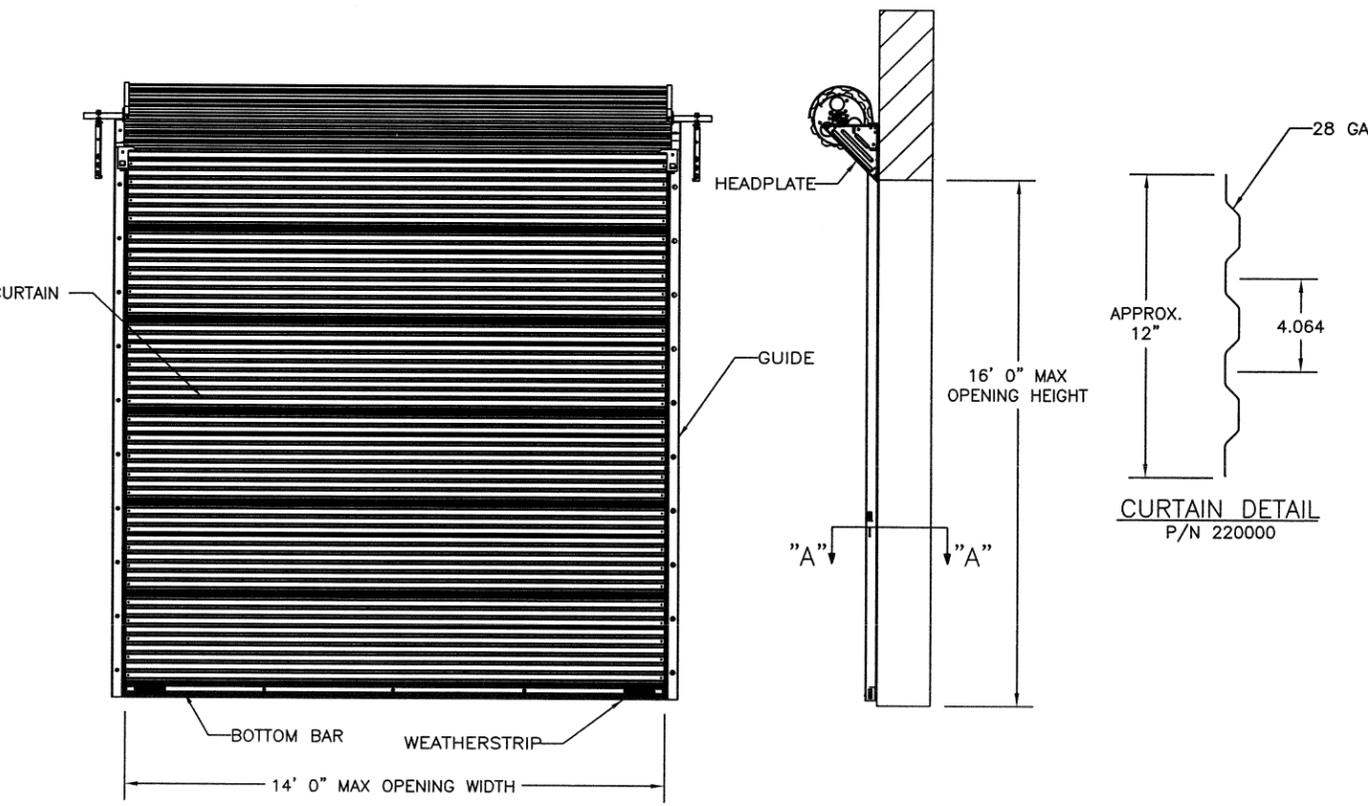
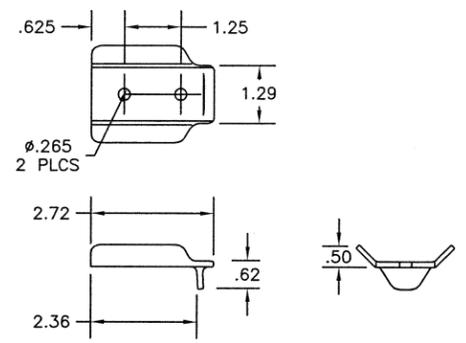
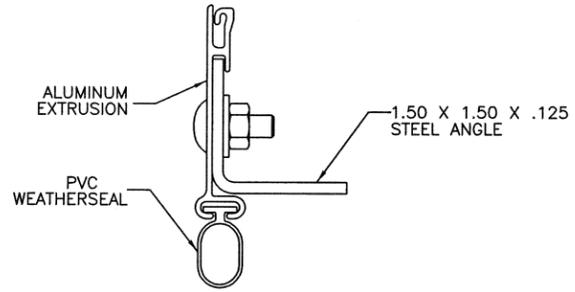


NOTES

- DESIGNED AND TESTED IN ACCORDANCE WITH FLORIDA BLDG CODE AND INTERNATIONAL BLDG CODE.
- SPACING IS THE CENTER TO CENTER DIMENSION. BOTTOM FASTENER WITHIN 6 INCHES OF FLOOR.
- PRESSURES LISTED AS ±DESIGN PSF.
- CONCRETE JAMBS SHALL BE 3000 PSI CONCRETE MINIMUM.
- WOOD JAMBS SHALL BE SOUTHERN YELLOW PINE (SP. GR.=0.55) MINIMUM.
- APPROVED CONCRETE ANCHORS: TAPCON OR EQUIVALENT.
- STEEL GAUGE THICKNESSES PER DASMA TDS#154.

- JAMB CONSTRUCTION AND DESIGN BY OTHERS. JAMBS MUST BE DESIGNED TO WITHSTAND THE MAXIMUM MOMENT, NORMAL, AND PARALLEL FORCES IMPOSED ON THEM BY THE DOOR, AS LISTED BELOW:  
 GUIDE 1: MOMENT= 1133 IN-LBS PER FT OF DOOR HEIGHT  
 NORMAL= 186 LBS/FT OF DOOR HEIGHT  
 PARALLEL = 356 LBS/FT OF DOOR HEIGHT

REVISIONS				
EN	REV	DESCRIPTION	DATE	APPROVAL
11675	-	RFP PER EN		

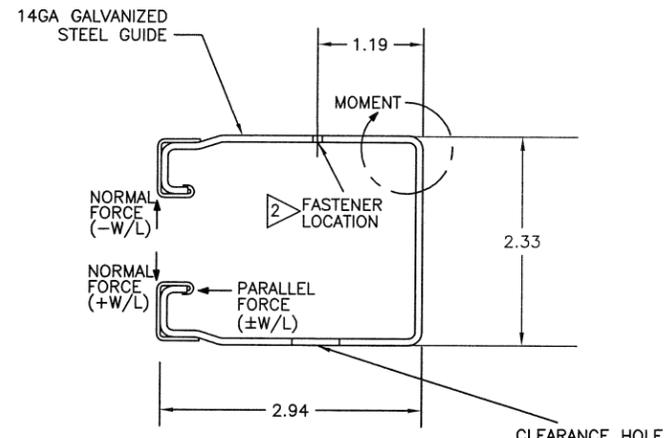

GUIDE 1 SPECIFICATION						
WIDTH	JAMB TYPE	22/-22 psf	26/-26 psf	31/-31 psf	36/-36 psf	41/-41 psf
8'	STEEL	S1	S1	S2	S2	S2
	CONCRETE	C1	C1	C1	C1	C1
	WOOD	W1	W1	W1	W1	W1
10'	STEEL	S1	S2	S2	S2	S2
	CONCRETE	C1	C1	C1		
	WOOD	W1	W1	W1	W1	
12'	STEEL	S2	S2	S3		
	CONCRETE	C2				
	WOOD	W1				
14'	STEEL	S3	S3			
	CONCRETE					
	WOOD					

JAMB AND FASTER DEFINITIONS	
FASTER:	DEFINITION:
S1	1/4"-20 SELF DRILLING SCREW
	12" SPACING
	JAMB STEEL 14 GA THICK MIN.
S2	1/4"-20 SELF DRILLING SCREW
	12" SPACING
	JAMB STEEL 12 GA THICK MIN.
S3	1/4"-20 SELF DRILLING SCREW
	6" SPACING
	JAMB STEEL 12 GA THICK MIN.
C1	1/4" TAPCON, 1.75" EMBED
	12" SPACING
C2	1/4" TAPCON, 1.75" EMBED
	6" SPACING
W1	1/4" X 2.5" LAG SCREW
	12" SPACING

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.

REF DWG	USED ON	THIRD ANGLE PROJECTION	TOLERANCES UNLESS OTHERWISE SPECIFIED	FINISH	OVERHEAD DOOR DALLAS, TEXAS	NAME	DATE	DRAWING TITLE
		ASME Y14.100 AND Y14.5 APPLY, UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN U.S. CUSTOMARY UNITS.	WHOLE NUMBERS: ±.25 .X ±.1 .XX ±.03 .XXX ±.010 ANGLES: ± 1° HOLES: ±	NONE		MATERIAL: N/A	M. SAWICKI	12/14/10
				UNIT OF MEASURE		CHECKED BY:		DRAWING NUMBER
				EACH		APPROVED BY:		D-411119
								SCALE: NONE SHEET 1 OF 1