

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED


NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE 2006 IBC AND 2006 IRC WITH STATE OF TEXAS MODIFICATIONS.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300-04.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 1/8" THICK MINIMUM


SIGNED: 05/04/2015

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 - 6	INSTALLATION DETAILS


WINDOW MART MFG., LLC. 5760 ALBERT PIKE, P.O. BOX 570 ROYAL, AR 71968		
7122 UNIFRAME TWIN SINGLE HUNG NON-REINFORCED - NON-IMPACT NOTES		
DRAWN: N.G.	DWG NO. 08-02696	REV -
SCALE NTS	DATE 05/04/15	SHEET 1 OF 6

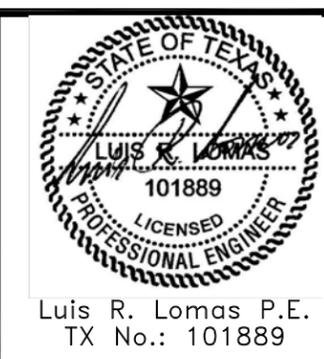

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

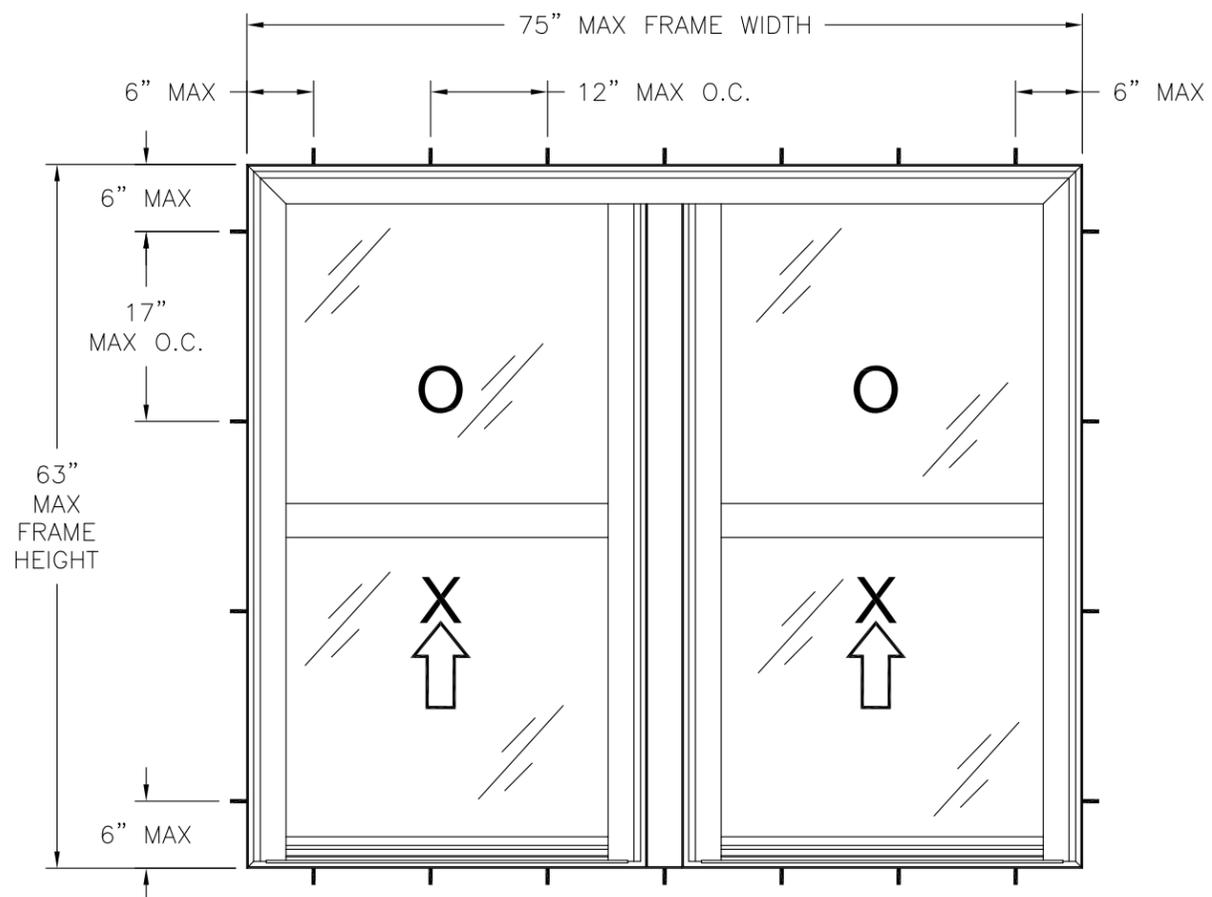

7122 UNIFRAME TWIN SINGLE HUNG
EXTERIOR VIEW
FRAME INSTALLATION

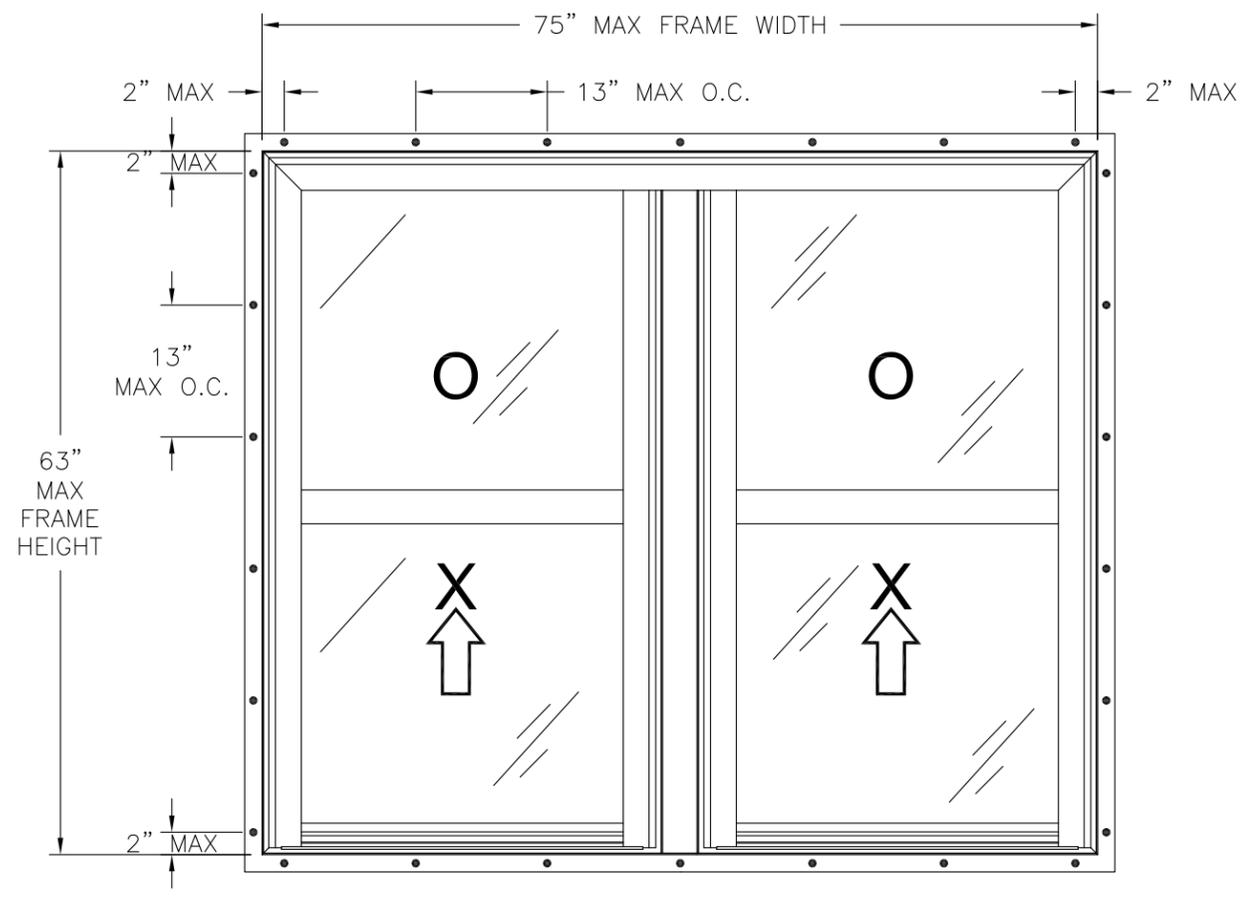

7122 UNIFRAME TWIN SINGLE HUNG
EXTERIOR VIEW
FIN INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING
+45.0/-50.0PSF	NONE

NOTES:

1. MAXIMUM SASH SIZE: 34 1/8" X 30 5/8"
2. MAXIMUM D.L.O.: 32 5/16" X 28 1/16"
3. (4) 3/8" X 3/16" WEEP SLOT AT BOTTOM RAIL GLAZING POCKET THROUGH BOTTOM SURFACE, ONE AT EACH END.
4. (4) 1 1/8" WEEP NOTCH AT SILL SCREEN RETENTION LEG, ONE AT EACH JAMB/MULLION.
5. (4) 1 3/4" WEEP NOTCH AT SILL SCREEN RETENTION LEG, ONE AT EACH JAMB/MULLION
6. (4) 3/16" WEEP SLOT AT FIXED MEETING RAIL GLAZING POCKET THROUGH BOTTOM SURFACE, ONE AT EACH END.
7. (4) 3/16" X 3/16" WEEP SLOT AT FIXED MEETING RAIL BOTTOM SURFACE OF SHEAR BLOCK, ONE PER BLOCK.

SIGNED: 05/04/2015

HARDWARE SCHEDULE	
A.	(4) COMPOSITE CAM LOCK WITH KEEPER (2802) 8" FROM EACH END OF LOCK RAIL
B.	(4) CONSTANT FORCE BALANCE WITH TILT LOCKING SHOE, ONE PER JAMB/MULLION
C.	(4) METAL PIVOT BARS, ONE AT EACH END OF BOTTOM RAILS
D.	(4) PLASTIC FLUSH MOUNT TILT LATCH, ONE AT EACH END OF LOCK RAILS


WINDOW MART MFG., LLC.
5760 ALBERT PIKE, P.O. BOX 570
ROYAL, AR 71968

7122 UNIFRAME TWIN SINGLE HUNG
NON-REINFORCED - NON-IMPACT
ELEVATIONS


DRAWN: N.G.	DWG NO. 08-02696	REV -
SCALE NTS	DATE 05/04/15	SHEET 2 OF 6

Luis R. Lomas P.E.
TX No.: 101889

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

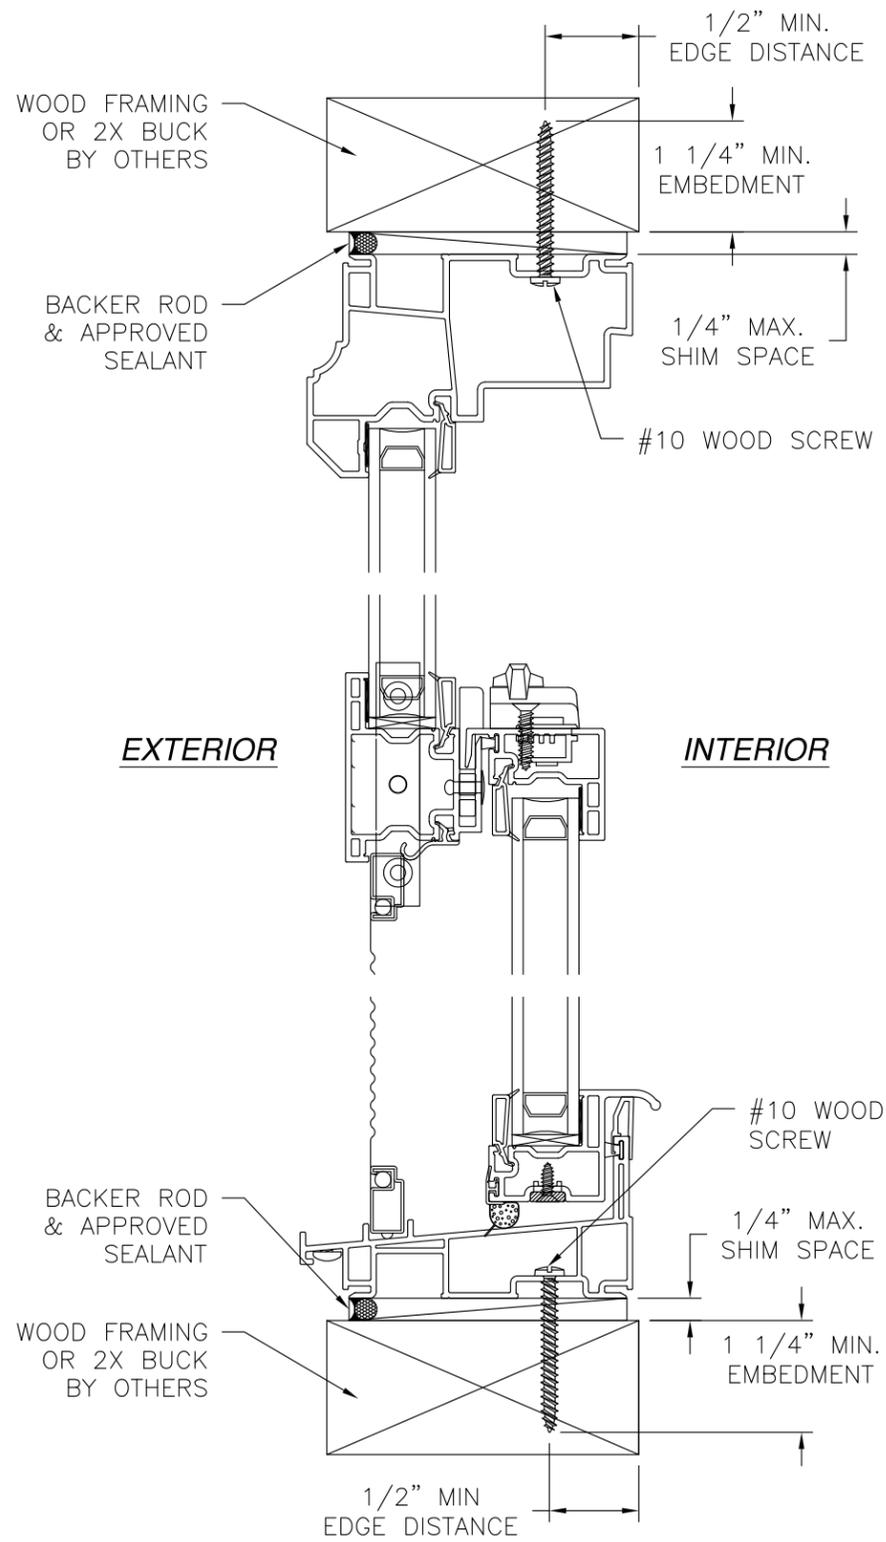

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

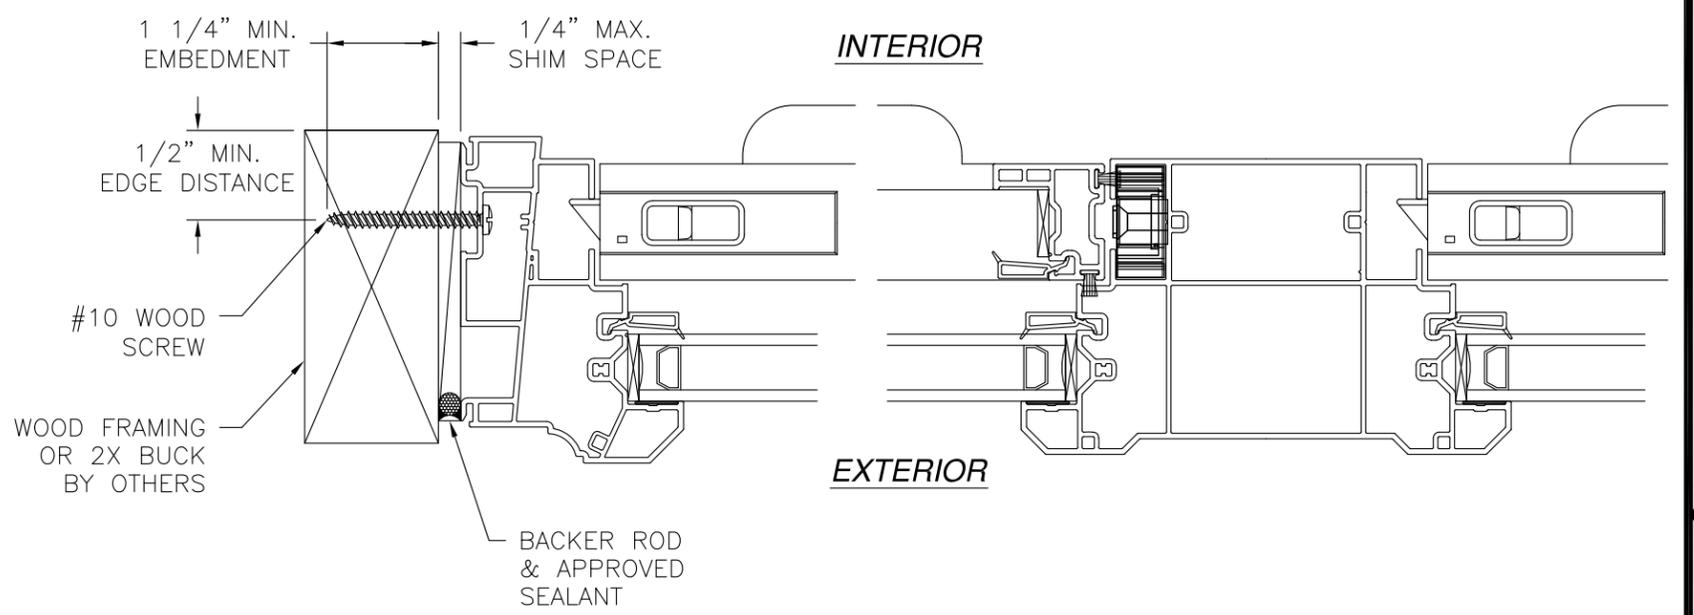

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 05/04/2015


WINDOW MART MFG., LLC. 5760 ALBERT PIKE, P.O. BOX 570 ROYAL, AR 71968		
7122 UNIFRAME TWIN SINGLE HUNG NON-REINFORCED - NON-IMPACT INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02696	REV -
SCALE NTS	DATE 05/04/15	SHEET 3 OF 6

Luis R. Lomas P.E.
TX No.: 101889


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

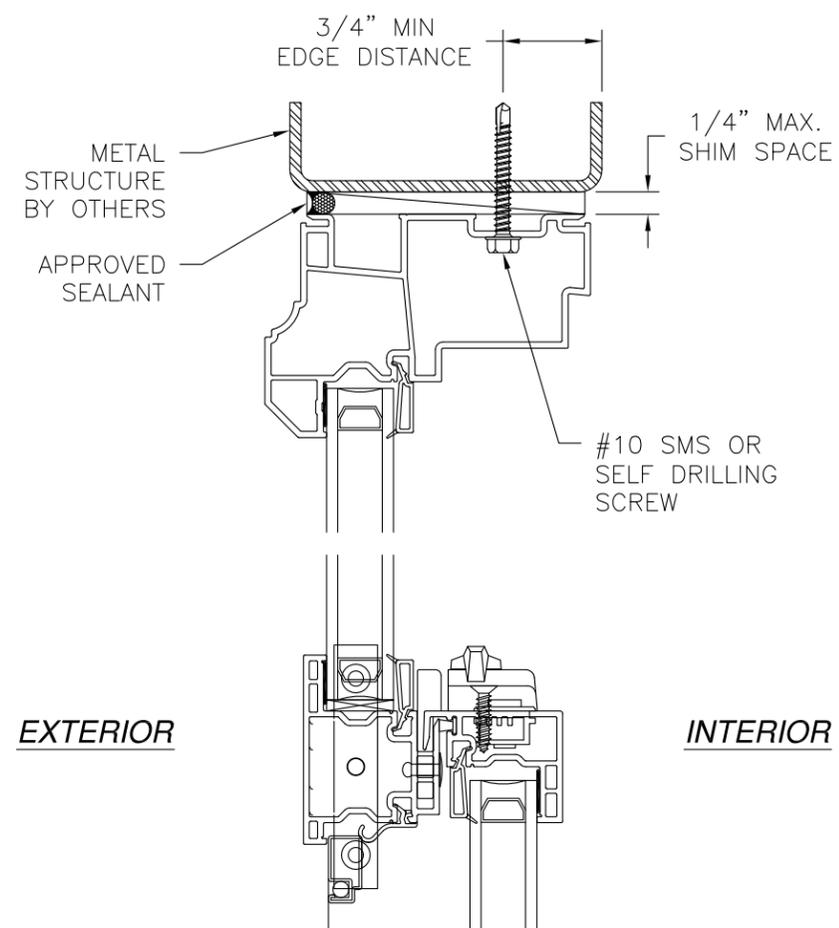

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

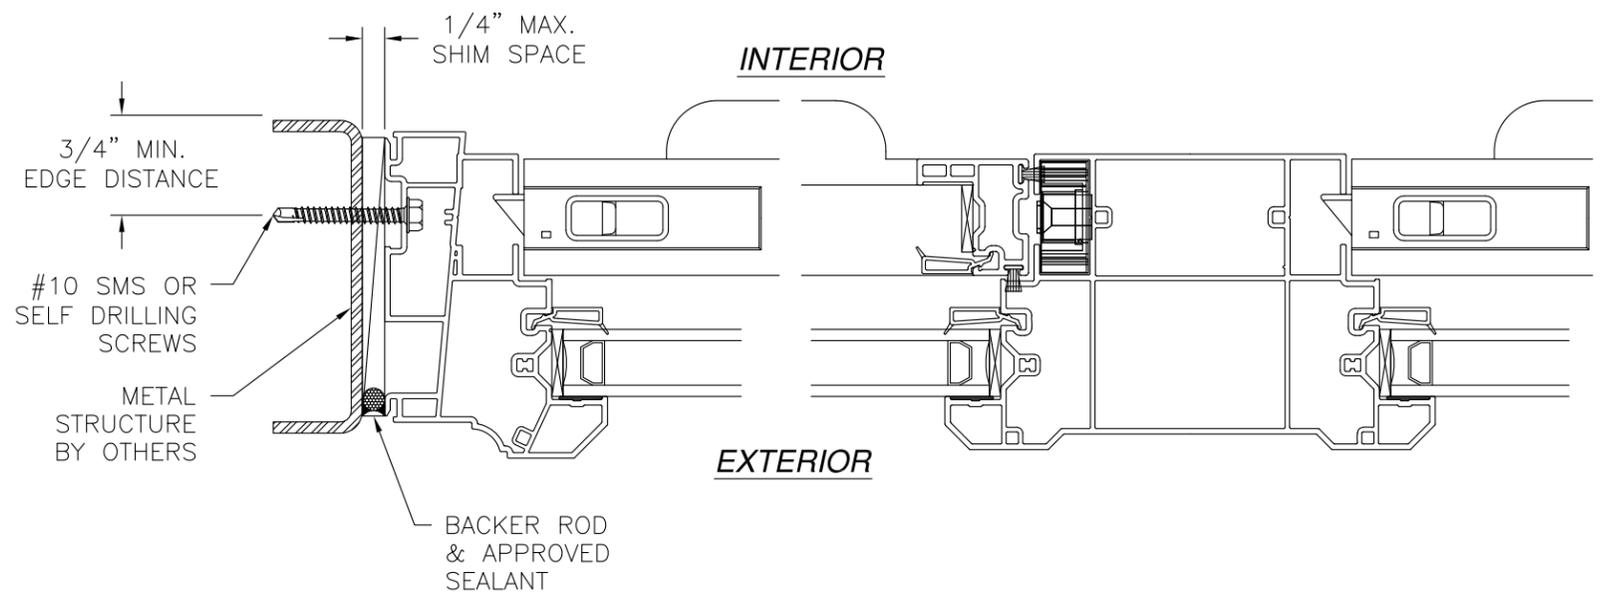

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

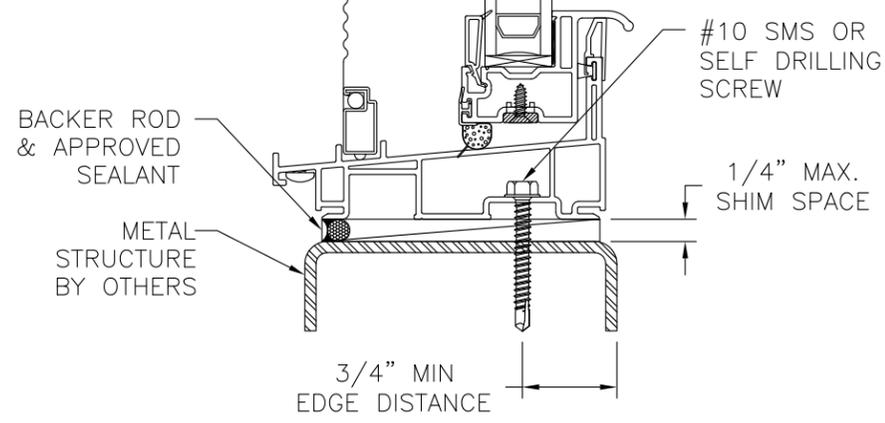

NOTES:
 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

WINDOW MART MFG., LLC.
 5760 ALBERT PIKE, P.O. BOX 570
 ROYAL, AR 71968

7122 UNIFRAME TWIN SINGLE HUNG
 NON-REINFORCED - NON-IMPACT
 INSTALLATION DETAILS


DRAWN: N.G.	DWG NO. 08-02696	REV -
SCALE NTS	DATE 05/04/15	SHEET 4 OF 6

SIGNED: 05/04/2015




Luis R. Lomas P.E.
 TX No.: 101889

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

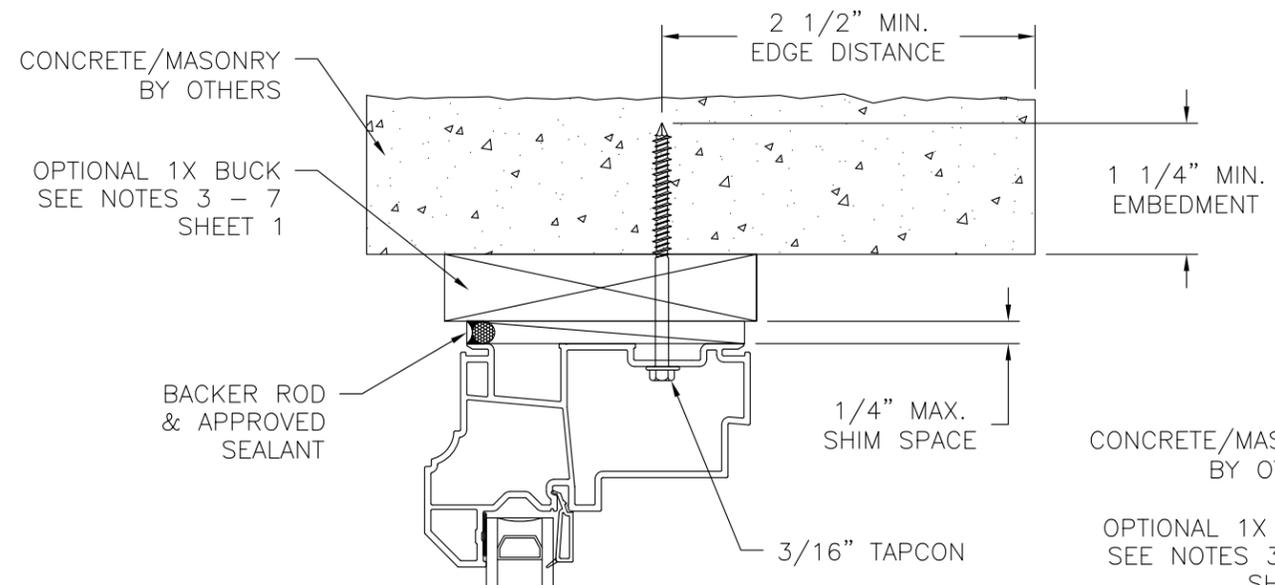

EXTERIOR


INTERIOR

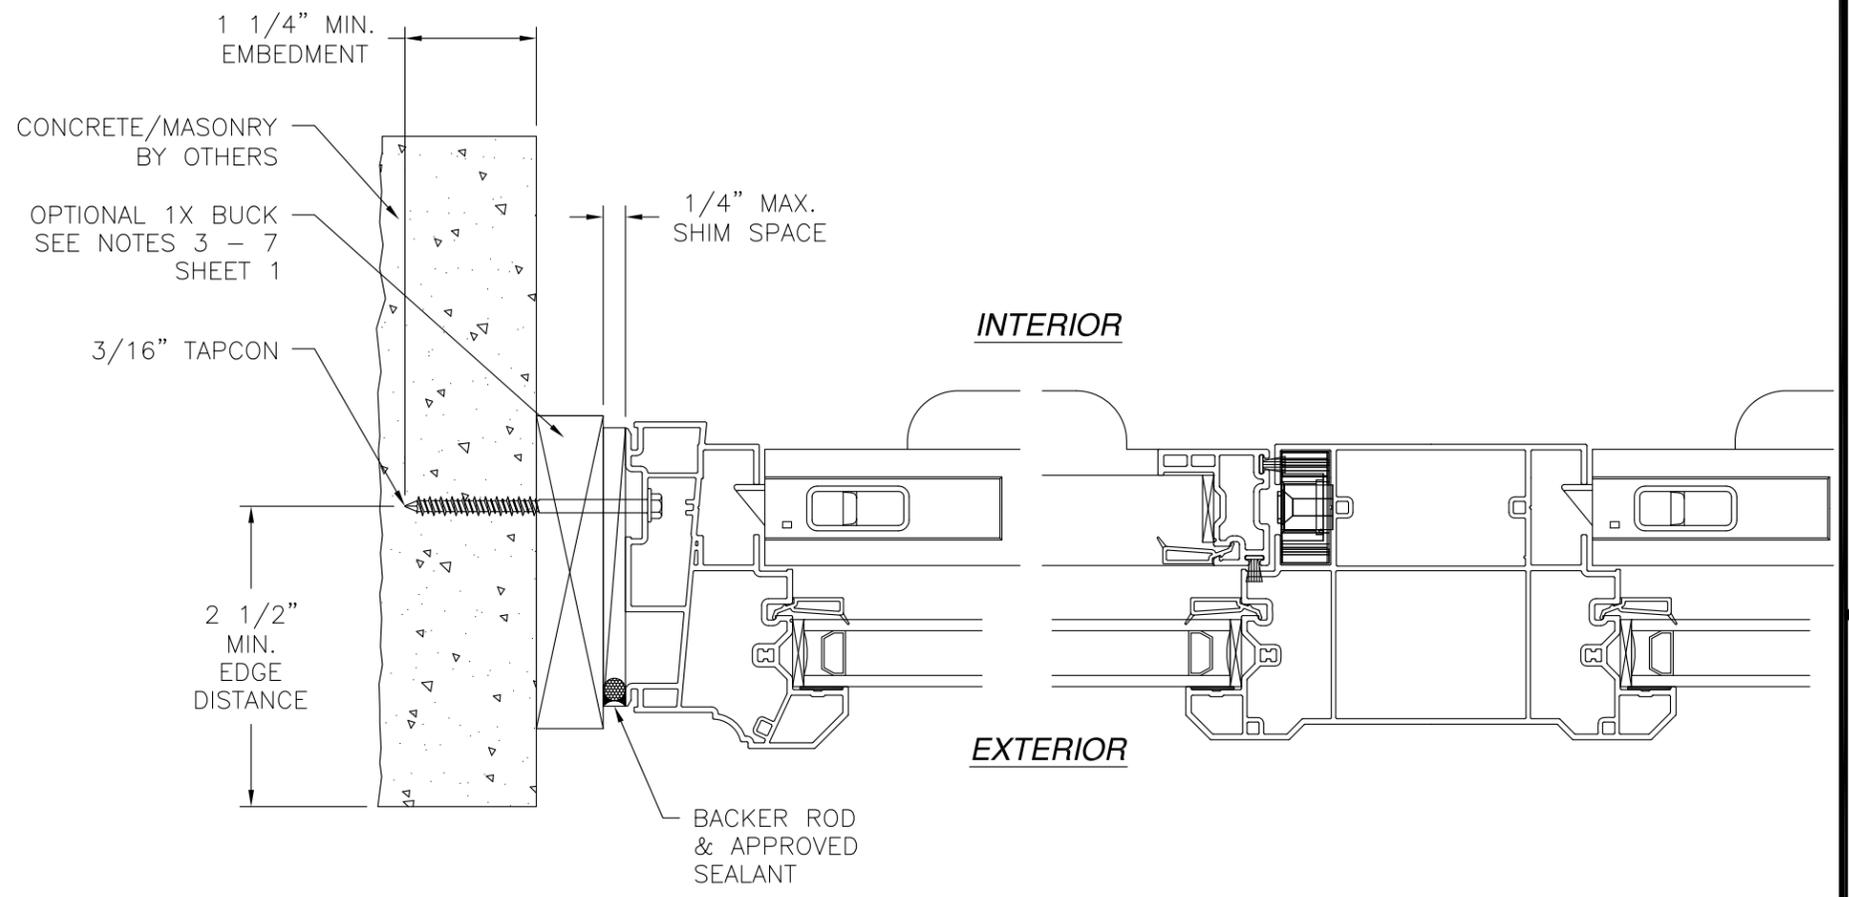

INTERIOR

EXTERIOR

**JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION**

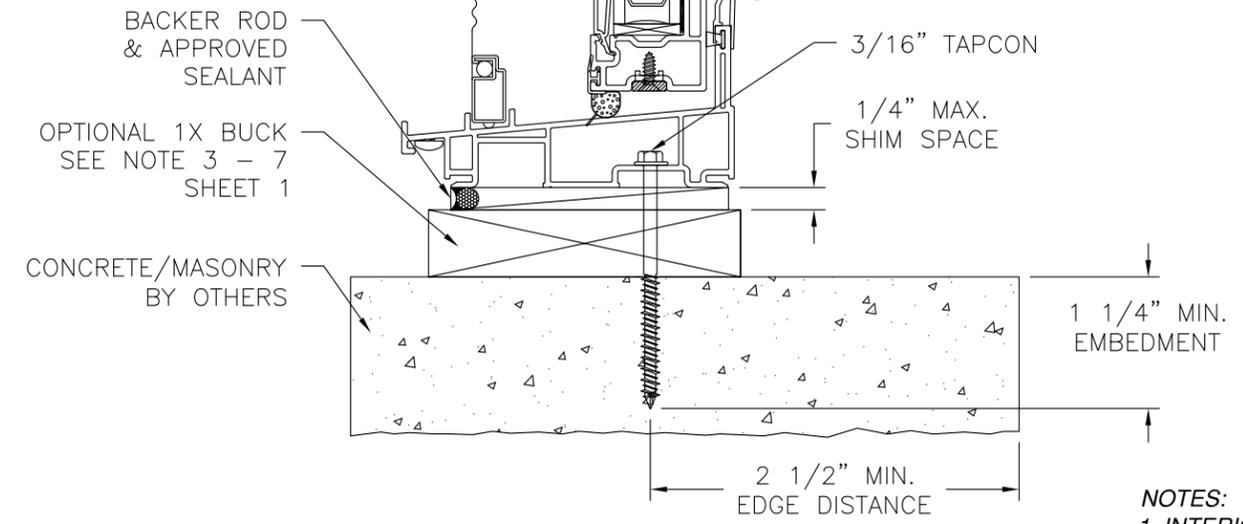

**VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION**



- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 05/04/2015

WINDOW MART MFG., LLC. 5760 ALBERT PIKE, P.O. BOX 570 ROYAL, AR 71968		
7122 UNIFRAME TWIN SINGLE HUNG NON-REINFORCED - NON-IMPACT INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02696	REV -
SCALE NTS	DATE 05/04/15	SHEET 5 OF 6


Luis R. Lomas P.E.
TX No.: 101889

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

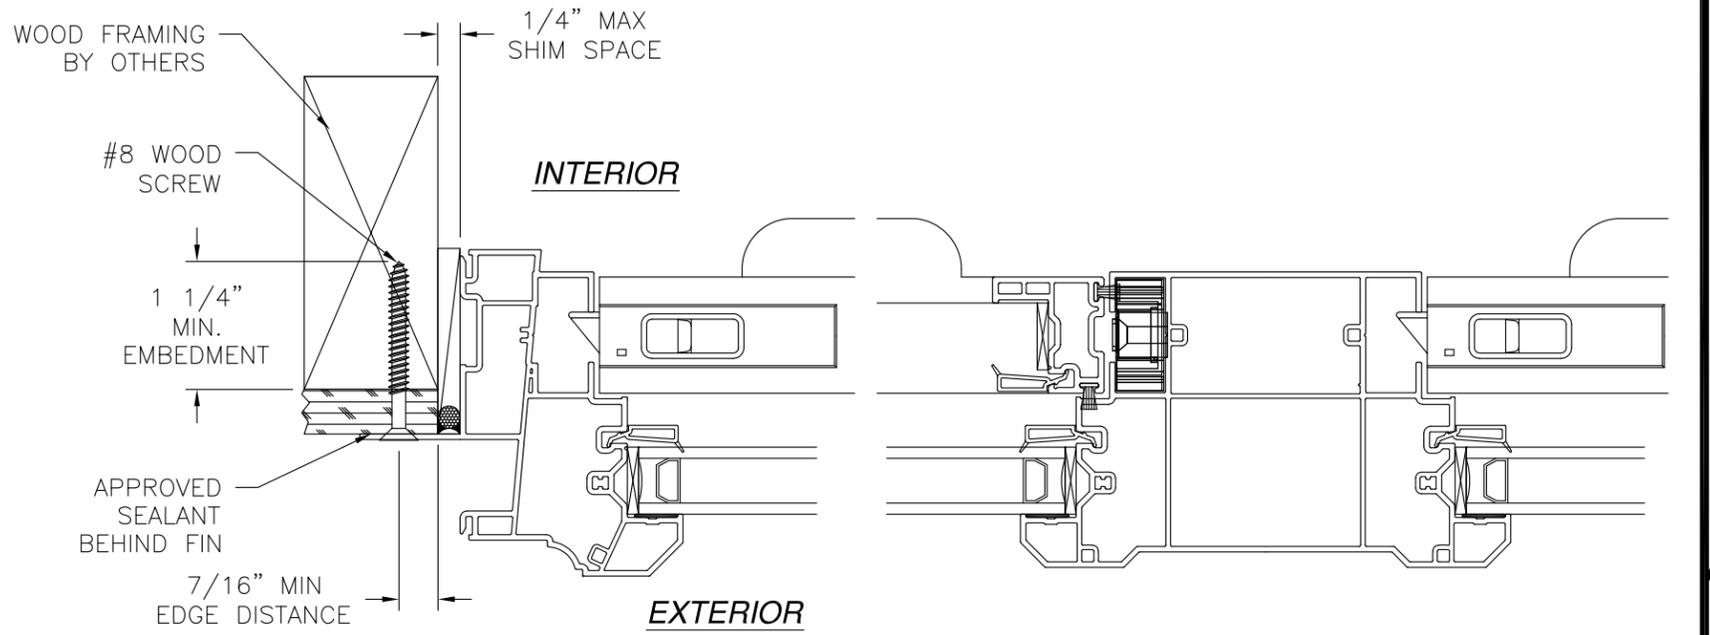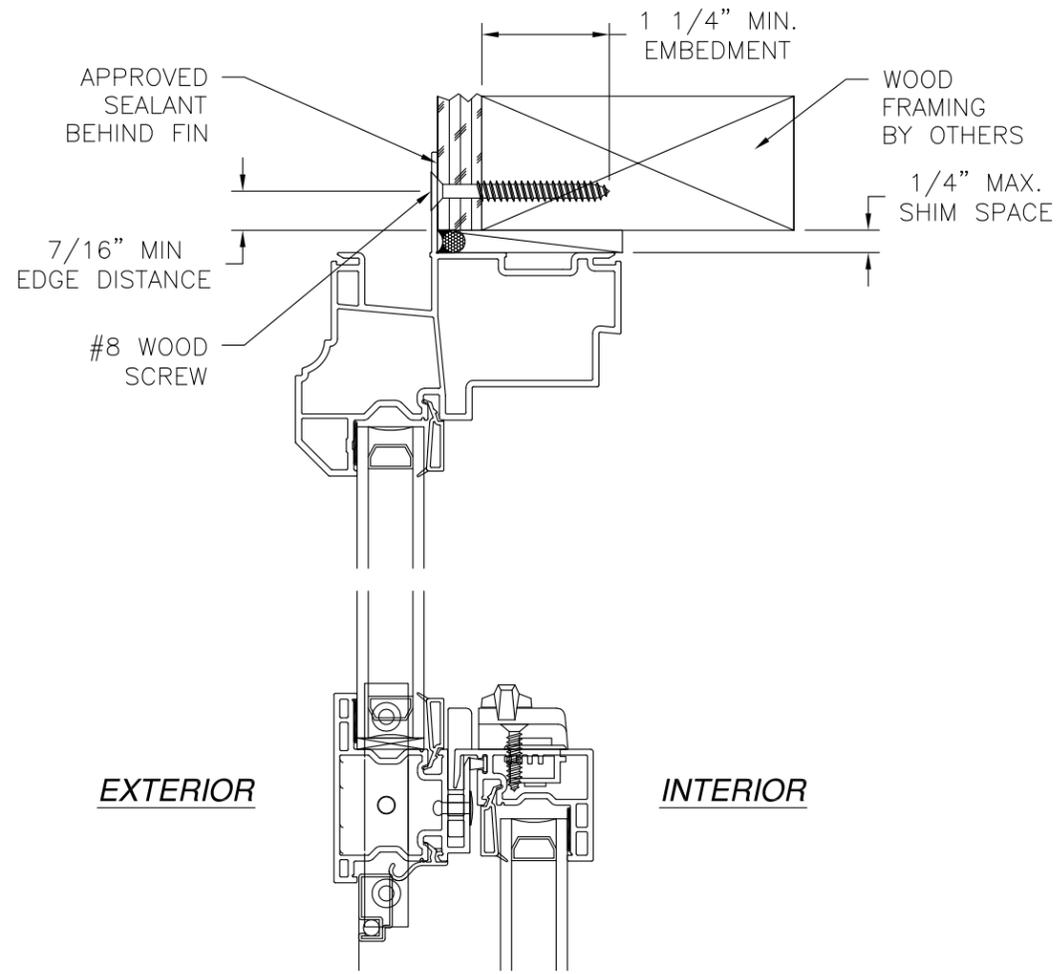

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

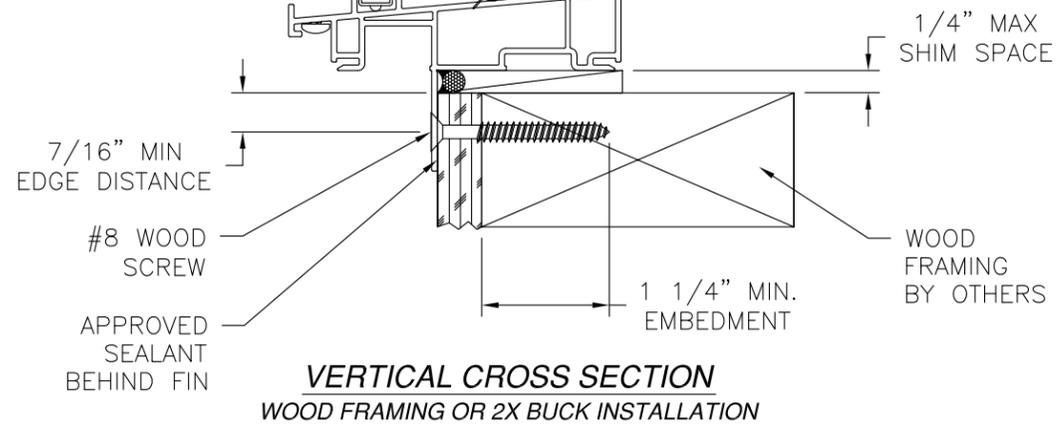

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

WINDOW MART MFG., LLC.
5760 ALBERT PIKE, P.O. BOX 570
ROYAL, AR 71968

7122 UNIFRAME TWIN SINGLE HUNG
NON-REINFORCED - NON-IMPACT
INSTALLATION DETAILS

DRAWN: N.G.	DWG NO. 08-02696	REV -
SCALE NTS	DATE 05/04/15	SHEET 6 OF 6

SIGNED: 05/04/2015



Luis R. Lomas P.E.
TX No.: 101889