CREST DOORS, INC.

157 HUMBLE AVE. ~ SAN ANTONIO, TEXAS 78225

GLAZED STEEL DOUBLE DOOR
w/ or w/o SIDELITES
INSWING / OUTSWING
"NON-IMPACT"

EVALUATED FOR USE IN THE STATE OF TEXAS

The Crest Fiberglass Door described herein complies with the 2006 International Residential Code (IRC), Sections R301 & R613 and the 2006 International Building Code (IBC), Sections 1405.12, 1609, 1714.5, 2403 and 2404 (including Texas revisions) subject to the following conditions:

1. Anchors shall be as listed and spaced as shown in the details. Anchor embedment to base material shall be beyond wall dressing or stucco.
2. When used in areas requiring wind-borne debris protection this product is required to be protected with an impact resistant covering that complies with Section R301.2.1.2 of the IRC and Section 1609.1.2 of the IBC.
3. Allowable design pressure requirements must be equal to or less than the design pressure rating shown in the design pressure chart, sheet 1 of this drawing.
4. Conditions not covered by this drawing are subject to further engineering analysis.

SUPPORTING DOCUMENTS & EVIDENCE

1. Testing per AAMA/WDMA/CSA 101/I.S.2/A440-05 :
   Testing Evaluation Laboratories, Inc. test report(s) #: TEL 01520140.
2. Calculations (Anchoring and Glass load resistance report ASTM E1300-04) prepared by Lyndon F. Schmidt, P.E.
3. Certificate of Participation issued by the National Accreditation and Management Institute, Inc., certifying that Crest Doors, Inc. is manufacturing products within a Quality Assurance program.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel & glazing details
3	Sidelite panel & glazing details
4	Elevations
5	Horizontal cross sections
6	Vertical cross sections
7	Vertical cross sections
8	Frame anchoring
9	Frame anchoring
10	Astragal details
11	Components and bill of materials

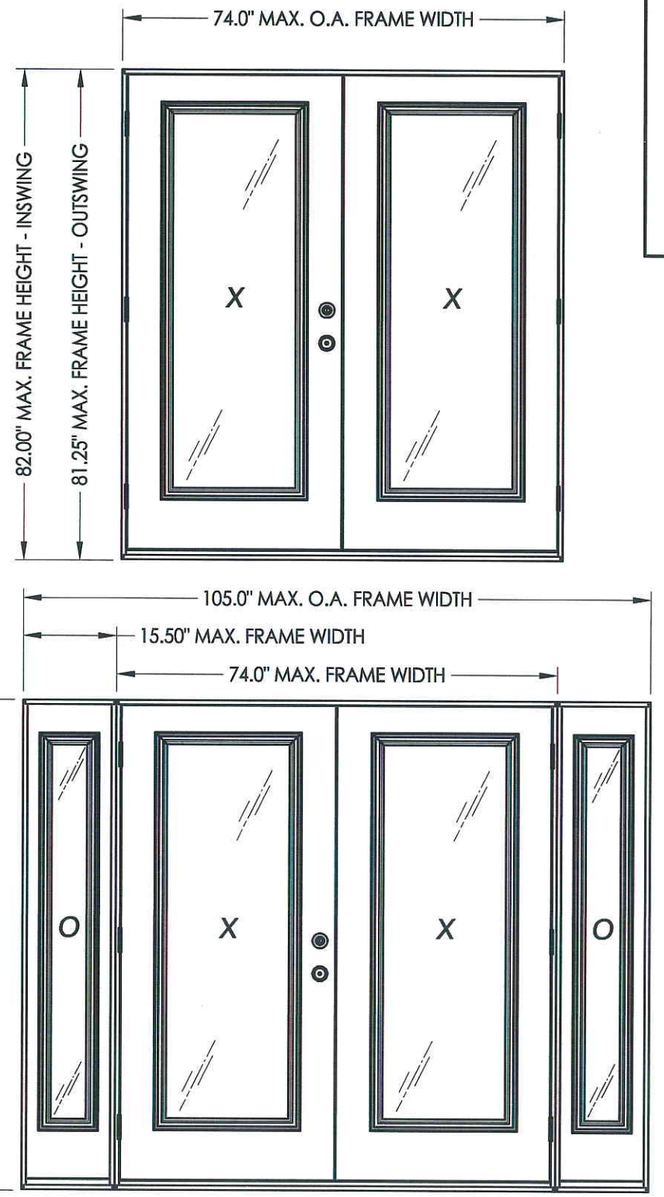

CONFIGURATION	MAX. FRAME DIMENSION	MAX. SIDELITE D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
				POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX	74.00" x 82.00"	21.0" x 63.0"	G1	+30.0	-35.0	+30.0	-30.0
OXXO	105.00" x 82.00"	21.0" x 63.0"		+30.0	-35.0	+30.0	-30.0

STATE OF TEXAS ★★★ LYNDON F. SCHMIDT 104123 LICENSED PROFESSIONAL ENGINEER 5.25.10

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

NO.	DATE	BY	REVISIONS

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 1 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, TX-4097

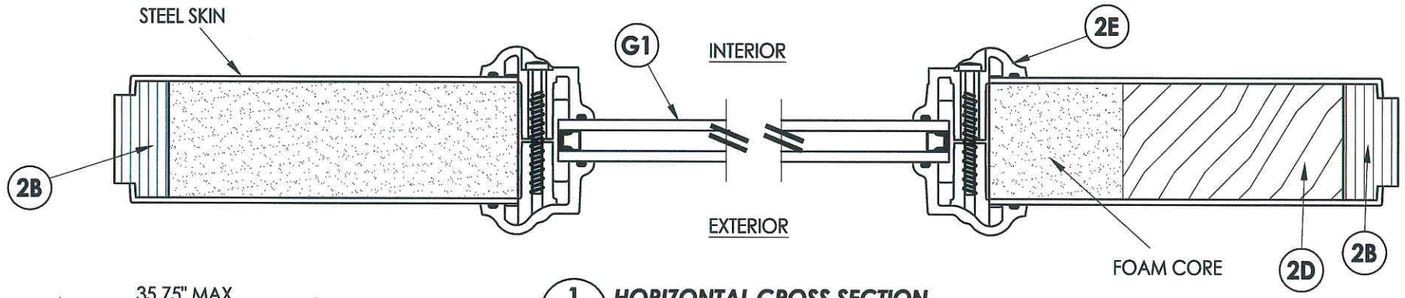

1/2 HORIZONTAL CROSS SECTION

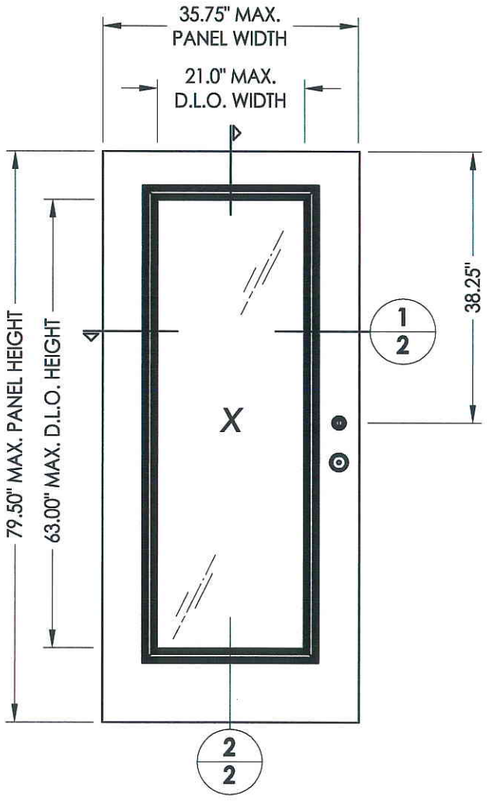

40 DOOR PANEL
Steel

STEEL DOOR SKIN: MIN. 0.019" THK.
CORE MATERIAL: EPS FOAM (POLYSTYRENE)

NOTE:
1. Spacing for lite frame screws is as follows:
   Sides: 4.5" from corners and 11.5" o.c. thereafter
   Top & Bottom: 4.5" from corners and @ centerline.

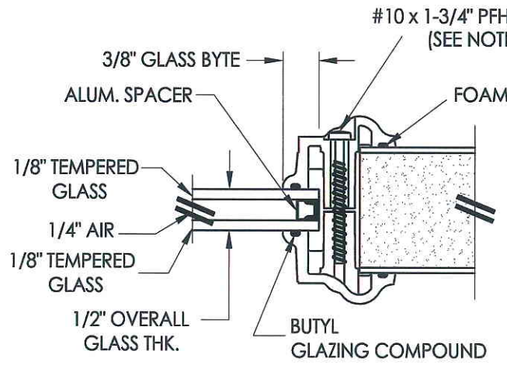

G1 GLAZING DETAIL
ODL Lite Frame



2E ODL LITE FRAME
HP Polypropylene



2B HINGE & LATCH STILE
LVL

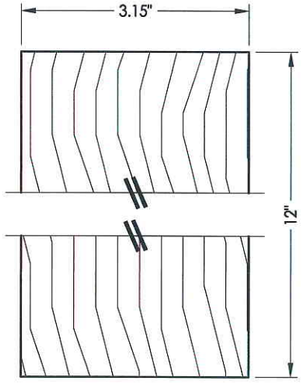

2D LOCK BLOCK
Wood (S.G.>= 0.42)



2A TOP RAIL
LVL



2C BOTTOM RAIL
Wood (S.G.>= 0.42)

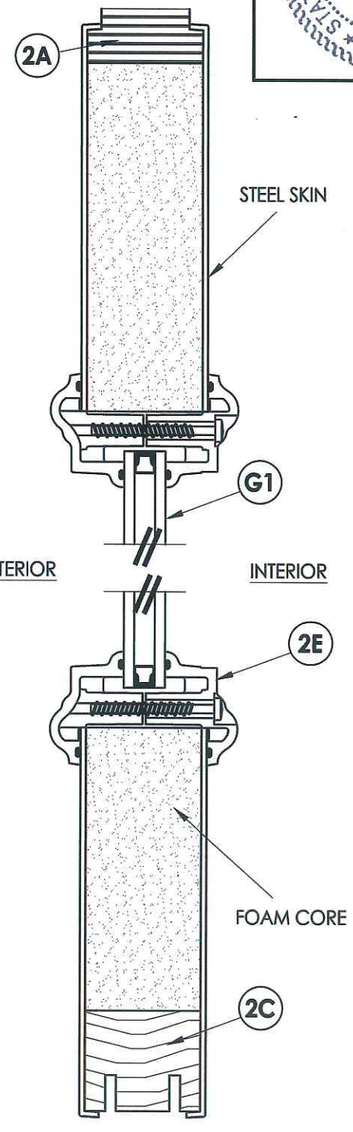

2/2 VERTICAL CROSS SECTION

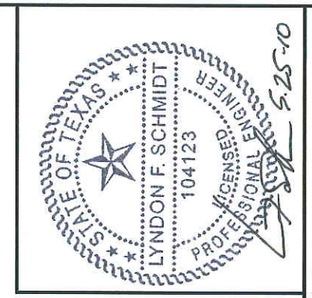

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: DOOR PANEL & GLAZING DETAILS

NO.	DATE	REVISIONS	BY

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 2 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-2

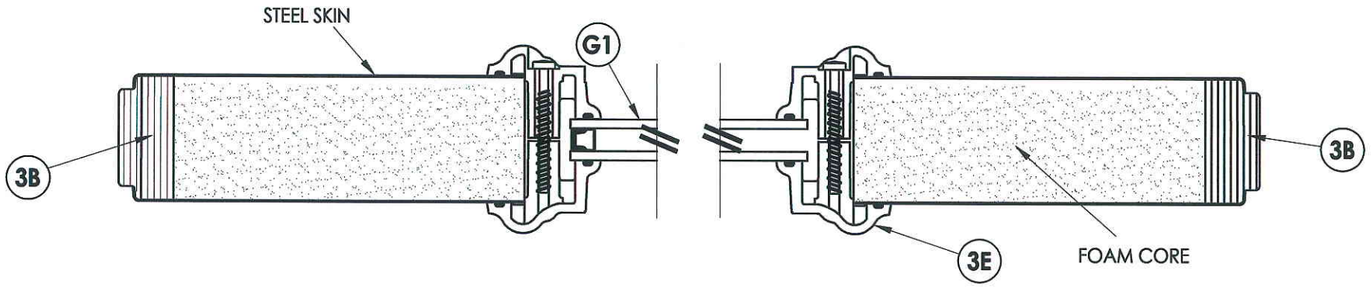

1/3 HORIZONTAL CROSS SECTION

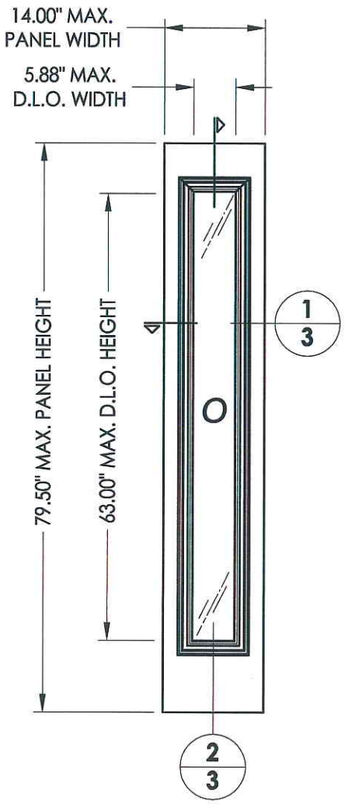

50 SIDELITE PANEL
Steel

STEEL DOOR SKIN: MIN. 0.019" THK.
CORE MATERIAL: EPS FOAM (POLYSTYRENE)

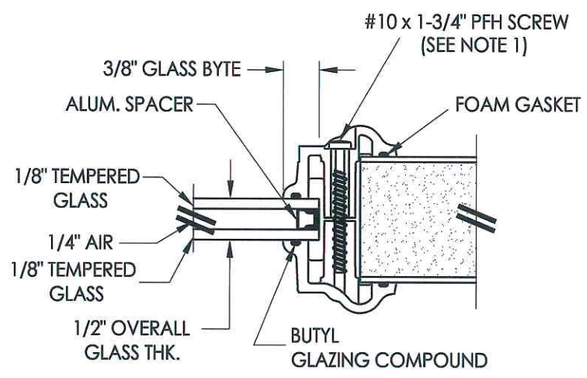

G1 GLAZING DETAIL
ODL Lite Frame



3E ODL LITE FRAME
HP Polypropylene



3C BOTTOM RAIL
Wood (S.G.>= 0.42)



3A TOP RAIL
LVL



3B HINGE & LATCH STILE
LVL

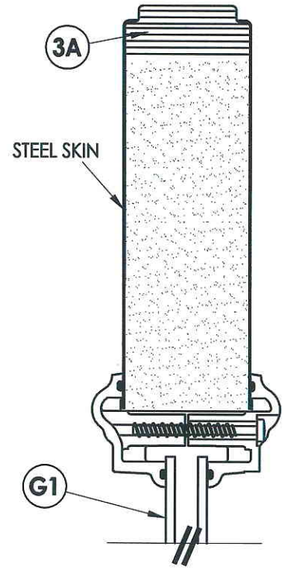

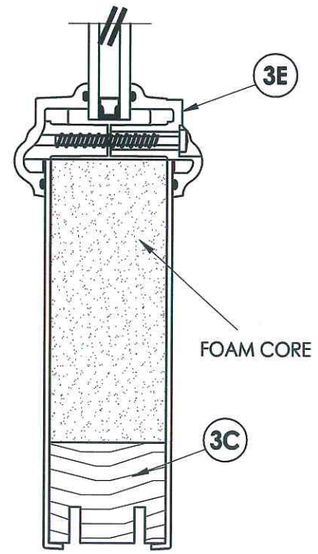

2/3 VERTICAL CROSS SECTION

NOTE:
1. Spacing for lite frame screws is as follows:
   Sides: 4.5" from corners and 11.5" o.c. thereafter
   Top & Bottom: 2" from corners.

STATE OF TEXAS ★★★ LYNDON F. SCHMIDT 104123 LICENSED PROFESSIONAL ENGINEER 5-25-10

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: SIDELITE PANEL & GLAZING DETAILS

NO.	DATE	BY
REVISIONS		

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 3 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-3

HARDWARE CHART		
MANUFACTURER	MODEL	ITEM #
KWIKSET	LOCK: 200	17
	DEADBOLT: 600	18

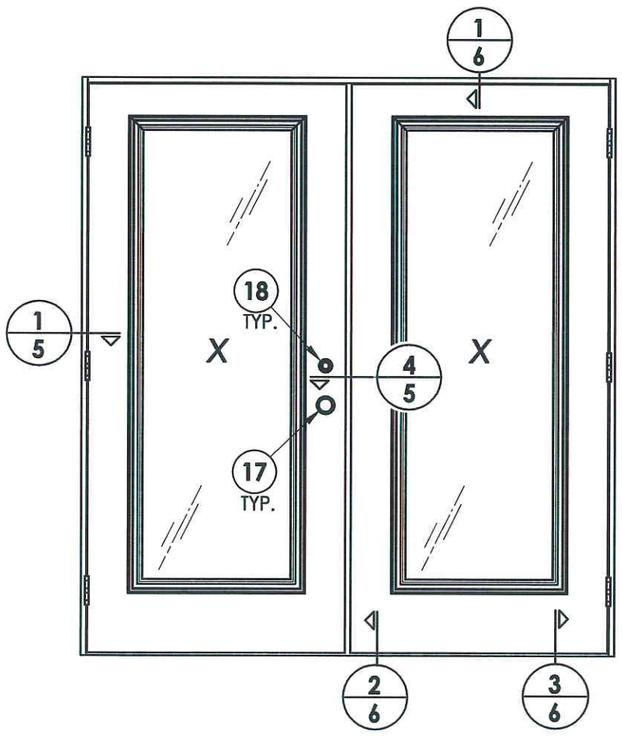

ELEVATION (XX)

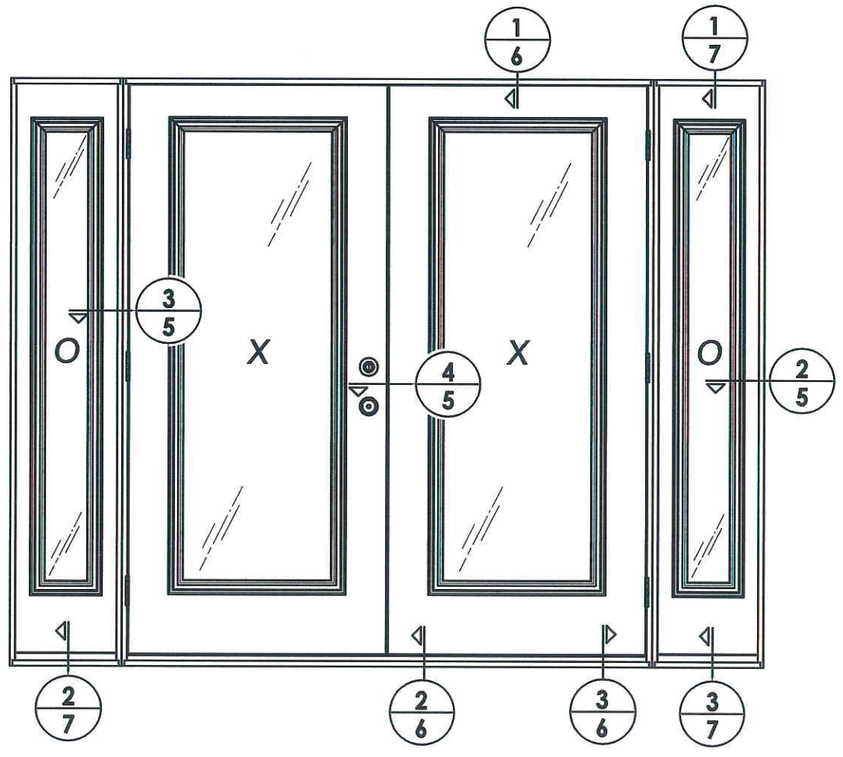

ELEVATION (OXXO)

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

STATE OF TEXAS
LYNDON F. SCHMIDT
104123
LICENSED PROFESSIONAL ENGINEER
5.25.10

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: ELEVATIONS

NO.	DATE	BY	REVISIONS

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 4 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-4

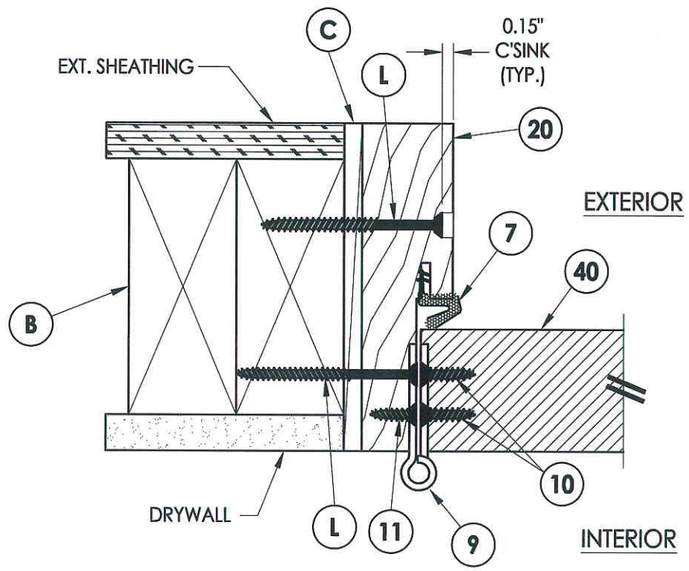

1/5 **HORIZONTAL CROSS SECTION**
Inswing shown - outswing also approved

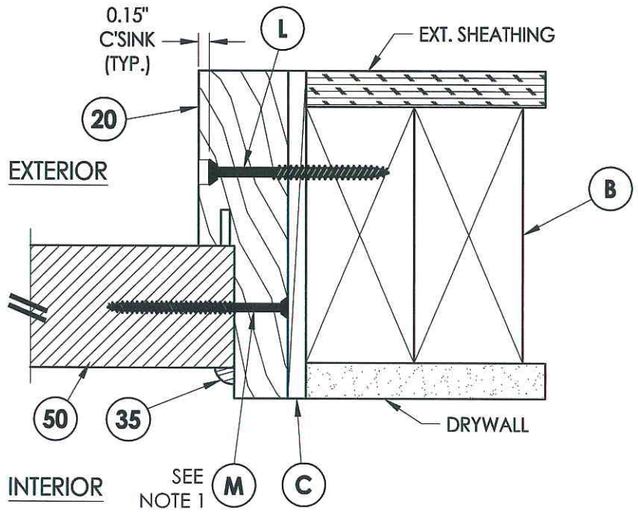

2/5 **HORIZONTAL CROSS SECTION**
Inswing shown - outswing also approved

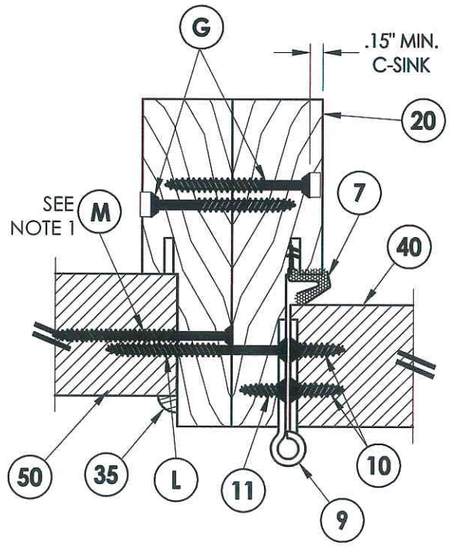

3/5 **HORIZONTAL CROSS SECTION**
Inswing shown - outswing also approved

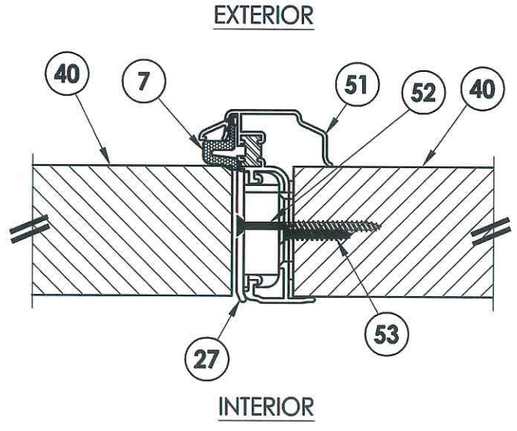

4/5 **HORIZONTAL CROSS SECTION**
Inswing shown - outswing also approved

NOTE:

1. Sidelite ass'y fasteners located 6" from each end and 6 more screws equally spaced between (8 screws total per jamb).

STATE OF TEXAS
LYNDON F. SCHMIDT
104123
LICENSED
PROFESSIONAL ENGINEER
5-25-10

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: *CREST STEEL DOOR*

PART OR ASSEMBLY: *HORIZONTAL CROSS SECTIONS*

NO.	DATE	REVISIONS	BY

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 5 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-5

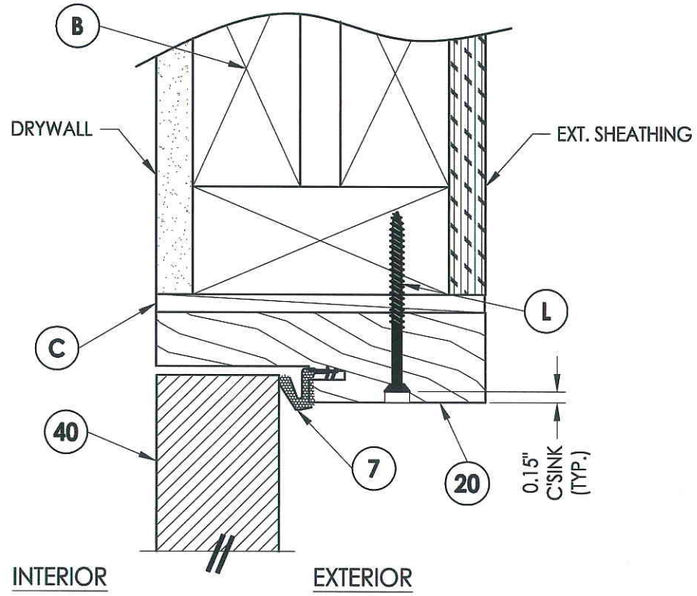

1/6 **VERTICAL CROSS SECTION**
Inswing shown - outswing also approved

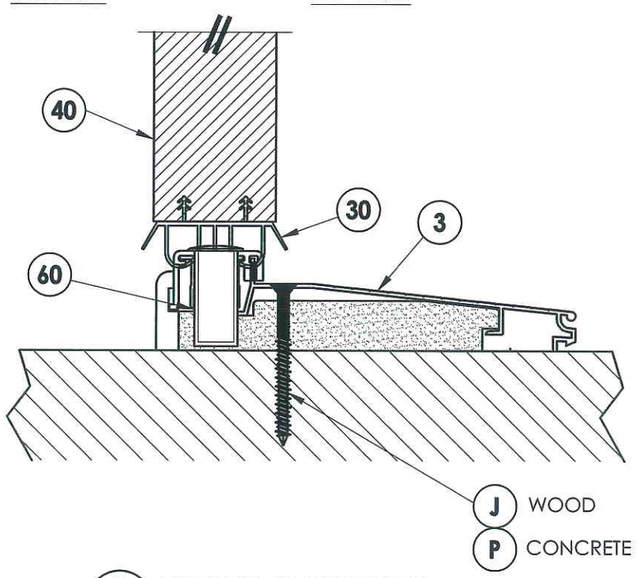

2/6 **VERTICAL CROSS SECTION**
Inswing configuration

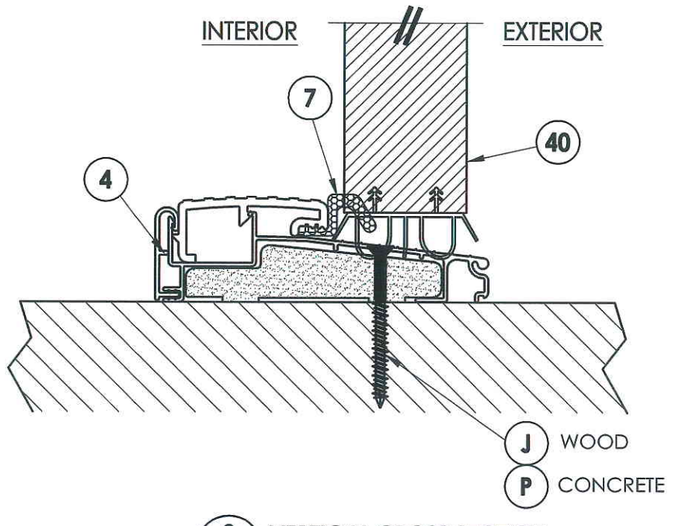

3/6 **VERTICAL CROSS SECTION**
Outswing configuration

STATE OF TEXAS
LYNDON F. SCHMIDT
104123
LICENSED PROFESSIONAL ENGINEER

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: *CREST STEEL DOOR*

PART OR ASSEMBLY: *VERTICAL CROSS SECTIONS*

NO.	DATE	BY

REVISIONS

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 6 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-6

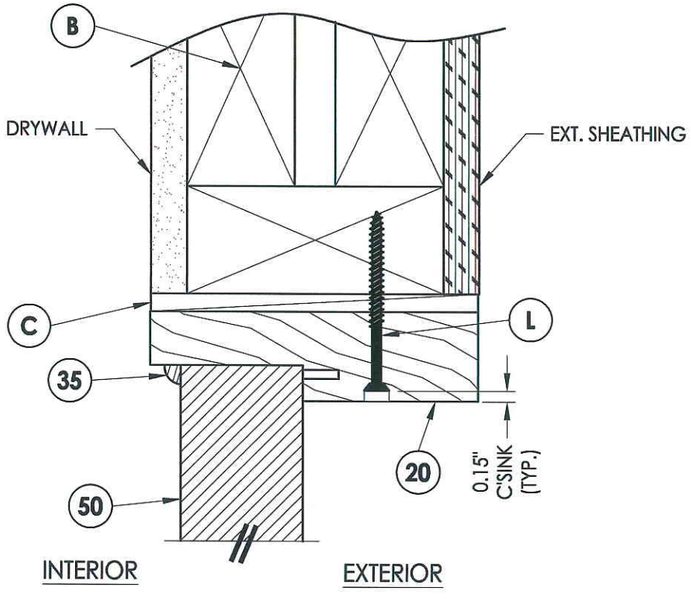

1/7 **VERTICAL CROSS SECTION**
Inswing shown - outswing also approved

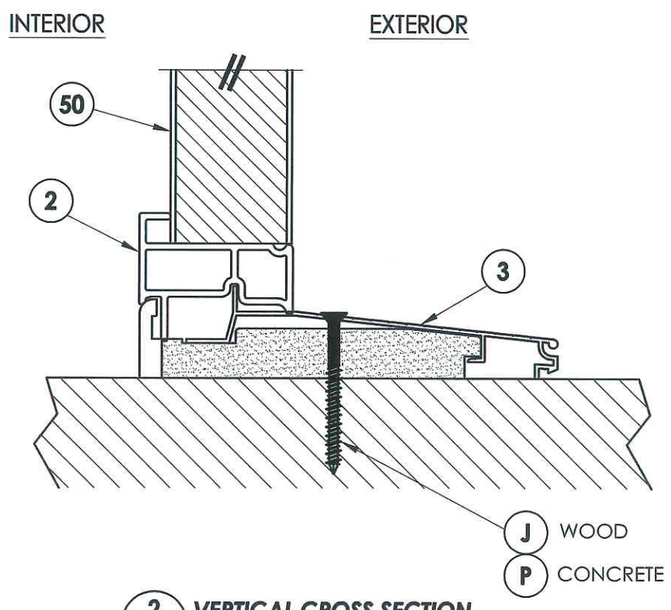

2/7 **VERTICAL CROSS SECTION**
Inswing configuration

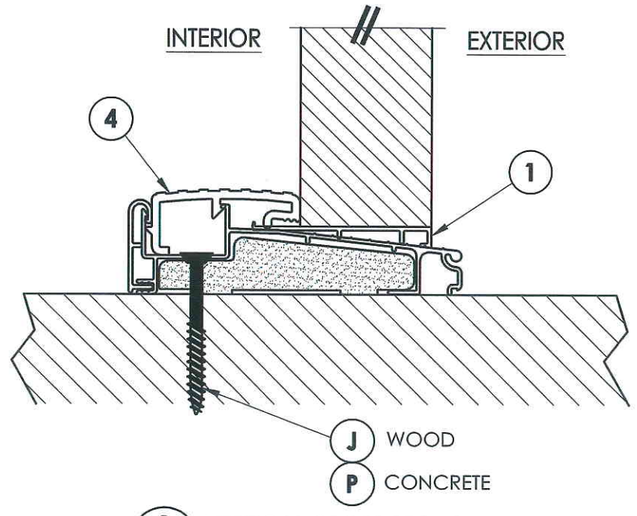

3/7 **VERTICAL CROSS SECTION**
Outswing configuration

STATE OF TEXAS
LYNDON F. SCHMIDT
104123
LICENSED PROFESSIONAL ENGINEER
5.25.10

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL, 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: VERTICAL CROSS SECTIONS

NO.	DATE	REVISIONS	BY

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 7 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-7

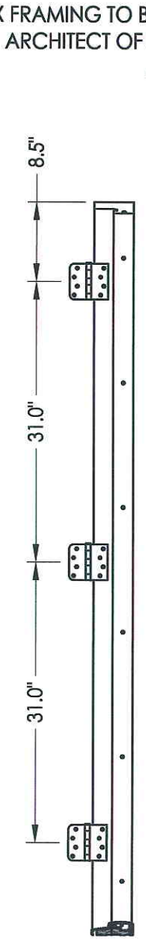

HINGE JAMB

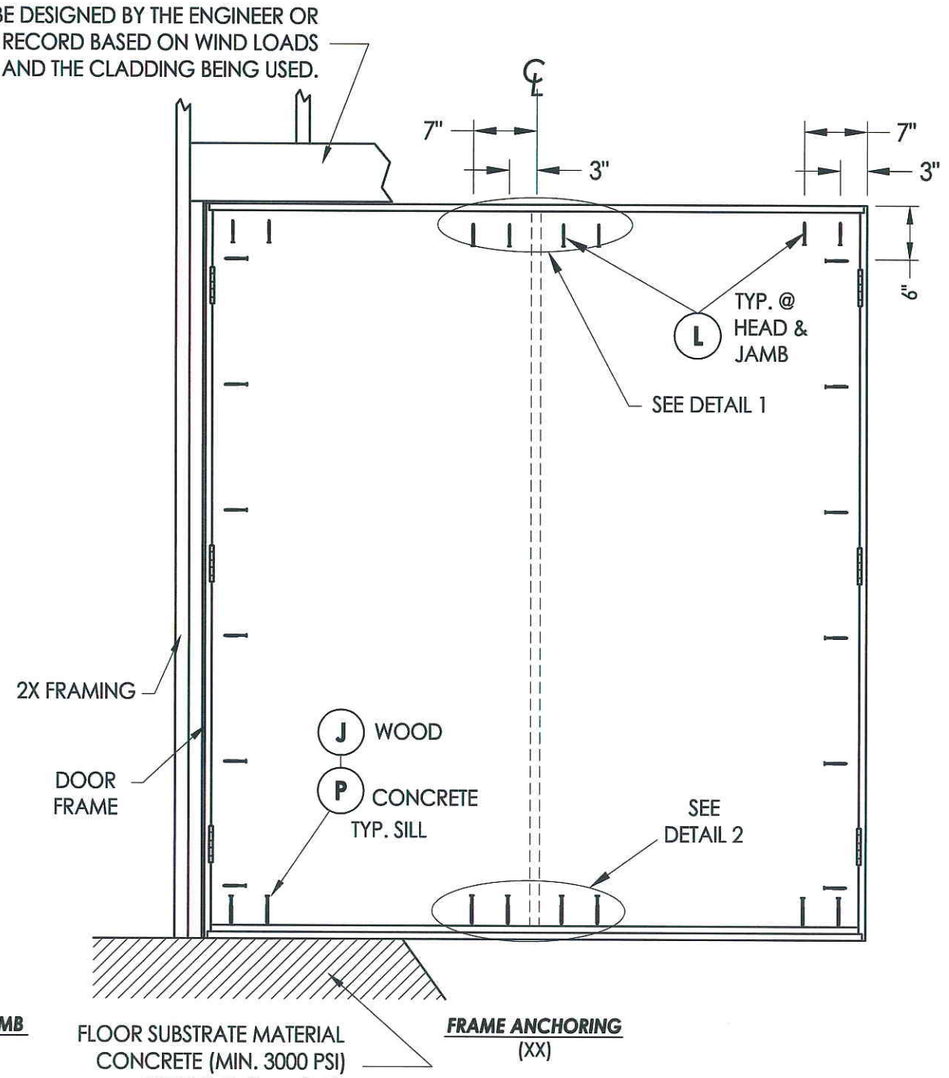

FRAME ANCHORING
(XX)



ASTRAGAL

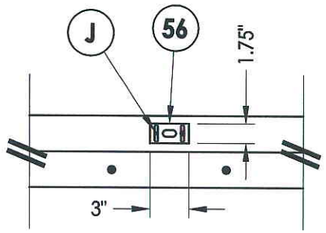

DETAIL 1
Inswing configuration

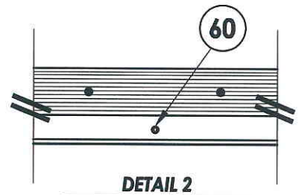

DETAIL 2
Inswing configuration

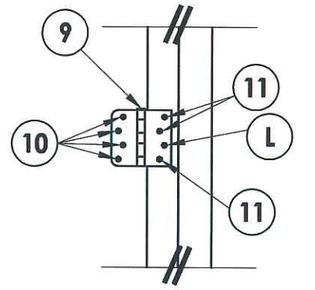

HINGE DETAIL



DETAIL 1
Outswing configuration



DETAIL 2
Outswing configuration



LATCH & DEADBOLT DETAIL

CONCRETE ANCHOR NOTES:

1. *Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.*
2. *Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.*
3. *Concrete anchor table:*

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-3/4"	2-1/2"	3"
ELCO	1/4"	1-3/4"	1"	4"

STATE OF TEXAS
LYNDON F. SCHMIDT
104123
LICENSED PROFESSIONAL ENGINEER

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: FRAME ANCHORING

NO.	DATE	REVISIONS	BY

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 8 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-8

2X FRAMING TO BE DESIGNED BY THE ENGINEER OR ARCHITECT OF RECORD BASED ON WIND LOADS AND THE CLADDING BEING USED.

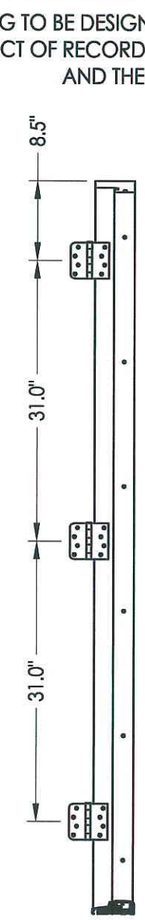

HINGE JAMB

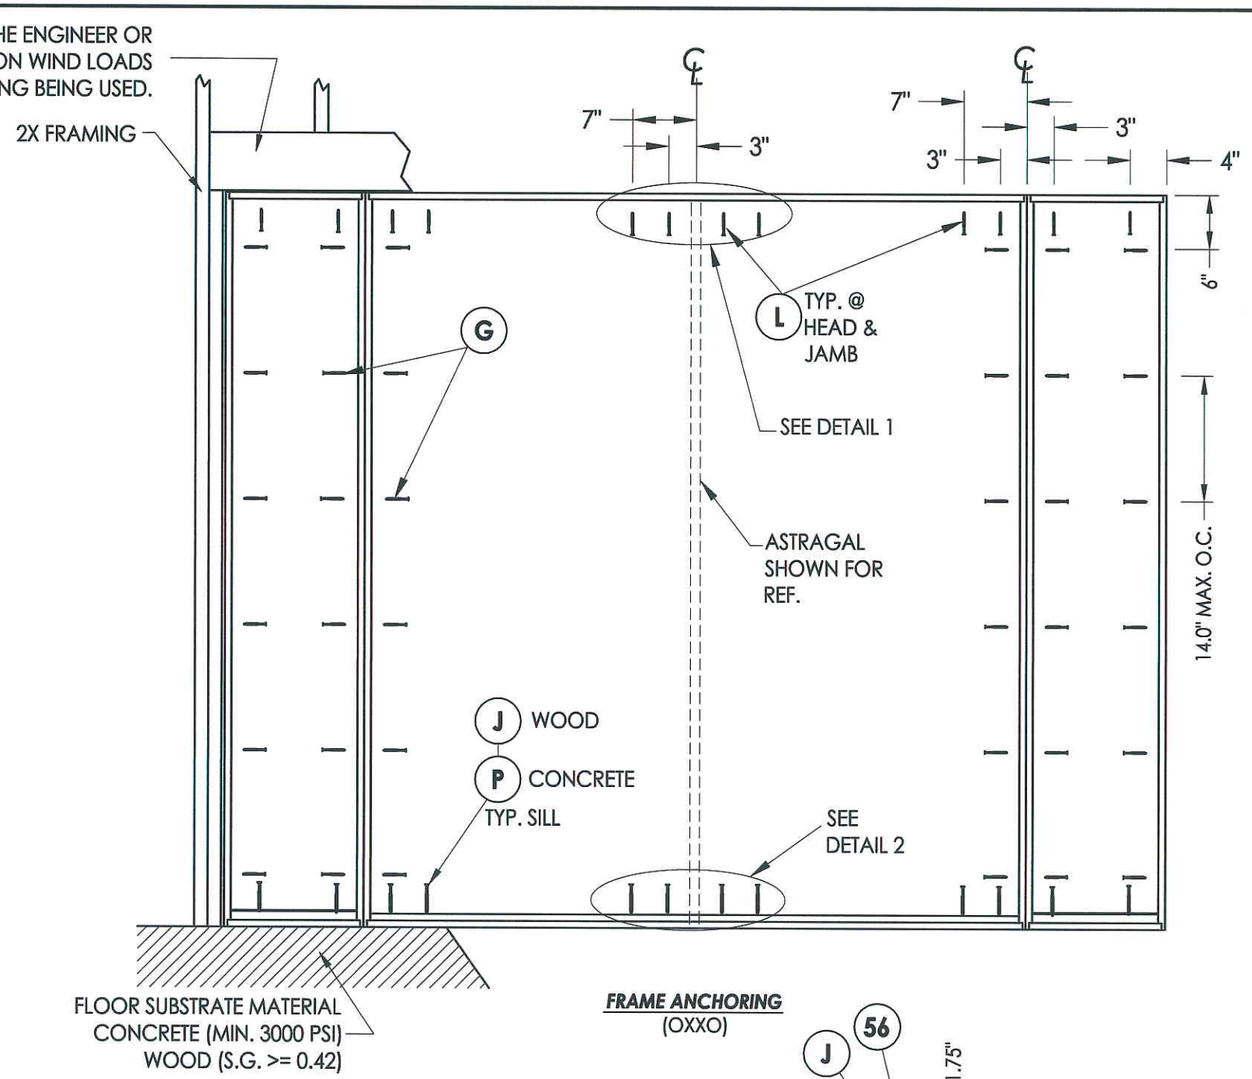



ASTRAGAL

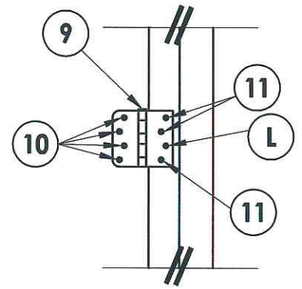

HINGE DETAIL



LATCH & DEADBOLT DETAIL

CONCRETE ANCHOR NOTES:

1. *Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.*
2. *Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.*
3. *Concrete anchor table:*

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-3/4"	2-1/2"	3"
ELCO	1/4"	1-3/4"	1"	4"

FRAME ANCHORING (OXXO)

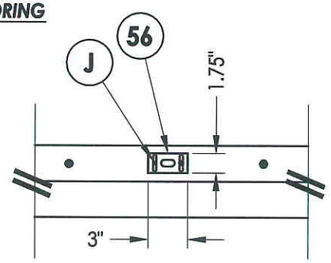

DETAIL 1
Inswing configuration

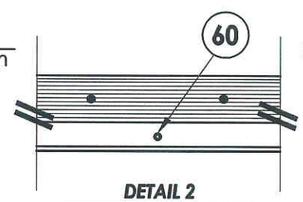

DETAIL 2
Inswing configuration

ASTRAGAL



DETAIL 1
Outswing configuration



DETAIL 2
Outswing configuration

Documents Prepared By: Lyndon F. Schmidt, P.E. TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: *CREST STEEL DOOR*

PART OR ASSEMBLY: *FRAME ANCHORING*

NO.	DATE	REVISIONS	BY

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 9 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-9

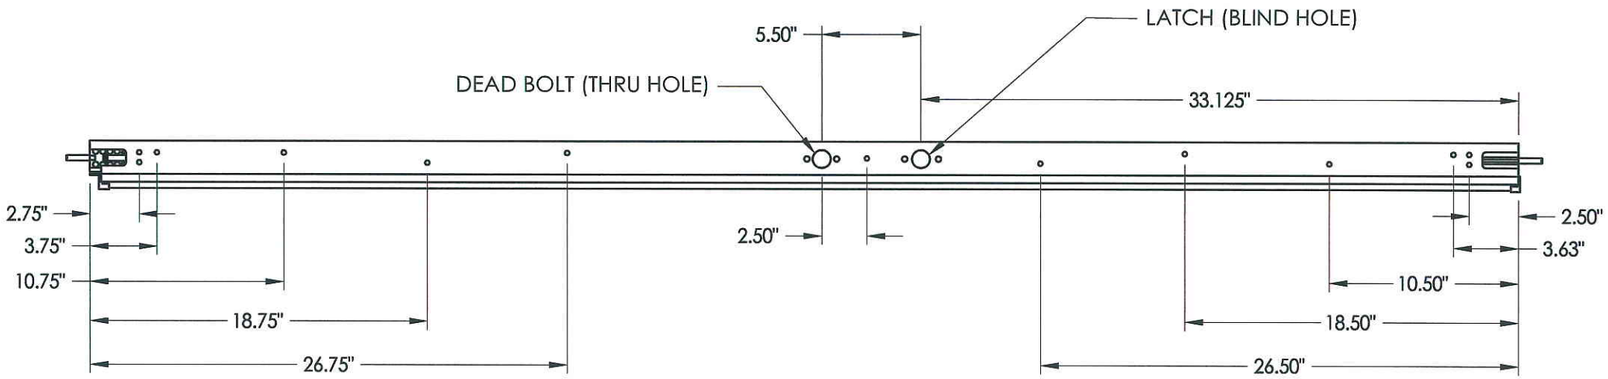

TOP

BOTTOM

A-A



6'8 ALUMINUM ASTRAGAL ASSEMBLY
By Endura Products

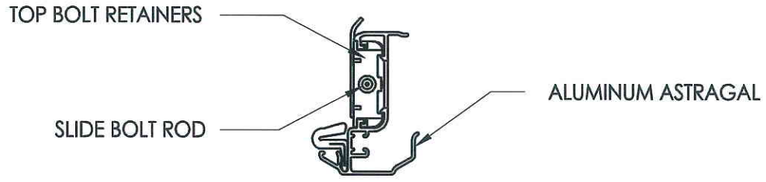

VIEW A-A
Aluminum Astragal Assembly



(51) **ALUMINUM ASTRAGAL**
By Endura Products

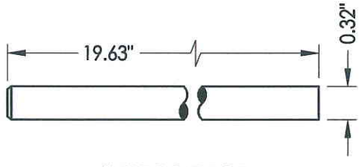

SLIDE BOLT ROD
MATL: Steel



TOP BOLT RETAINER
MATL: 9-3/4" Aluminum



TOP BOLT RETAINER
MATL: 4-3/4" HDPE

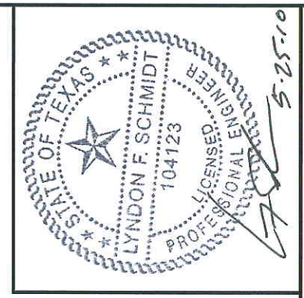

5.25.10

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: ENDURA ASTRAGAL DETAILS

NO.	DATE	BY	REVISIONS

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 10 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-10

BILL OF MATERIALS

ITEM #	DESCRIPTION	MATERIAL
B	2X FRAMING SG >= 0.42	WOOD
C	1/4" MAX. SHIM SPACE	-
G	#10 X 2" PFH WOOD SCREW	STEEL
J	#10 X 3" PFH WOOD SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW	STEEL
M	#8 X 2-1/2" PFH WOOD SCREW	STEEL
P	1/4" PFH ELCO OR ITW CONCRETE SCREW (1-3/4" MIN. EMB.)	STEEL
1	SIDELITE SPACER -OUTSWING	-
2	SIDELITE SPACER -INSWING	-
3	INSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM/COMP.
4	OUTSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM/COMP.
5	#10 X 2-1/2" PFH SCREW	STEEL
7	WEATHERSTRIP BY Q-LON	FOAM
9	4" HINGE	STEEL
10	#10 X 1" PFH WOOD SCREW	STEEL
11	#10 X 3/4" PFH WOOD SCREW	STEEL
20	JAMB FINGER - JOINT - PINE (SG >= 0.42)	WOOD
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT PLATE	STEEL
30	DOOR SWEEP	PVC
35	QUARTER ROUND	WOOD
40	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
50	SIDELITE PANEL - SEE SIDELITE PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
51	ASTRAGAL BY ENDURA	ALUM
52	#8 x 2-1/4" PFH WOOD SCREW	STEEL
53	#8 x 1" PFH WOOD SCREW	STEEL
56	ASTRAGAL STRIKE PLATE	PVC
60	ASTRAGAL SLIDE BOLT ROD RETAINER	PVC

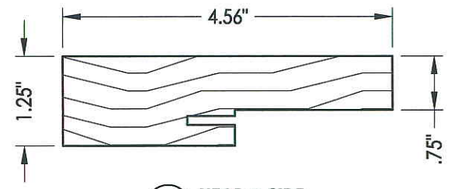

20 HEAD & SIDE
Jamb



2 SIDELITE SPACER
Inswing

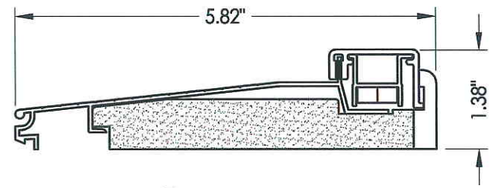

3 INSWING THRESHOLD

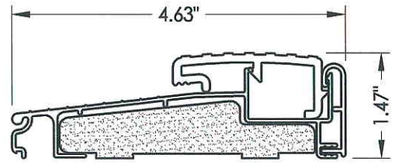

4 OUTSWING THRESHOLD



1 SIDELITE SPACER
Outswing



30 SWEEP

CONCRETE ANCHOR NOTES:

1. *Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.*
2. *Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.*
3. *Concrete anchor table:*

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-3/4"	2-1/2"	3"
ELCO	1/4"	1-3/4"	1"	4"

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: CREST STEEL DOOR

PART OR ASSEMBLY: COMPONENTS AND B.O.M.

NO.	DATE	REVISIONS	BY

DATE: 05/24/10
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: TX-4097
SHEET 11 OF 11

© 2010 R.W. BUILDING CONSULTANTS INC.

R:\A - Projects\Project Folders\proj 1401-1500\PF 1488\D. RWBC Drawings\TX-2010\TX-6-8 STL NN-IMP.dwg, 4-11