NOTES:

1. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.

2. SLIDE LOCKS OR OPERATOR REQUIRED.

3. SECTION SHALL BE CONSTRUCTED WITH FOAMED IN PLACE POLYURETHANE FOAM INSULATION CHEMICALLY BONDED TO .052" MINIMUM VINYL FACER AND A POLYLAMINATE BACKER. EACH SECTION SHALL HAVE 30 GA STEEL RAILS AT THE TOP AND BOTTOM OF EACH SECTION. END CAP TO HAVE A MINIMUM 1.3" DEPTH.

4. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

5. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

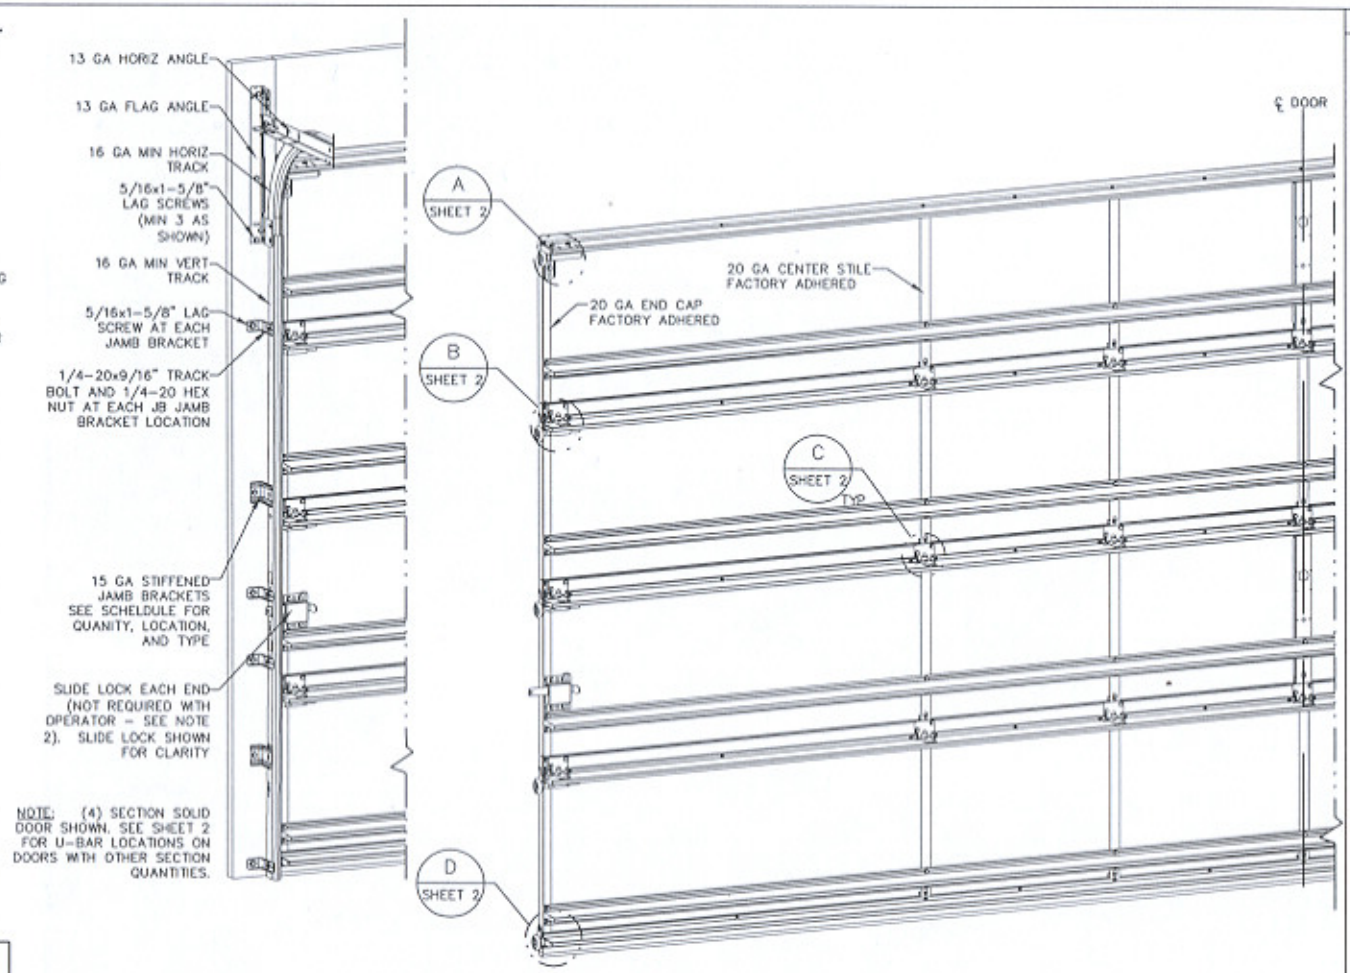

REVISIONS

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE		
MAX DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
10'-0"	ALL	+129.5/-144.0
15'-0"	ALL	+194.3/-216.0
16'-0"	ALL	+207.2/-230.4

JAMB BRACKET SCHEDULE				
DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	TRACK TYPE	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
7'-0"	4	6	QI	2" (JB), 13" (QI), 25-1/2" (JB), 34" (JB), 45-1/4" (QI), 63" (JB)
7'-0"	4	6	FAT	2" (JB), 10" (JB), 21-3/4" (JB), 29-3/4" (JB), 42" (JB), 63-1/4" (JB)
8'-0"	5	8	QI	2" (JB), 13" (QI), 23" (JB), 34" (JB), 47-1/4" (QI), 58" (JB), 67" (QI), 75" (JB)
8'-0"	5	8	FAT	2" (JB), 10" (JB), 21-3/4" (JB), 29-3/4" (JB), 46" (JB), 57-1/4" (JB), 66" (JB), 75-1/2" (JB)

NOTE:
(JB) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT.
(QI) FOLLOWING DIMENSION DENOTES QUICK INSTALL JAMB BRACKET INSTALLED IN BUTTERFLY SLOT. NO ADDITIONAL HARDWARE NEEDED TO ATTACH TO TRACK.

MARK R. BARROW
STATE OF FLORIDA
3/4/08

MARK R. BARROW, PE
FLORIDA LICENSE NO. 57389

Wayne® Dalton

3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A
DESIGN (PSF):	+25.90/-28.80	MAX WIDTH:	16'-0"		DATE	NAME
TEST (PSF):	+38.85/-43.20	MAX HEIGHT:	8'-0"	DRAWN	1/18/08	GRT
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX SECTION HEIGHT:	21"	CHECKED	2/27/08	MRB

MODEL 9300

SHEET 1 OF 2

WINDLOAD SPECIFICATION OPTION CODE 1422

DRAWING PART NO. 333512

REV. P

U-BAR SPACER FACTORY INSERTED INTO END OF U-BAR

JB-1 JAMB BRACKET ATTACHED TO TOP FIXTURE WITH (1) 1/4-20x1" BOLT AND NUT AND ATTACHED TO END STILE WITH (1) 1/4-20x5/8" SELF DRILLING SCREW

ADJUSTABLE TOP FIXTURE ATTACHED TO U-BAR WITH (2) 1/4-20x1" BOLTS AND NUTS (1 THROUGH JB-1 JAMB BRACKET AND TOP FIXTURE)

DETAIL A

14 GA UPPER HINGE ATTACHED WITH (2) 1/4-14x5/8" CRIMPTITE SCREWS

14 GA LOWER HINGE FACTORY ATTACHED WITH (1) #12-14x1/2" SELF TAPPING SCREW

2" NYLON STORMGARD ROLLER WITH 4-1/2" STEM

13 GA ROLLER SLIDE ATTACHED TO PRE-PUNCHED HOLES IN BOTTOM OF U-BAR WITH (2) 1/4-14x5/8" CRIMPTITE SCREWS. USE VIEWING HOLE IN SLIDE TO ENSURE PROPER ALIGNMENT OF ROLLERS



DETAIL B

14 GA UPPER HINGE ATTACHED WITH (2) 1/4-14x5/8" CRIMPTITE SCREWS

14 GA LOWER HINGE FACTORY ATTACHED WITH (1) #12-14x1/2" SELF TAPPING SCREW

DETAIL C

BOTTOM NYLON ROLLER CARRIER FACTORY ATTACHED



DETAIL D

CENTER STILE & INTERMEDIATE HINGE LOCATIONS

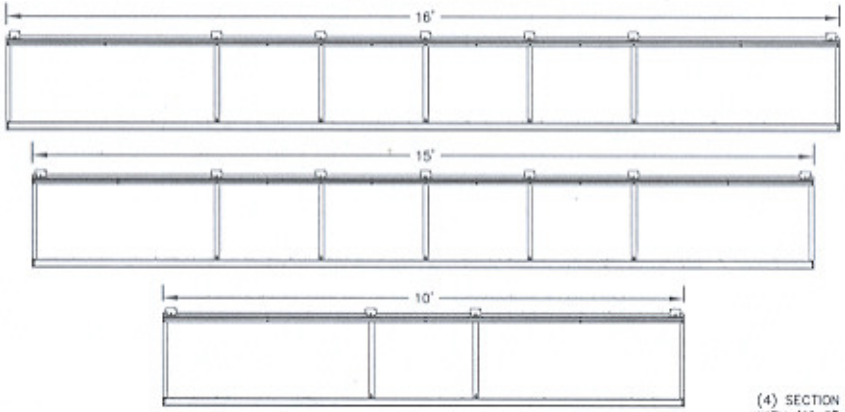

(5) SECTION DOORS WITH (11) 3", 18 GA, 80 KSI U-BARS LOCATED AS SHOWN

(4) SECTION DOORS WITH (9) 3", 18 GA, 80 KSI U-BARS LOCATED AS SHOWN

NOTE: U-BARS SHOULD BE INSTALLED LEVEL ACROSS DOOR AND MAINTAIN A MINIMUM CENTERLINE SPACING OF 6-5/8" BETWEEN U-BARS ON ADJACENT SECTIONS

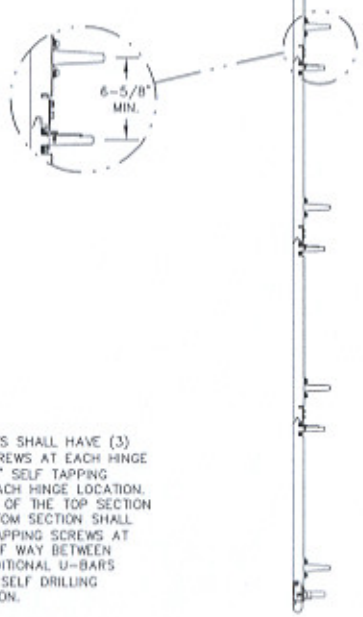

U-BAR ATTACHMENT NOTES

ALL U-BARS AT SECTION JOINTS SHALL HAVE (3) #12-14x1/2" SELF TAPPING SCREWS AT EACH HINGE LOCATION AND (2) #12-14x1/2" SELF TAPPING SCREWS HALF WAY BETWEEN EACH HINGE LOCATION. U-BARS LOCATED ON THE TOP OF THE TOP SECTION AND THE BOTTOM OF THE BOTTOM SECTION SHALL HAVE (2) #12-14x1/2" SELF TAPPING SCREWS AT EACH STILE LOCATION AND HALF WAY BETWEEN EACH STILE LOCATION. ALL ADDITIONAL U-BARS SHALL HAVE (2) 1/4-20x5/8" SELF DRILLING SCREWS AT EACH STILE LOCATION.

REVISIONS

MARK R. BARROW
3/4/08

MARK R. BARROW, PE
FLORIDA LICENSE NO. 57389

Wayne® Dalton

3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A
DESIGN (PSF):	+25.90/-28.80	MAX WIDTH:	16'-0"		DATE	NAME
TEST (PSF):	+38.85/-43.20	MAX HEIGHT:	8'-0"	DRAWN	1/18/08	GRT
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX SECTION HEIGHT:	21"	CHECKED	2/27/08	MRB

MODEL 9300

SHEET 2 OF 2

WINDLOAD SPECIFICATION OPTION CODE 1422

DRAWING PART NO. 333512

REV. P