

TEXAS DEPARTMENT OF INSURANCE

Engineering Services Program / MC 103-3A 333 Guadalupe Street P.O. Box 149104 Austin, Texas 78714-9104
Phone No. (512) 322-2212 Fax No. (512) 463-6693

PRODUCT EVALUATION
RC-367

Effective February 1, 2013

*The following product has been evaluated for compliance with the wind loads specified in the **International Residential Code (IRC)** and the **International Building Code (IBC)**. This product shall be subject to reevaluation **February 2017**.*

This product evaluation is not an endorsement of this product or a recommendation that this product be used. The Texas Department of Insurance has not authorized the use of any information contained in the product evaluation for advertising, or other commercial or promotional purpose.

This product evaluation is intended for use by those individuals who are following the design wind load criteria in Chapter 3 of the IRC and Section 1609 of the IBC. The design loads determined for the building or structure shall not exceed the design load rating specified for the products shown in the limitations section of this product evaluation. This product evaluation does not relieve a Texas licensed engineer of his responsibilities as outlined in the Texas Insurance Code, the Texas Administrative Code, and the Texas Engineering Practice Act.

Rock-Lok Standing Seam Metal Roof Panels over Wood Deck manufactured by

Southeastern Metals Manufacturing Company (SEMCO)
11801 Industry Drive
Jacksonville, Florida 32218
(904) 757-4200

and

Dot Metals
18757 Bracken Drive
San Antonio, TX 78266
(800) 331-9966

is acceptable in designated catastrophe zones along the Texas Gulf Coast when installed in accordance with the manufacturer's installation instructions and this product evaluation.

PRODUCT DESCRIPTION

The Rock-Lok panel is a concealed fastened metal roof panel. The metal roof panels are manufactured from minimum 24 gauge, Fy = 50 ksi, steel, and has 16" wide coverage with 2" tall ribs.

LIMITATIONS

Roof Framing: The metal roofing panels shall be installed over a minimum $1\frac{9}{32}$ " thick plywood deck.

New Roof Framing Attachment: The roof framing shall meet or exceed the uplift requirements of the International Residential Code or International Building Code and shall be installed as required for resistance to wind loads.

Design Wind Pressures: For installations to wood decks, design wind pressure limitations are specified in Table 1.

Installation Over an Existing Roof Covering: Installation over an existing roof covering is not covered in this product evaluation report.

Roof Slope: The Rock-Lok aluminum panels shall not be installed on roofs with a roof slope less than 1:12.

INSTALLATION INSTRUCTIONS

General Installation Requirements: All International Residential Code (IRC) and the International Building Code (IBC) requirements must be satisfied and manufacturer's installation instructions followed, unless otherwise specified by this product evaluation.

Table 1
Attachment of Rock-Lok to wood roof decks

System	Design Wind Pressure (psf)	Clip Spacing
1	-93.5	Clips spaced 16" o.c.
2	-101	Clips spaced 12" o.c.

Underlayment: A minimum of one layer of No. 30 (Type II) asphalt felt shall be used. The underlayment used shall comply with one or more of the following: ASTM D 226, ASTM D 4869, or ASTM D 1970. The felt shall be installed with 6 inch side laps and 3 inch end laps. The felt shall be fastened to the roof deck with corrosion resistant fasteners in accordance with the manufacturer's installation instructions. Fasteners shall be applied along the overlaps not farther apart than 36 inches on center.

Attachment of Panels to Wood Deck: The metal panels are secured to the roof deck with 3 1/2" wide x 2" high, 22 gauge steel panel clips. The panel clips are located at 4" from each end of the panel and spaced in accordance with the clip spacing in Table 1. The clips are secured to the wood deck with two (2) No. 10 x 1" pancake head screws. Refer to Figure 1 for lap detail.

Trims, Closures, and Accessories: Components, such as the eave trim, rake trim, ridge trim, hip trim, and valley trim shall be installed as required by the manufacturer.

Panel Ends and End Laps: As required by the manufacturer.

Panel Edges: As required by the manufacturer.

Note: The manufacturer's installation instructions shall be on the job site during the installation. All fasteners shall be corrosion resistant as specified in the International Residential Code (IRC), the International Building Code (IBC), and the Texas Revisions.

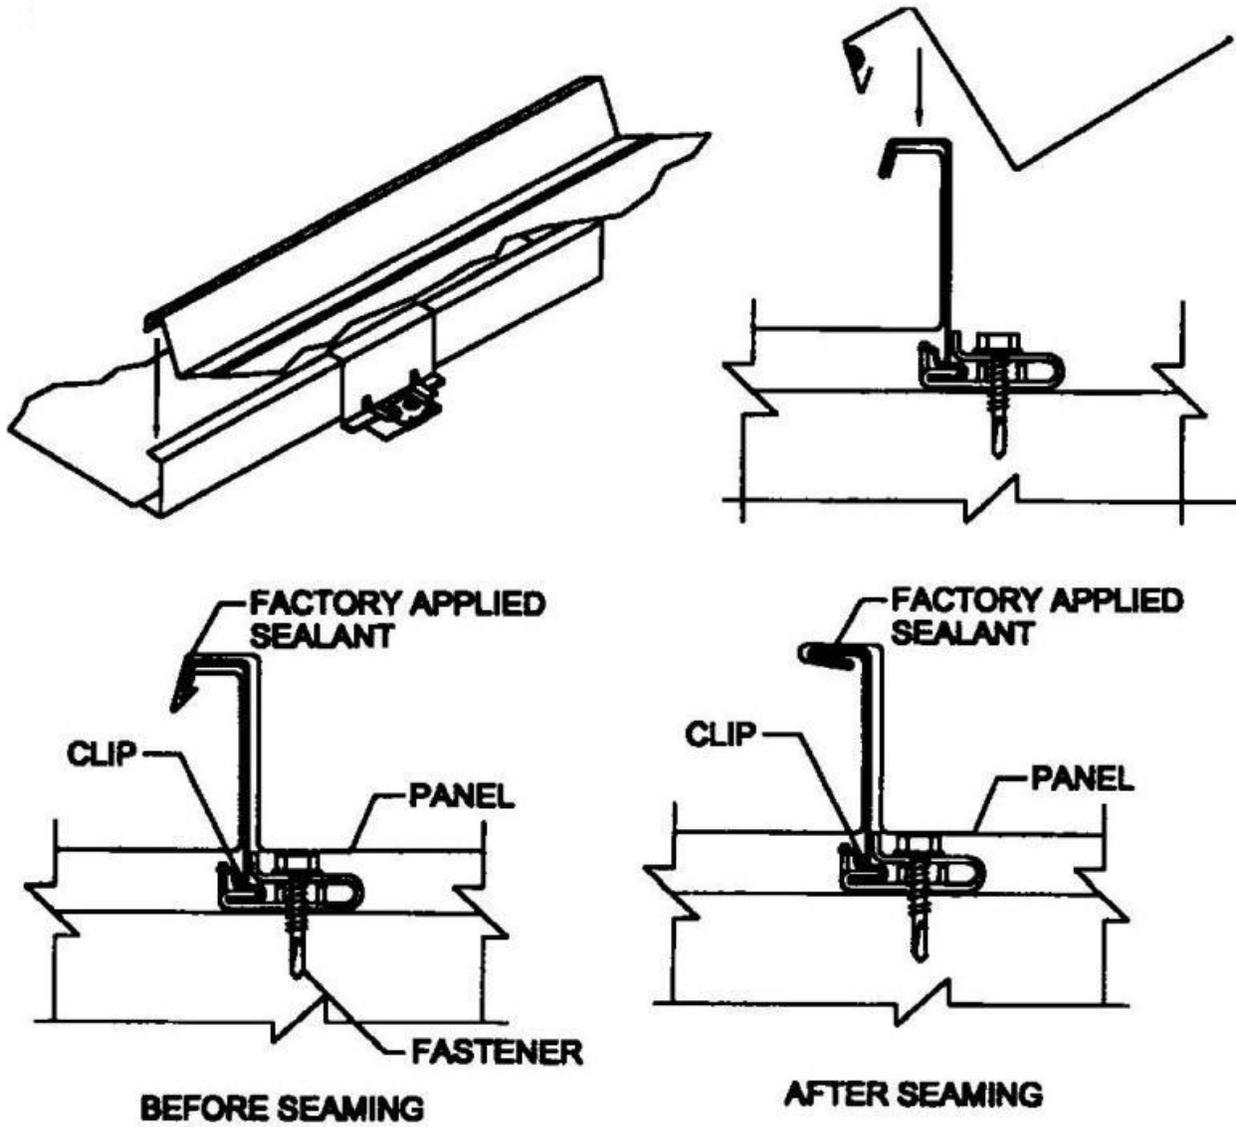


Figure 1: Rock-Lok Lap Detail