


Table 1 - Verified Installations			
Certification	DP (psf)	WIDTH (in)	HEIGHT (in)
Single	+/- 50.0	72	84

- NOTES:
- INSTALLATIONS SHOWN ON THIS DRAWING HAVE BEEN VERIFIED AS THE AS-TESTED INSTALLATION FOR THE PERFORMANCE LEVEL SHOWN. VERIFIED PRODUCTS ARE LISTED IN TABLE 1. THIS DRAWING APPLIES ONLY TO THOSE PRODUCTS.
 - INSTALLATION ANCHORS SHALL BE MINIMUM #8 WOOD SCREWS OR ROOFING NAILS OF SUFFICIENT LENGTH TO ACHIEVE MINIMUM EMBEDMENT OF 1.5" INTO WOOD FRAMING MEMBER. WOOD SCREWS SHALL SATISFY NATIONAL DESIGN SPECIFICATION FOR MATERIAL PROPERTIES AND DIMENSIONS. PER NDS-2005 11.1.4.7, EDGE DISTANCES SHALL BE SUFFICIENT TO PREVENT SPLITTING.
 - WOOD FRAMING SHALL BE SPRUCE-PINE-FIR (G=0.42) OR DENSER.
 - INSTALLATION ANCHORS ARE SHOWN GOING THROUGH EXTERIOR FINISH. ANCHORS MAY BE INSTALLED DIRECTLY INTO WOOD FRAMING MEMBER WITH 1.5" MINIMUM EMBEDMENT STILL REQUIRED.
 - SHIM AS REQUIRED AT EACH ANCHOR LOCATION. SPACES GREATER THAN 1/16" REQUIRE THE USE OF LOAD BEARING SHIMS. MAX SHIM SPACE IS 1/4".
 - ONE (1) ANCHOR IS REQUIRED WITHIN 1/2" OF EACH INDICATED LOCATION. TOLERANCE IS NOT CUMULATIVE.
 - INSTALLATION ANCHORS SHALL BE LOCATED 2" FROM CORNERS AND 12" MAXIMUM ON CENTER SPACING.
 - THESE INSTRUCTIONS ADDRESS STRUCTURAL REQUIREMENTS ONLY. WINDOWS SHALL BE INSTALLED PER ASTM E2112 OR FMA/AAMA 100.
 - SMALLER WINDOWS OF THE SAME CONSTRUCTION AND EQUAL OR LESSER DESIGN PRESSURES ARE COVERED BY THIS DRAWING.
 - GLAZING TYPE, GLASS TYPE, AND GLASS THICKNESS ARE ESTABLISHED BY THE CERTIFICATION AND SHALL SATISFY ASTM E1300. GLAZING TYPE SHALL BE INSULATING GLASS.
 - PRODUCTS LISTED IN TABLE 1 ARE NOT IMPACT RESISTANT. IF USED IN WIND-BORNE DEBRIS REGIONS, APPROVED PROTECTION DEVICES ARE REQUIRED.
 - PRODUCT OR INSTALLATION IS NOT APPROVED FOR HIGH VELOCITY HURRICANE ZONE (HVHZ)

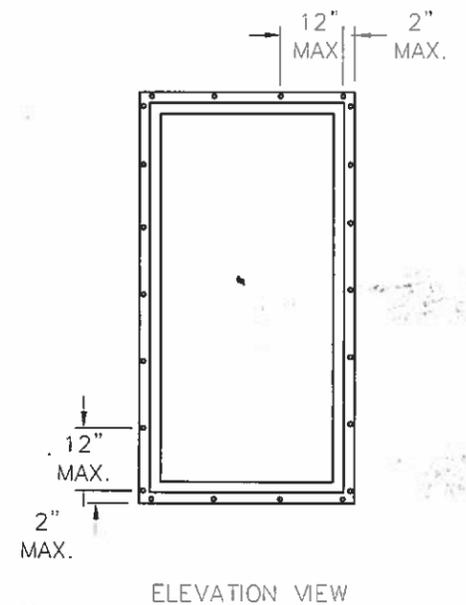

THIS DRAWING IS PROPRIETARY AND CONFIDENTIAL TO ATRIUM COMPANIES, INC. AND SHALL NOT BE REPRODUCED, COPIED, OR DISSEMINATED WITHOUT THE EXPRESSED WRITTEN PERMISSION OF ATRIUM COMPANIES, INC.

ATRIUM
COMPANIES, INC.

No.	Date	Revision Description	By	ECN #
5	05/03/2012	Updated Screws from 1" to 1 1/4" (w/trim)	DJC	ECN-2012-2118.1

Material (Type-Alloy-Temper):	Est. Area (in ²): NA	Tolerances: X.XX = ±X.XX X.XXX = ±X.XXX X.X" = ±X.X"	
Est. Weight (lb/ft): NA	Drawn By: JTS	Approved By: DJC	Date: December 20, 2012
Title: ADW-01 300 375 PW FIN INSTALLATION	Scale: 3:4	Sheet Size: ANSI B	ECN# (Initial Issue): ECN-2008-1395P
File Name: ADW-01 301 300 375 PW Assembly	Sheet 1/1		