

# OLDCASTLE BUILDING ENVELOPE

## FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)



OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

### INSTALLATION NOTES:

- SEE SHEET 11 FOR ANCHOR TYPE REQUIREMENTS, MINIMUM EMBEDMENTS, AND MINIMUM EDGE DISTANCES. ALL ANCHOR REQUIREMENTS MUST BE ADHERED TO. ANY DEVIATIONS FROM ANCHOR REQUIREMENTS REQUIRES SEPARATE EVALUATION AND APPROVAL.
- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8" AT HEAD & SILL AND 1/2" AT THE JAMBS. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.42.
  - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
  - MASONRY - CMU UNIT STRENGTH CONFORMS TO ASTM C-90, WITH MIN. COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MIN. GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
  - STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 12 GA. WALL THICKNESS.
  - ALUMINUM - MINIMUM 1/8 INCH THICK 6063-T5 ALUMINUM.

### GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2018 INTERNATIONAL BUILDING CODE (IBC) AND 2018 INTERNATIONAL RESIDENTIAL CODE (IRC), AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - AAMA 501-15
  - ASTM E1886-13a
  - ASTM E1996-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE. SEE SHEET 3 FOR GLASS TYPE.
- STOREFRONT FRAME MATERIAL: ALUMINUM 6063-T6
- ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE 2018 INTERNATIONAL BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	MISSILE LEVEL E GLAZING DETAILS
4	MULLION TABLES
5	TYPE A & B ANCHOR TABLES
6	TYPE A & B ANCHOR TABLES CONTINUED
7	TYPE C & D ANCHOR TABLES
8	TYPE C & D ANCHOR TABLES CONTINUED
9	DOOR MULLION TABLE
10	DOOR MULLION TABLES CONTINUED
11	VERTICAL SECTIONS & ANCHOR DESCRIPTIONS
12	MULLION HORIZONTAL SECTIONS
13	MULLION HORIZONTAL SECTIONS
14	COMPONENTS & BILL OF MATERIALS

### INSTRUCTIONS FOR USE:

- DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BUILDING HEIGHT, & WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- SEE CHART ON SHEET 3 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.
- CHECK MULLION CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHART ON SHEET 4 FOR STOREFRONT MULLION AND SHEETS 9 & 10 FOR DOOR MULLION, THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
- USING CHARTS ON SHEETS 5 THROUGH 8 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
- THE LOWEST VALUE RESULTING FROM STEP 2, 3, AND 4 SHALL APPLY TO ENTIRE SYSTEM.

TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)  
INSTALLATION & GENERAL NOTES

PREPARED BY: BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: 01.04.2023

DWG. BY: SH  
CHK. BY: HFN

SCALE: NTS


DWG. #: OBE010

SHEET:

1


OF 14

s:\projects\oldcastle\_building\_envelope\tdi-21-1110.1 - tdi submittal - series fg-5750t\_storefront (non thermal) e1 and e3\_series fg-5750t\_storefront (thermal) e2 and e4.dwg\obe010.dwg 1/5/2023 9:32 AM

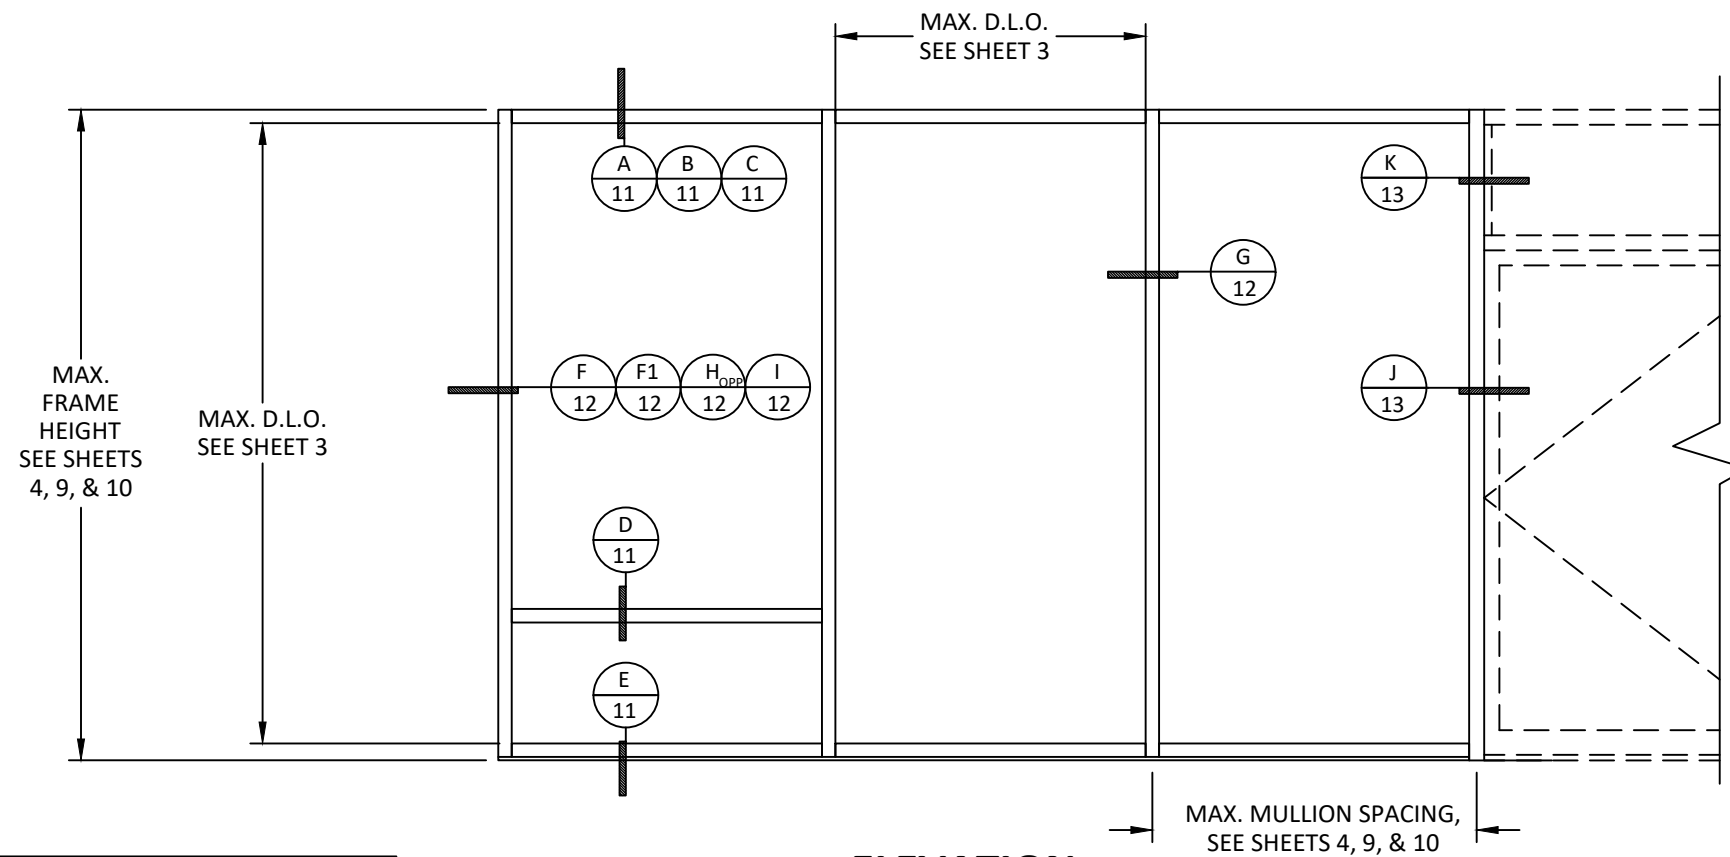


**ELEVATION**  
**TYPICAL FG-5750T STOREFRONT**

NOTE: SEE SEPARATE DOOR APPROVAL FOR DOOR RATING & DETAILS. LOWER DESIGN PRESSURE FROM STOREFRONT OR DOOR APPROVAL WILL APPLY TO ENTIRE SYSTEM.

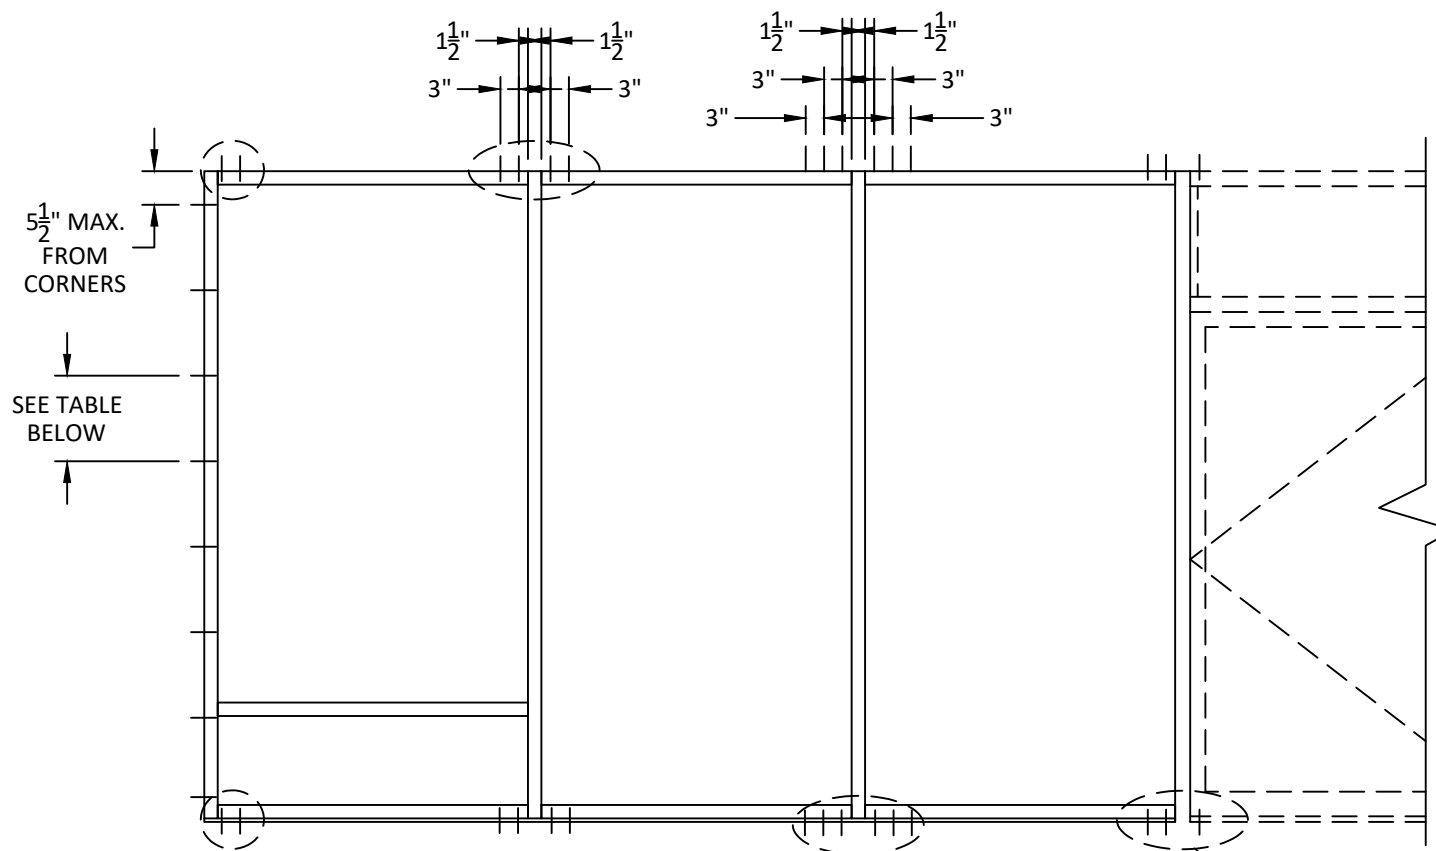

**TYPICAL ANCHOR LAYOUT**

JAMB ANCHOR SPACING		
ANCHOR TYPE	MAX. SPACING	MAX. DP
A	24.0"	70 PSF
B	14.25"	
C	16.25"	
D	24.0"	

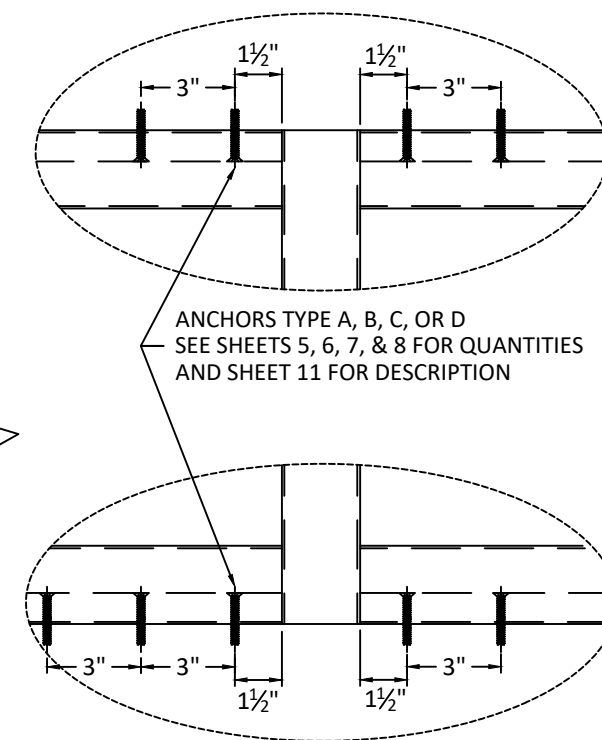

ANCHORS TYPE A, B, C, OR D  
SEE SHEETS 5, 6, 7, & 8 FOR QUANTITIES  
AND SHEET 11 FOR DESCRIPTION

FOR DOOR ADJACENT MULLION  
ANCHOR REQUIREMENTS SEE  
SHEETS 9 & 10.



**OLDCASTLE BUILDING ENVELOPE**  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM  
STOREFRONT SYSTEM  
(MISSILE LEVEL E)  
ELEVATION &  
ANCHOR LAYOUT

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: **01.04.2023**

DWG. BY: **SH**      CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **OBE010**

SHEET:

**2**


OF 14

# GLASS TYPES


## MISSILE LEVEL E IMPACT

GLASS LOAD CAPACITY (PSF)			
NOMINAL DIMS.		GLASS TYPE '1' OR '2'	
D.L.O. WIDTH (in.)	D.L.O. HEIGHT (in.)	EXT. (+)	INT. (-)
39.5	55	70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		52.3	52.3
63.5		52.3	52.3
69.5	61	52.3	52.3
39.5		70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		50.0	50.0
63.5	47.1	47.1	
69.5	47.1	47.1	
39.5	67	70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	42.9	42.9	
39.5	73	70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	41.4	41.4	
39.5	79	70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	41.4	41.4	

GLASS LOAD CAPACITY (PSF)			
NOMINAL DIMS.		GLASS TYPE '1' OR '2'	
D.L.O. WIDTH (in.)	D.L.O. HEIGHT (in.)	EXT. (+)	INT. (-)
39.5	85	70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	91	41.4	41.4
39.5		70.0	70.0
45.5		63.2	63.2
51.5		55.8	55.8
57.5		50.0	50.0
63.5	45.3	45.3	
69.5	41.4	41.4	
39.5	97	69.7	69.7
45.5		62.9	62.9
51.5		55.8	55.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	41.4	41.4	
39.5	103	68.7	68.7
45.5		61.8	61.8
51.5		55.8	55.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	41.4	41.4	
39.5	109	67.8	67.8
45.5		60.9	60.9
51.5		55.7	55.7
57.5		50.0	50.0
63.5		45.3	45.3
39.5	115	67.0	67.0
45.5		60.1	60.1
51.5		54.8	54.8
57.5		50.0	50.0
63.5		45.3	45.3
69.5	121	66.3	66.3
45.5		59.3	59.3
51.5		54.1	54.1
57.5		50.0	50.0

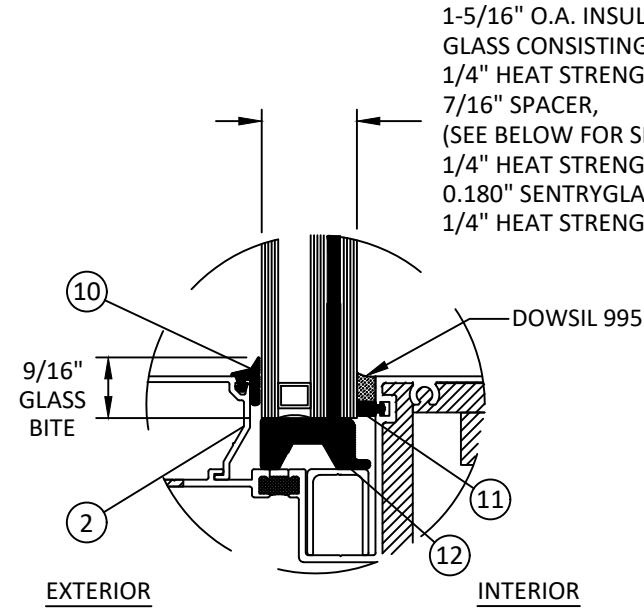

**GLAZING DETAIL 1**

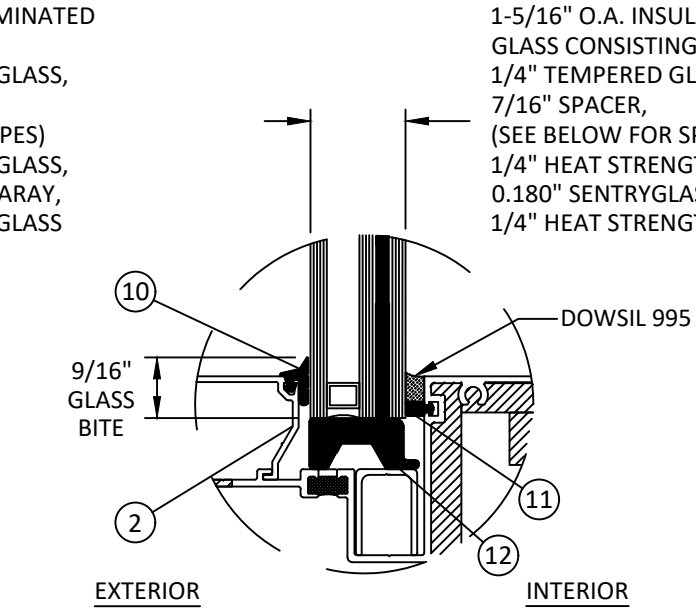


**GLAZING DETAIL 2**

GLASS SPACER OPTIONS	
OPTION #	SPACER TYPE
1	ALUMINUM BOX SPACER
2	TECHNOFORM TGI-SPACER
3	QUANEX SUPER SPACER T-SPACER
4	FULLER K4SG (THERMOPLASTIC SPACER)

- \* NOTE:**
- GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300 (3 SEC. GUSTS) AND CHAPTER 17 OF THE 2018 IBC FOR SIZES OTHER THAN TESTED.
  - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
  - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
  - D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.

- DAYLITE OPENING DIMENSIONS:**
- DAYLITE OPENING WIDTH:
- NOMINAL PANEL WIDTH - 2.500"
- DAYLITE OPENING HEIGHT W/O INTERMEDIATE HORIZONTAL:
- FRAME HEIGHT - 5.625"

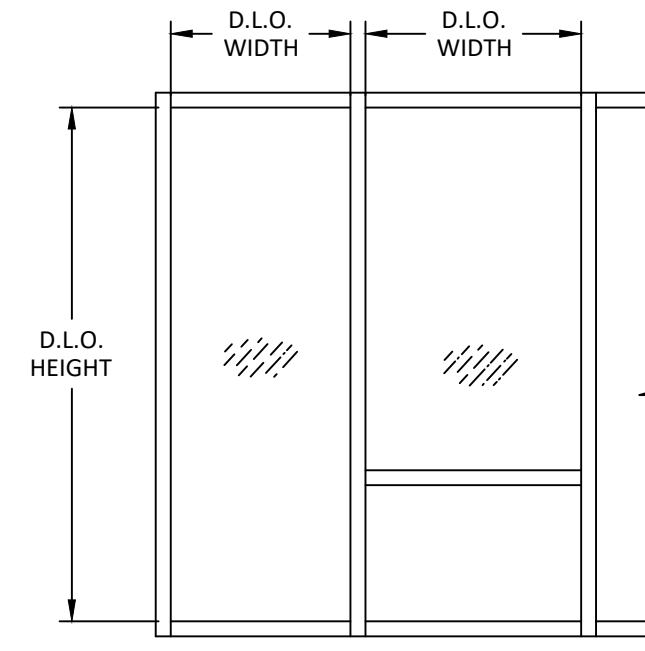

OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)  
MISSILE LEVEL E GLAZING DETAILS

PREPARED BY: BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: 01.04.2023  
DWG. BY: SH      CHK. BY: HFN  
SCALE: NTS  
DWG. #: OBE010  
SHEET:




# MULLION LOAD TABLES




OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

DESIGN LOAD CAPACITY - PSF							
NOMINAL DIMS.		JAMB J1		HEAVY JAMB J2		MULLION M1	
WIDTH (W) (in.)	FRAME HEIGHT (H) (in.)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
30	72	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0	70.0	70.0
66		70.0	70.0	70.0	70.0	70.0	70.0
72		70.0	70.0	70.0	70.0	70.0	70.0
30	78	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0	70.0	70.0
66		70.0	70.0	70.0	70.0	70.0	70.0
72		67.3	67.3	67.3	67.3	67.3	67.3
30	84	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0	70.0	70.0
66		68.2	68.2	68.2	68.2	68.2	68.2
72		62.5	62.5	62.5	62.5	62.5	62.5
30	90	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0	70.0	70.0
66		63.6	63.6	63.6	63.6	63.6	63.6
72		58.3	58.3	58.3	58.3	58.3	58.3
30	96	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0	70.0
60		65.6	65.6	65.6	65.6	65.6	65.6
66		59.7	59.7	59.7	59.7	59.7	59.7
72		54.7	54.7	54.7	54.7	54.7	54.7


DESIGN LOAD CAPACITY - PSF							
NOMINAL DIMS.		JAMB J1		HEAVY JAMB J2		MULLION M1	
WIDTH (W) (in.)	FRAME HEIGHT (H) (in.)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
30	102	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		68.6	68.6	68.6	68.6	68.6	68.6
60		61.8	61.8	61.8	61.8	61.8	61.8
66		56.1	56.1	56.1	56.1	56.1	56.1
72		51.5	51.5	51.5	51.5	51.5	51.5
30	108	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0	70.0
54		64.8	64.8	64.8	64.8	64.8	64.8
60		58.3	58.3	58.3	58.3	58.3	58.3
66		53.0	53.0	53.0	53.0	53.0	53.0
72		70.0	70.0	70.0	70.0	70.0	70.0
30	114	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		69.1	69.1	69.1	69.1	69.1	69.1
54		61.4	61.4	61.4	61.4	61.4	61.4
60		55.3	55.3	55.3	55.3	55.3	55.3
66		50.2	50.2	50.2	50.2	50.2	50.2
72		70.0	70.0	70.0	70.0	70.0	70.0
30	120	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0	70.0
48		65.6	65.6	65.6	65.6	65.6	65.6
54		58.3	58.3	58.3	58.3	58.3	58.3
60		52.5	52.5	52.5	52.5	52.5	52.5
72		70.0	70.0	70.0	70.0	70.0	70.0
30		126	70.0	70.0	70.0	70.0	70.0
36	70.0		70.0	70.0	70.0	70.0	70.0
42	70.0		70.0	70.0	70.0	70.0	70.0
48	62.5		62.5	62.5	62.5	62.5	62.5
54	55.6		55.6	55.6	55.6	55.6	55.6
60	50.0		50.0	50.0	50.0	50.0	50.0

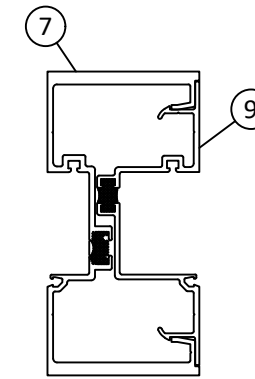


JAMB - J1

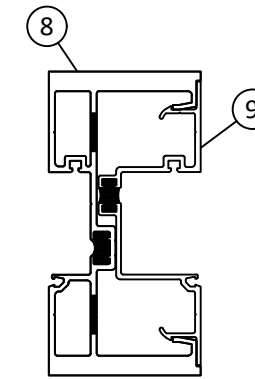


MULLION - M1

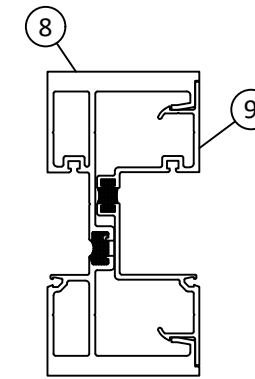

HEAVY JAMB - J2

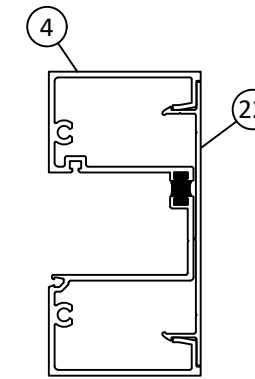

ANCHORED JAMB - J3

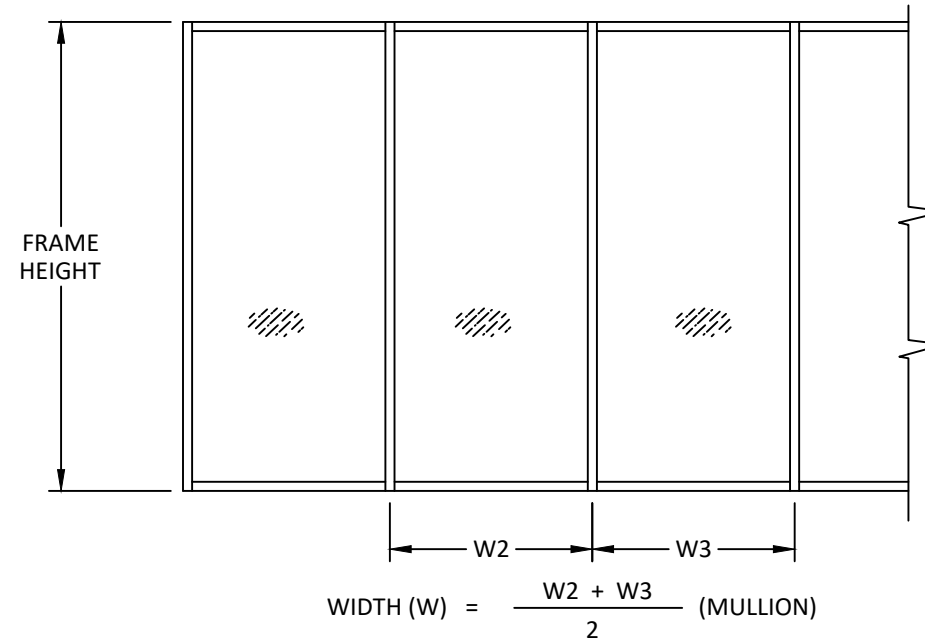

TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)

MULLION LOAD TABLES

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE:	01.04.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	OBE010

SHEET: 4 OF 14

# ANCHOR TYPE 'A & B' TABLES

ANCHORS TYPES: SEE SHEET 11 FOR DESCRIPTION

A3 = (3) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION






B3 = (3) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

B4 = (4) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

B5 = (5) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

B6 = (6) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

ANCHOR LOAD CAPACITY - PSF						
NOMINAL DIMS.		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'		
WIDTH (W)	FRAME HEIGHT	A3	B3	B4	B5	B6
30	72	70.0	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0
57		70.0	69.2	70.0	70.0	70.0
60		70.0	65.8	70.0	70.0	70.0
63		70.0	62.6	70.0	70.0	70.0
66		70.0	59.8	70.0	70.0	70.0
69		70.0	57.2	70.0	70.0	70.0
72	70.0	54.8	70.0	70.0	70.0	
30	78	70.0	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0	70.0
54		70.0	67.4	70.0	70.0	70.0
57		70.0	63.9	70.0	70.0	70.0
60		70.0	60.7	70.0	70.0	70.0
63		70.0	57.8	70.0	70.0	70.0
66		70.0	55.2	70.0	70.0	70.0
69		70.0	52.8	70.0	70.0	70.0
72	70.0	50.6	67.4	70.0	70.0	
30	84	70.0	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0
51		70.0	66.3	70.0	70.0	70.0
54		70.0	62.6	70.0	70.0	70.0
57		70.0	59.3	70.0	70.0	70.0
60		70.0	56.4	70.0	70.0	70.0
63		70.0	53.7	70.0	70.0	70.0
66		70.0	51.2	68.3	70.0	70.0
69		70.0	49.0	65.3	70.0	70.0
72	70.0	47.0	62.6	70.0	70.0	

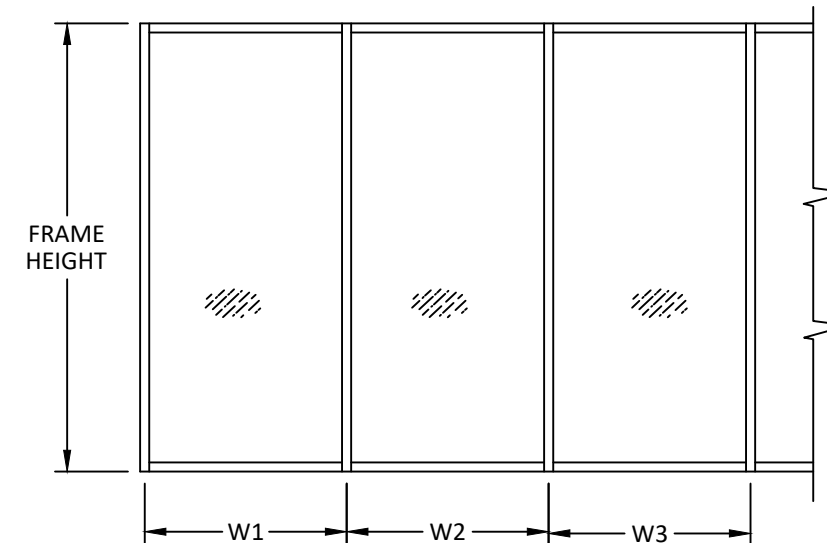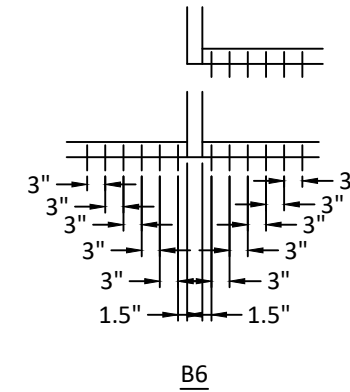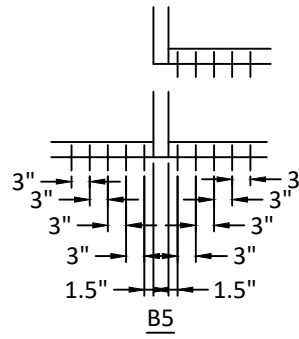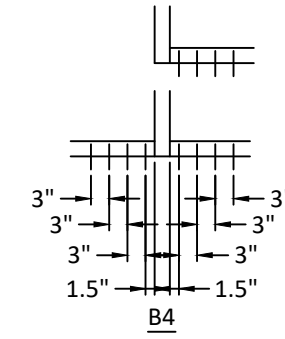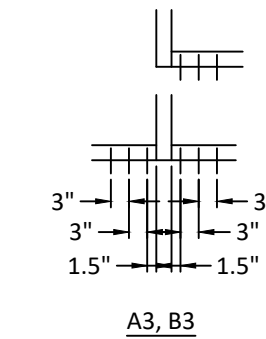

WIDTH (W) = W1 (JAMB)

WIDTH (W) =  $\frac{W2 + W3}{2}$  (MULLION)



OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)

TYPE A & B ANCHOR TABLES

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: 01.04.2023

DWG. BY: SH      CHK. BY: HFN

SCALE: NTS

DWG. #: OBE010

SHEET:

5

OF 14



# ANCHOR TYPE 'A & B' TABLES - CONTINUED

ANCHOR LOAD CAPACITY - PSF						
NOMINAL DIMS.		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'		
WIDTH (W)	FRAME HEIGHT	A3	B3	B4	B5	B6
30	90	70.0	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0	70.0
48		70.0	65.8	70.0	70.0	70.0
51		70.0	61.9	70.0	70.0	70.0
54		70.0	58.5	70.0	70.0	70.0
57		70.0	55.4	70.0	70.0	70.0
60		70.0	52.6	70.0	70.0	70.0
63		70.0	50.1	66.8	70.0	70.0
66		70.0	47.8	63.8	70.0	70.0
69		70.0	45.7	61.0	70.0	70.0
72	70.0	43.8	58.5	70.0	70.0	
30	96	70.0	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
45		70.0	65.8	70.0	70.0	70.0
48		70.0	61.6	70.0	70.0	70.0
51		70.0	58.0	70.0	70.0	70.0
54		70.0	54.8	70.0	70.0	70.0
57		70.0	51.9	69.2	70.0	70.0
60		70.0	49.3	65.8	70.0	70.0
63		70.0	47.0	62.6	70.0	70.0
66		70.0	44.8	59.8	70.0	70.0
69		70.0	42.9	57.2	70.0	70.0
72	70.0	41.1	54.8	68.5	70.0	
30	102	70.0	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0	70.0
42		70.0	66.3	70.0	70.0	70.0
45		70.0	61.9	70.0	70.0	70.0
48		70.0	58.0	70.0	70.0	70.0
51		70.0	54.6	70.0	70.0	70.0
54		70.0	51.6	68.8	70.0	70.0
57		70.0	48.9	65.1	70.0	70.0
60		70.0	46.4	61.9	70.0	70.0
63		70.0	44.2	58.9	70.0	70.0
66		70.0	42.2	56.3	70.0	70.0
69		70.0	40.4	53.8	67.3	70.0
72	70.0	38.7	51.6	64.5	70.0	

ANCHOR LOAD CAPACITY - PSF					
NOMINAL DIMS.		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A3	B3	B4	
30	108	70.0	70.0	70.0	
33		70.0	70.0	70.0	
36		70.0	70.0	70.0	
39		70.0	67.4	70.0	
42		70.0	62.6	70.0	
45		70.0	58.5	70.0	
48		70.0	54.8	70.0	
51		70.0	51.6	68.8	
54		70.0	48.7	64.9	
57		70.0	46.1	61.5	
60		70.0	43.8	58.5	
63		70.0	41.8	55.7	
66		70.0	39.9	53.1	
30		114	70.0	70.0	70.0
33	70.0		70.0	70.0	
36	70.0		69.2	70.0	
39	70.0		63.9	70.0	
42	70.0		59.3	70.0	
45	70.0		55.4	70.0	
48	70.0		51.9	69.2	
51	70.0		48.9	65.1	
54	70.0		46.1	61.5	
57	70.0		43.7	58.3	
60	70.0		41.5	55.4	
63	70.0		39.6	52.7	
66	70.0		37.8	50.3	
30	120		70.0	70.0	70.0
33		70.0	70.0	70.0	
36		70.0	65.8	70.0	
39		70.0	60.7	70.0	
42		70.0	56.4	70.0	
45		70.0	52.6	70.0	
48		70.0	49.3	65.8	
51		70.0	46.4	61.9	
54		70.0	43.8	58.5	
57		70.0	41.5	55.4	
60		70.0	39.5	52.6	
30		126	70.0	70.0	70.0
33			70.0	68.3	70.0
36			70.0	62.6	70.0
39	70.0		57.8	70.0	
42	70.0		53.7	70.0	
45	70.0		50.1	66.8	
48	70.0		47.0	62.6	
51	70.0		44.2	58.9	
54	70.0		41.8	55.7	
57	70.0		39.6	52.7	
60	70.0		37.6	50.1	



OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM  
STOREFRONT SYSTEM  
(MISSILE LEVEL E)  
TYPE A & B ANCHOR TABLES  
CONTINUED

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: **01.04.2023**  
DWG. BY: **SH** | CHK. BY: **HFN**  
SCALE: **NTS**  
DWG. #: **OBE010**

SHEET:  
**6**  
OF 14



1/5/2023 9:32 AM  
 s:\projects\oldcastle building envelope\tdi-21-1110.1 - tdi submittal - series fg-5750t storefront (non thermal) e1 and e3\_series fg-5750t storefront (thermal) e2 and e4.dwg\obe010.dwg

# ANCHOR TYPE 'C & D' TABLES

ANCHORS TYPES: SEE SHEET 11 FOR DESCRIPTION

- C3 = (3) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
- C4 = (4) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
- C5 = (5) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
- D3 = (3) ANCHORS TYPE 'D' AT JAMB OR EACH SIDE OF MULLION

ANCHOR LOAD CAPACITY - PSF					
NOMINAL DIMS.		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'
WIDTH (W)	FRAME HEIGHT	C3	C4	C5	D3
30	72	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
57		70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0
63		70.0	70.0	70.0	70.0
66		70.0	70.0	70.0	70.0
69		70.0	70.0	70.0	70.0
72	70.0	70.0	70.0	70.0	
30	78	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
57		70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0
63		70.0	70.0	70.0	70.0
66		70.0	70.0	70.0	70.0
69		68.8	70.0	70.0	70.0
72	65.9	70.0	70.0	70.0	
30	84	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
57		70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0
63		70.0	70.0	70.0	70.0
66		66.8	70.0	70.0	70.0
69		63.9	70.0	70.0	70.0
72	61.2	70.0	70.0	70.0	

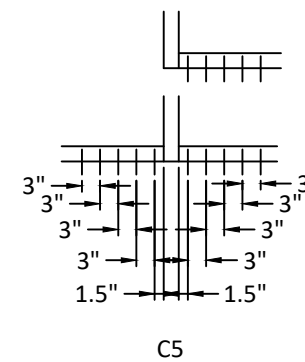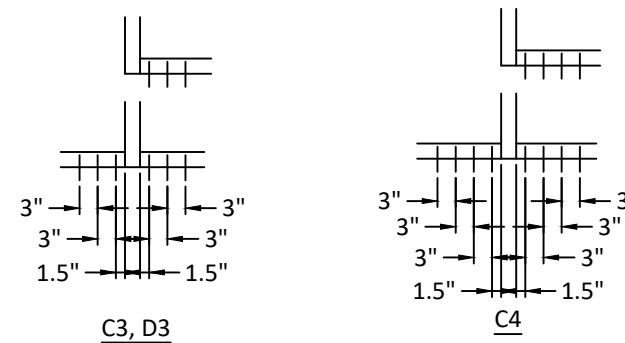

WIDTH (W) = W1 (JAMB)

WIDTH (W) =  $\frac{W2 + W3}{2}$  (MULLION)



OLDCASTLE BUILDING ENVELOPE  
 803 AIRPORT ROAD  
 TERRELL, TEXAS 75160  
 PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)

TYPE C & D ANCHOR TABLES

PREPARED BY: **BUILDING DROPS, INC.**  
 398 E. DANIA BEACH BLVD., STE. 338  
 DANIA BEACH, FL 33004  
 PH: (954)399-8478  
 FAX: (954)744-4738  
 WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
 TEXAS P.E. No. 118471  
 BUILDING DROPS, INC  
 398 E. DANIA BEACH BLVD. # 338  
 DANIA BEACH, FL 33004  
 TBPE FRIM No. 13734

DATE: 01.04.2023

DWG. BY: SH  
 CHK. BY: HFN

SCALE: NTS

DWG. #: OBE010

SHEET:

7

OF 14



# ANCHOR TYPE 'C & D' TABLES - CONTINUED

ANCHOR LOAD CAPACITY - PSF					
NOMINAL DIMS.		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'
WIDTH (W)	FRAME HEIGHT	C3	C4	C5	D3
30	90	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
57		70.0	70.0	70.0	70.0
60		68.6	70.0	70.0	70.0
63		65.3	70.0	70.0	70.0
66		62.3	70.0	70.0	70.0
69		59.6	70.0	70.0	70.0
72	57.1	70.0	70.0	70.0	
30	96	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
57		67.7	70.0	70.0	70.0
60		64.3	70.0	70.0	70.0
63		61.2	70.0	70.0	70.0
66		58.4	70.0	70.0	70.0
69		55.9	70.0	70.0	70.0
72	53.6	70.0	70.0	70.0	
30	102	70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
39		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
45		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
51		70.0	70.0	70.0	70.0
54		67.2	70.0	70.0	70.0
57		63.7	70.0	70.0	70.0
60		60.5	70.0	70.0	70.0
63		57.6	70.0	70.0	70.0
66		55.0	70.0	70.0	70.0
69		52.6	70.0	70.0	70.0
72	50.4	67.2	70.0	70.0	

ANCHOR LOAD CAPACITY - PSF						
NOMINAL DIMS.		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'	
WIDTH (W)	FRAME HEIGHT	C3	C4	C5	D3	
30	108	70.0	70.0	70.0	70.0	
33		70.0	70.0	70.0	70.0	
36		70.0	70.0	70.0	70.0	
39		70.0	70.0	70.0	70.0	
42		70.0	70.0	70.0	70.0	
45		70.0	70.0	70.0	70.0	
48		70.0	70.0	70.0	70.0	
51		67.2	70.0	70.0	70.0	
54		63.5	70.0	70.0	70.0	
57		60.2	70.0	70.0	70.0	
60		57.1	70.0	70.0	70.0	
63		54.4	70.0	70.0	70.0	
66		51.9	69.3	70.0	70.0	
30		114	70.0	70.0	70.0	70.0
33	70.0		70.0	70.0	70.0	
36	70.0		70.0	70.0	70.0	
39	70.0		70.0	70.0	70.0	
42	70.0		70.0	70.0	70.0	
45	70.0		70.0	70.0	70.0	
48	67.7		70.0	70.0	70.0	
51	63.7		70.0	70.0	70.0	
54	60.2		70.0	70.0	70.0	
57	57.0		70.0	70.0	70.0	
60	54.1		70.0	70.0	70.0	
63	51.6		68.7	70.0	70.0	
66	49.2		65.6	70.0	70.0	
30	120		70.0	70.0	70.0	70.0
33		70.0	70.0	70.0	70.0	
36		70.0	70.0	70.0	70.0	
39		70.0	70.0	70.0	70.0	
42		70.0	70.0	70.0	70.0	
45		68.6	70.0	70.0	70.0	
48		64.3	70.0	70.0	70.0	
51		60.5	70.0	70.0	70.0	
54		57.1	70.0	70.0	70.0	
57		54.1	70.0	70.0	70.0	
60		51.4	68.6	70.0	70.0	
30		126	70.0	70.0	70.0	70.0
33			70.0	70.0	70.0	70.0
36			70.0	70.0	70.0	70.0
39	70.0		70.0	70.0	70.0	
42	70.0		70.0	70.0	70.0	
45	65.3		70.0	70.0	70.0	
48	61.2		70.0	70.0	70.0	
51	57.6		70.0	70.0	70.0	
54	54.4		70.0	70.0	70.0	
57	51.6		68.7	70.0	70.0	
60	49.0		65.3	70.0	70.0	



OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM  
STOREFRONT SYSTEM  
(MISSILE LEVEL E)  
TYPE C & D ANCHOR TABLES  
CONTINUED

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: **01.04.2023**  
DWG. BY: **SH**      CHK. BY: **HFN**  
SCALE: **NTS**  
DWG. #: **OBE010**

SHEET:  
**8**



# DOOR MULLION LOAD & ANCHOR TABLES

TITLE: FG-5750T STORMMAX ALUMINUM  
STOREFRONT SYSTEM  
(MISSILE LEVEL E)  
DOOR MULLION TABLES


PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



DOOR MULLION LOAD CAPACITY (PSF)			
NOMINAL DIMS.		DESIGN PRESSURE	
WIDTH (W)	FRAME HEIGHT	EXT. (+)	INT. (-)
24	72	70.0	70.0
30		70.0	70.0
36		70.0	70.0
42		70.0	70.0
48		70.0	70.0
54		70.0	70.0
60		70.0	70.0
66		70.0	70.0
72	67.1	67.1	
24	78	70.0	70.0
30		70.0	70.0
36		70.0	70.0
42		70.0	70.0
48		70.0	70.0
54		70.0	70.0
60		70.0	70.0
66		67.6	67.6
72	62.0	62.0	
24	84	70.0	70.0
30		70.0	70.0
36		70.0	70.0
42		70.0	70.0
48		70.0	70.0
54		70.0	70.0
60		69.1	69.1
66		62.8	62.8
72	57.6	57.6	
24	90	70.0	70.0
30		70.0	70.0
36		70.0	70.0
42		70.0	70.0
48		70.0	70.0
54		70.0	70.0
60		64.5	64.5
66		58.6	58.6
72	53.7	53.7	
24	96	70.0	70.0
30		70.0	70.0
36		70.0	70.0
42		70.0	70.0
48		70.0	70.0
54		67.1	67.1
60		60.4	60.4
66		54.9	54.9
72	50.4	50.4	

DOOR MULLION LOAD CAPACITY (PSF)				
NOMINAL DIMS.		DESIGN PRESSURE		
WIDTH (W)	FRAME HEIGHT	EXT. (+)	INT. (-)	
24	102	70.0	70.0	
30		70.0	70.0	
36		70.0	70.0	
42		70.0	70.0	
48		70.0	70.0	
54		63.2	63.2	
60		56.9	56.9	
66		51.7	51.7	
24	108	70.0	70.0	
30		70.0	70.0	
36		70.0	70.0	
42		70.0	70.0	
48		67.1	67.1	
54		59.7	59.7	
60		53.7	53.7	
24		114	70.0	70.0
30	70.0		70.0	
36	70.0		70.0	
42	70.0		70.0	
48	63.6		63.6	
54	56.5		56.5	
60	50.9		50.9	
24	120		70.0	70.0
30		70.0	70.0	
36		70.0	70.0	
42		69.1	69.1	
48		60.4	60.4	
54		53.7	53.7	
24		126	70.0	70.0
30			70.0	70.0
36	70.0		70.0	
42	65.8		65.8	
48	57.6		57.6	
55.25	50.0		50.0	

ANCHOR TYPE	TOTAL NO. OF ANCHORS REQUIRED AT DOUBLE DOOR/SINGLE DOOR TO SIDELITE MULLION AT HEAD & SILL BY DESIGN PRESSURE				
	70 PSF	60 PSF	50 PSF	40 PSF	30 PSF
A	4	4	3	3	2
B	11	9	8	6	5
C	8	7	6	5	4
D	4	3	3	2	2
E	6	5	5	4	3
F	11	10	8	7	5
G	13	11	10	8	6
H	6	6	5	4	3

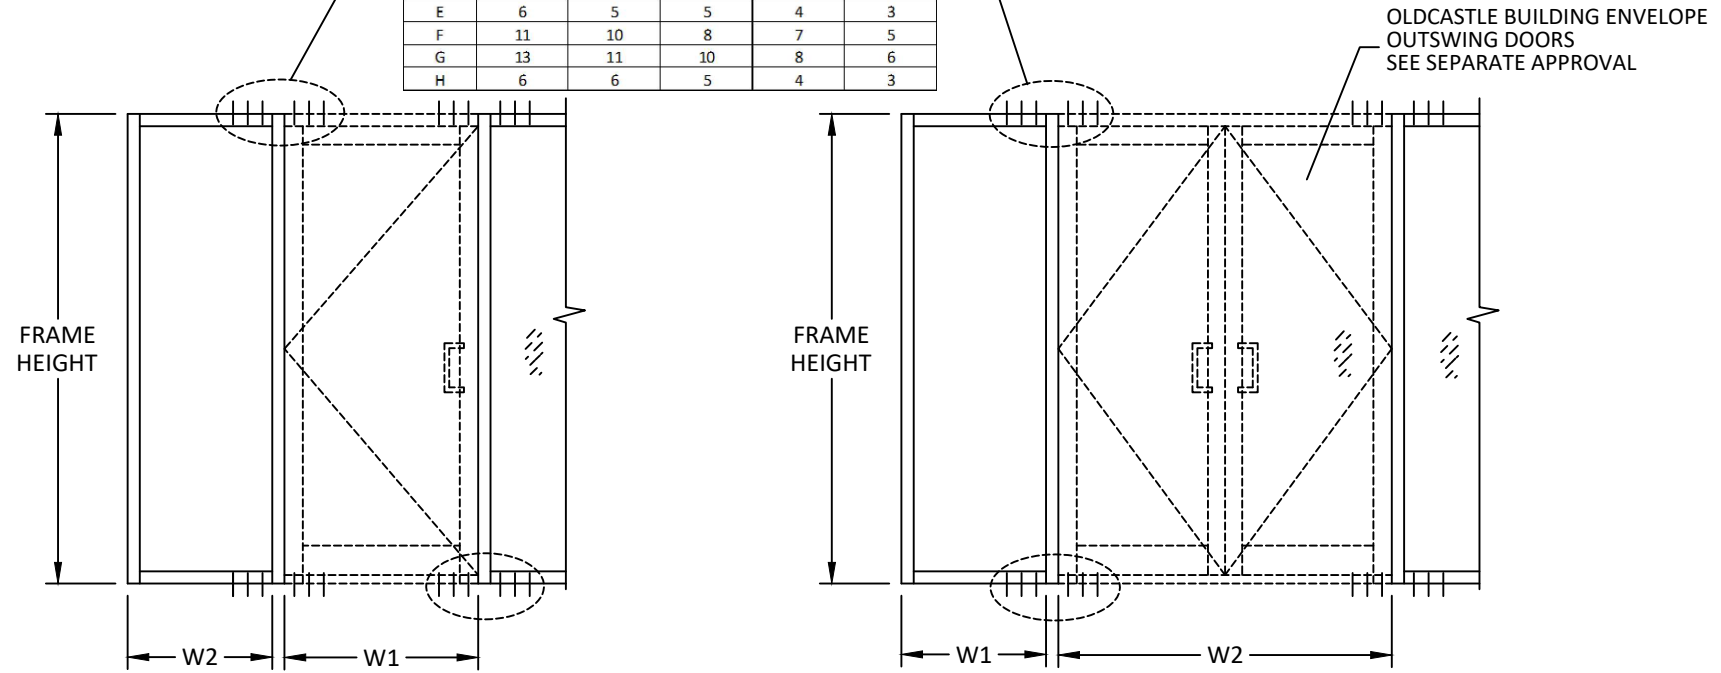

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$


**SINGLE DOOR**

NOTE: DOOR THRESHOLD ANCHORS TO BE 1/4" DIAMETER SEE SHEET 11 FOR DETAILS


$$\text{WIDTH (W)} = \frac{W1}{2} + \frac{W2}{4}$$

**DOUBLE DOOR**

ANCHOR TYPE	TOTAL NO. OF ANCHORS REQUIRED AT SINGLE DOOR W/TRANSOM TO SIDELITE MULLION AT HEAD & SILL BY DESIGN				
	70 PSF	60 PSF	50 PSF	40 PSF	30 PSF
A	4	4	3	3	2
B	11	9	8	6	5
C	8	7	6	5	4
D	4	3	3	2	2
E	6	5	5	4	3
F	11	10	8	7	5
G	13	11	10	8	6
H	6	6	5	4	3

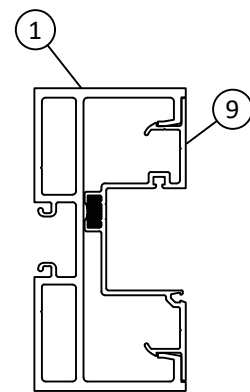

DOOR MULLION

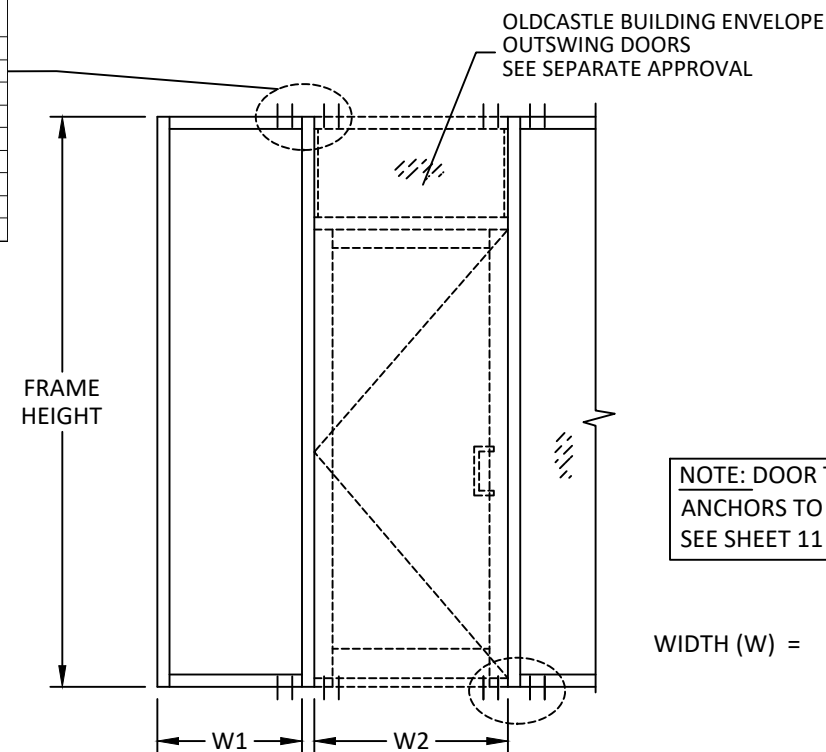

NOTE: DOOR THRESHOLD ANCHORS TO BE 1/4" DIAMETER SEE SHEET 11 FOR DETAILS

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

**SINGLE DOOR WITH TRANSOM**

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: **01.04.2023**

DWG. BY: **SH**      CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **OBE010**

SHEET: **9**

# DOOR MULLION LOAD & ANCHOR TABLES



OLDCASTLE BUILDING ENVELOPE  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM  
STOREFRONT SYSTEM  
(MISSILE LEVEL E)

DOOR MULLION TABLES

PREPARED BY:


**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



DOOR MULLION LOAD CAPACITY				
NOMINAL DIMS.			DESIGN PRESSURE	
FRAME HEIGHT (IN.)	DOOR WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)
114	72	30	70.0	70.0
		36	70.0	70.0
		42	70.0	70.0
		48	70.0	70.0
		54	66.9	66.9
		60	63.9	63.9
		66	61.3	61.3
		72	58.8	58.8
	78	30	70.0	70.0
		36	70.0	70.0
		42	70.0	70.0
		48	66.9	66.9
		54	63.9	63.9
		60	61.3	61.3
		66	58.8	58.8
		72	56.5	56.5
	84	30	70.0	70.0
		36	70.0	70.0
		42	66.9	66.9
		48	63.9	63.9
		54	61.3	61.3
		60	58.8	58.8
		66	56.5	56.5
		72	54.4	54.4
90	30	70.0	70.0	
	36	66.9	66.9	
	42	63.9	63.9	
	48	61.3	61.3	
	54	58.8	58.8	
	60	56.5	56.5	
	66	54.4	54.4	
	72	52.5	52.5	
96	30	66.9	66.9	
	36	63.9	63.9	
	42	61.3	61.3	
	48	58.8	58.8	
	54	56.5	56.5	
	60	54.4	54.4	
	66	52.5	52.5	
	72	50.6	50.6	


DOOR MULLION LOAD CAPACITY				
NOMINAL DIMS.			DESIGN PRESSURE	
FRAME HEIGHT (IN.)	DOOR WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)
120	72	30	70.0	70.0
		36	70.0	70.0
		42	69.9	69.9
		48	66.6	66.6
		54	63.5	63.5
		60	60.7	60.7
		66	58.2	58.2
		72	55.8	55.8
	78	30	70.0	70.0
		36	69.9	69.9
		42	66.6	66.6
		48	63.5	63.5
		54	60.7	60.7
		60	58.2	58.2
		66	55.8	55.8
		72	53.7	53.7
	84	30	69.9	69.9
		36	66.6	66.6
		42	63.5	63.5
		48	60.7	60.7
		54	58.2	58.2
		60	55.8	55.8
		66	53.7	53.7
		72	51.7	51.7
90	30	66.6	66.6	
	36	63.5	63.5	
	42	60.7	60.7	
	48	58.2	58.2	
	54	55.8	55.8	
	60	53.7	53.7	
	66	51.7	51.7	
	72	49.7	49.7	
96	30	63.5	63.5	
	36	60.7	60.7	
	42	58.2	58.2	
	48	55.8	55.8	
	54	53.7	53.7	
	60	51.7	51.7	

DOOR MULLION LOAD CAPACITY				
NOMINAL DIMS.			DESIGN PRESSURE	
FRAME HEIGHT (IN.)	DOOR WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)
126	72	30	70.0	70.0
		36	70.0	70.0
		42	66.6	66.6
		48	63.4	63.4
		54	60.5	60.5
		60	57.8	57.8
		66	55.4	55.4
		72	53.2	53.2
	78	30	70.0	70.0
		36	66.6	66.6
		42	63.4	63.4
		48	60.5	60.5
		54	57.8	57.8
		60	55.4	55.4
		66	53.2	53.2
		72	51.1	51.1
	84	30	66.6	66.6
		36	63.4	63.4
		42	60.5	60.5
		48	57.8	57.8
		54	55.4	55.4
		60	53.2	53.2
		66	51.1	51.1
		72	49.1	49.1
90	30	63.4	63.4	
	36	60.5	60.5	
	42	57.8	57.8	
	48	55.4	55.4	
	54	53.2	53.2	
	60	51.1	51.1	
96	30	60.5	60.5	
	36	57.8	57.8	
	42	55.4	55.4	
	48	53.2	53.2	
	54	51.1	51.1	
	60	49.1	49.1	

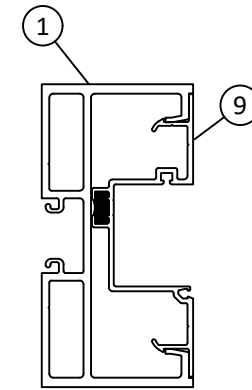

DOOR MULLION

ANCHOR TYPE	TOTAL NO. OF ANCHORS REQUIRED AT DOUBLE DOOR W/TRANSOM TO SIDELITE MULLION AT HEAD & SILL BY DESIGN				
	70 PSF	60 PSF	50 PSF	40 PSF	30 PSF
A	6	5	4	4	3
B	15	13	11	9	7
C	12	10	9	7	5
D	5	4	4	3	2
E	9	7	6	5	4
F	16	14	12	10	7
G	19	16	14	11	8
H	9	8	7	5	4

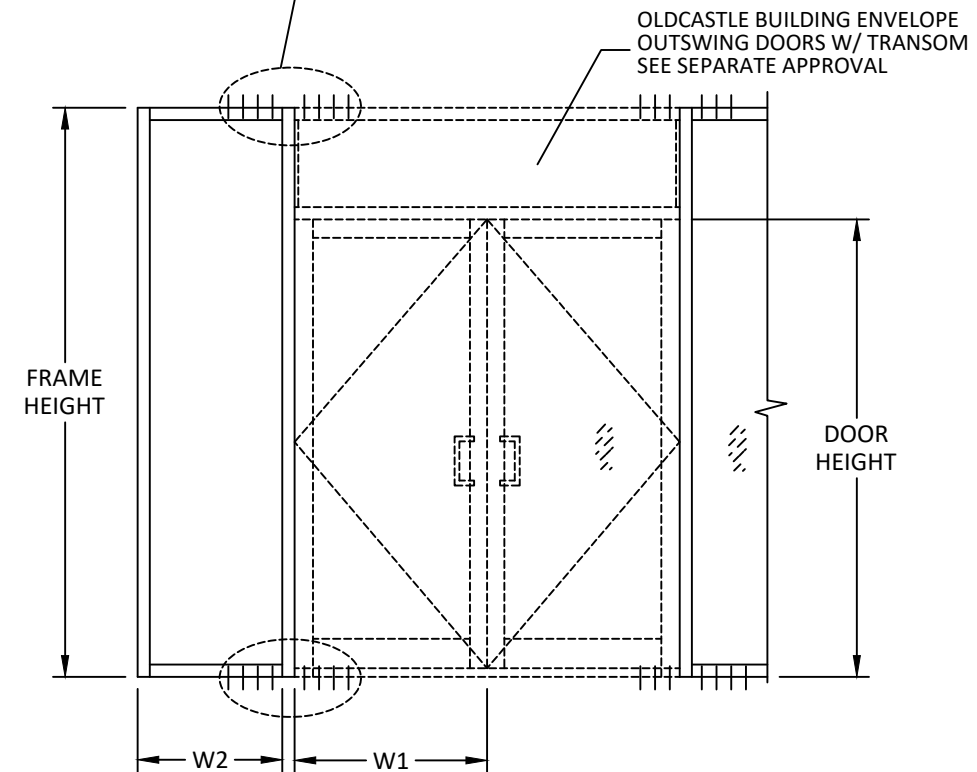

DOUBLE DOOR WITH TRANSOM

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

NOTE: DOOR THRESHOLD ANCHORS TO BE 1/4" DIAMETER SEE SHEET 11 FOR DETAILS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: 01.04.2023

DWG. BY: SH      CHK. BY: HFN

SCALE: NTS


DWG. #: OBE010

SHEET:


10




1/5/2023 9:32 AM  
 s:\projects\oldcastle\_building\_envelope\tdi-21-1110.1 - tdi submittal - series fg-5750 storefront (non thermal) e1 and e3\_series fg-5750 storefront (thermal) e2 and e4.dwg\obe010.dwg

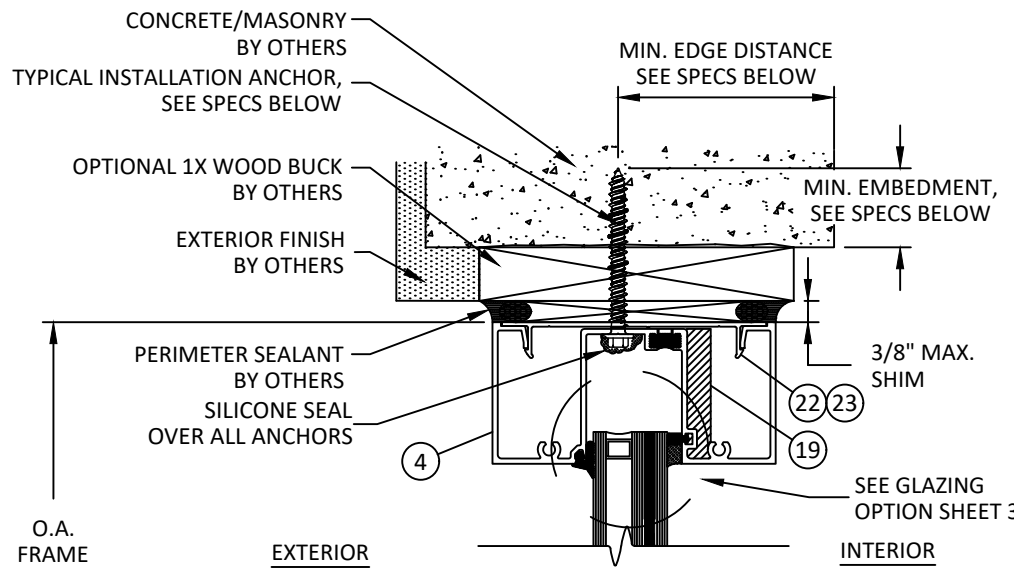


**A**  
**11** VERTICAL SECTION  
HEAD - CONCRETE/MASONRY W/ 1X BUCK  
TYPICAL INSTALLATION

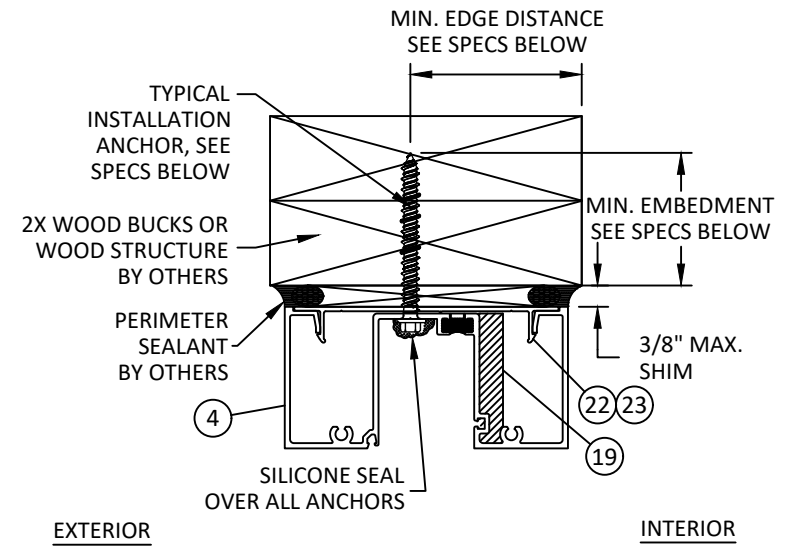

**B**  
**11** VERTICAL SECTION  
HEAD - WOOD FRAMING  
TYPICAL INSTALLATION

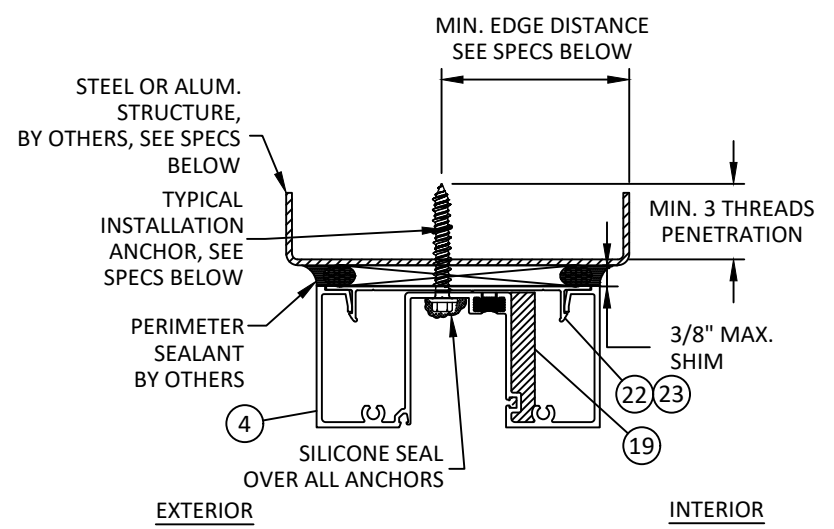


**C**  
**11** VERTICAL SECTION  
HEAD - METAL SUBSTRATE  
TYPICAL INSTALLATION

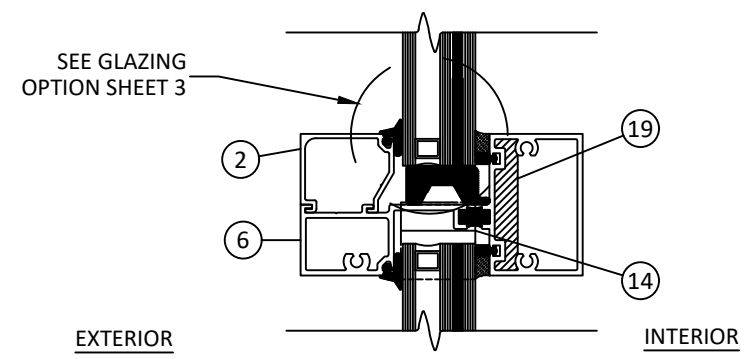

**D**  
**11** VERTICAL SECTION  
HORIZONTAL MEMBER

LIMIT DESIGN LOADS FOR HORIZONTAL AS FOLLOWS			
MAX HORIZ. SPAN	MAX GLASS HEIGHT ABOVE HORIZ.	MAX DESIGN LOADS	
		EXT. (+)	INT. (-)
45.5"	84"	70 PSF	70 PSF
57.5"	96"	50 PSF	50 PSF

DESIGN LOADS SHOWN ABOVE ARE BASED ON MAX. GLASS AREA ABOVE HORIZONTAL, FOR SIZES SMALLER THAN SHOWN ABOVE, ALLOWABLE DESIGN LOADS MAY BE CALCULATED SEPARATELY.

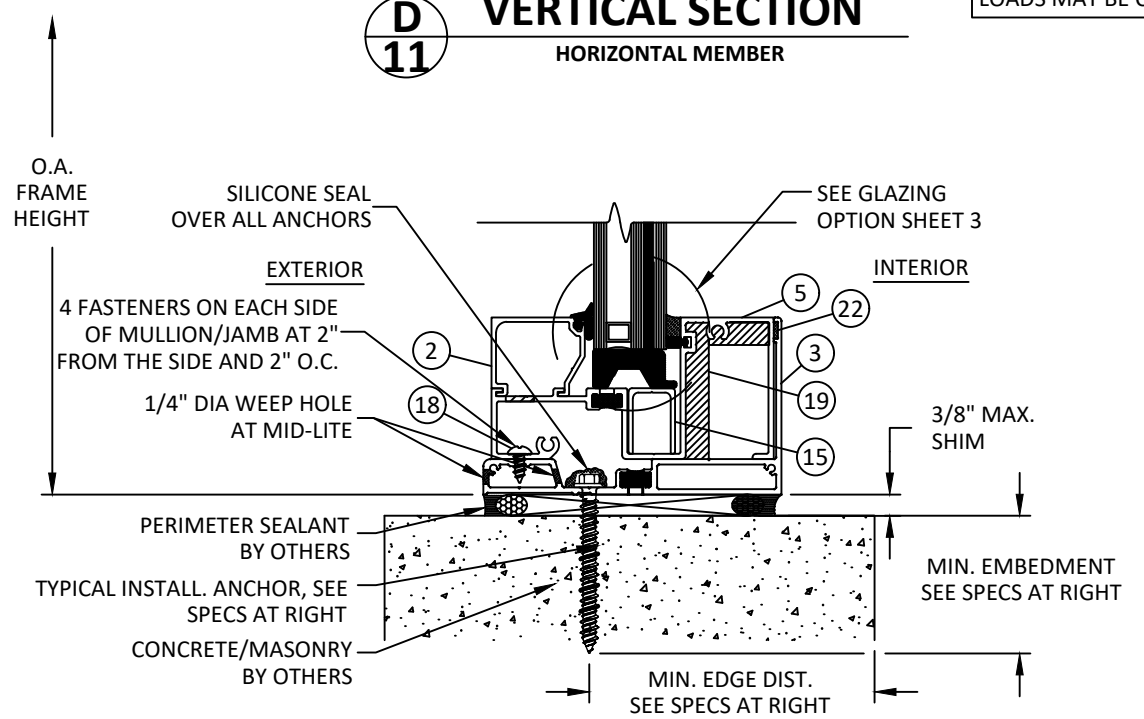

**E**  
**11** VERTICAL SECTION  
SILL - DIRECT TO CONCRETE/MASONRY  
TYPICAL CONFIGURATION

FG-5750T ANCHOR TYPES					
ANCHOR TYPE	ANCHOR DESCRIPTION	SUBSTRATE REQUIREMENTS	MIN. EMBEDMENT	MIN. EDGE DISTANCE	NOTES
A	5/16" DIA. TAPCON BY ITW (Fu=125 KSI, Fy=100 KSI) OR	F'C = 3000 PSI MIN.	1-3/4"	2-1/2"	FOR USE THROUGH OPTIONAL 1X BUCKS, BY OTHERS
B	5/16" DIA. ULTRACON BY DEWALT (Fu=177 KSI, Fy=155 KSI)	C-90 HOLLOW/FILLED BLOCK AT JAMBS F'M = 2000 PSI MIN.	1-1/2"	2-1/2"	
C	5/16" DIA. ULTRACON BY DEWALT (Fu=177 KSI, Fy=155 KSI)	MIN. S.G. = 0.42 WOOD	1-1/2"	1"	--
D	5/16" SELF-DRILLING SCREWS (GRADE 5)	STEEL: 16 GA. MIN., Fy=36 KSI MIN. ALUM.: 1/8" MIN., 6063-T5 MIN.	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"	STEEL IN CONTACT WITH ALUM. TO BE PLATED OR PAINTED
E	1/4" DIA. TAPCON BY ITW (Fu=125 KSI, Fy=100 KSI) OR	F'C = 3000 PSI MIN.	1-3/4"	2-1/2"	FOR USE THROUGH OPTIONAL 1X BUCKS, BY OTHERS
F	1/4" DIA. ULTRACON+ BY DEWALT (Fu=177 KSI, Fy=155 KSI)	C-90 HOLLOW/FILLED BLOCK AT JAMBS F'M = 2000 PSI MIN.	1"	2-1/2"	
G	1/4" DIA. ULTRACON+ BY DEWALT (Fu=177 KSI, Fy=155 KSI)	MIN. S.G. = 0.42 WOOD	1-1/2"	1"	--
H	1/4" SELF-DRILLING SCREWS (GRADE 5)	STEEL: 16 GA. MIN., Fy=36 KSI MIN. ALUM.: 1/8" MIN., 6063-T5 MIN.	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"	STEEL IN CONTACT WITH ALUM. TO BE PLATED OR PAINTED



**OLDCASTLE BUILDING ENVELOPE**  
 803 AIRPORT ROAD  
 TERRELL, TEXAS 75160  
 PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)  
 VERTICAL SECTIONS  
 PREPARED BY: **BUILDING DROPS, INC.**  
 398 E. DANIA BEACH BLVD., STE. 338  
 DANIA BEACH, FL 33004  
 PH: (954)399-8478  
 FAX: (954)744-4738  
 WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




HERMES F. NORERO, P.E.  
 TEXAS P.E. No. 118471  
 BUILDING DROPS, INC  
 398 E. DANIA BEACH BLVD. # 338  
 DANIA BEACH, FL 33004  
 TBPE FRIM No. 13734


DATE: **01.04.2023**  
 DWG. BY: **SH**      CHK. BY: **HFN**  
 SCALE: **NTS**  
 DWG. #: **OBE010**

SHEET: **11**  
 OF 14


1/5/2023 9:32 AM  
 s:\projects\oldcastle\_building\_envelope\12-1110-1 - tdi submittal - series fg-5750-storefront (non thermal) e1 and e3\_series fg-5750-storefront (thermal) e2 and e4.dwg\obe010.dwg

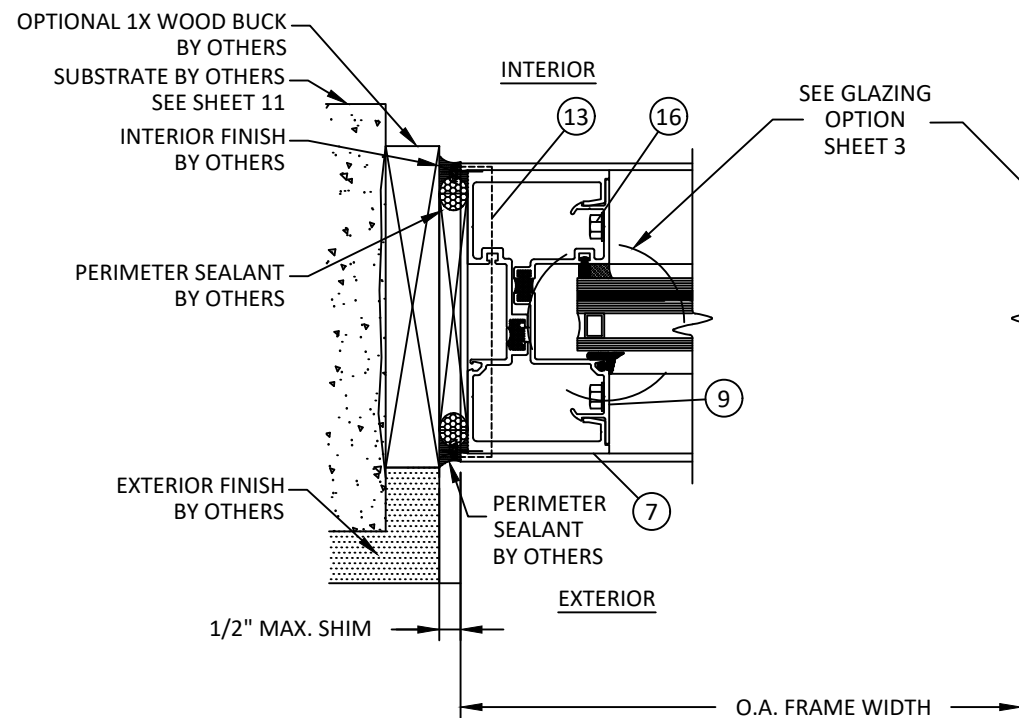


**F** **HORIZONTAL SECTION**  
**12** JAMB - J1

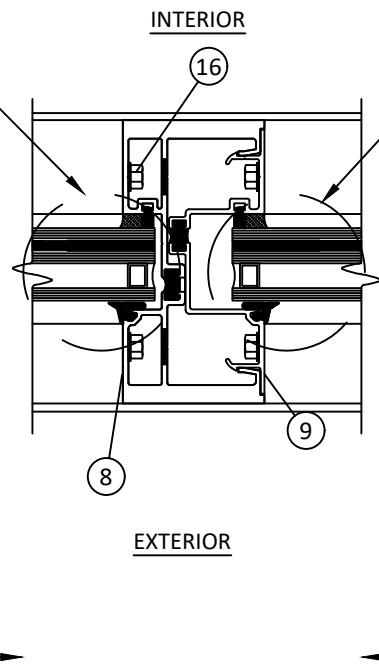


**G** **HORIZONTAL SECTION**  
**12** VERTICAL MULLION - M1

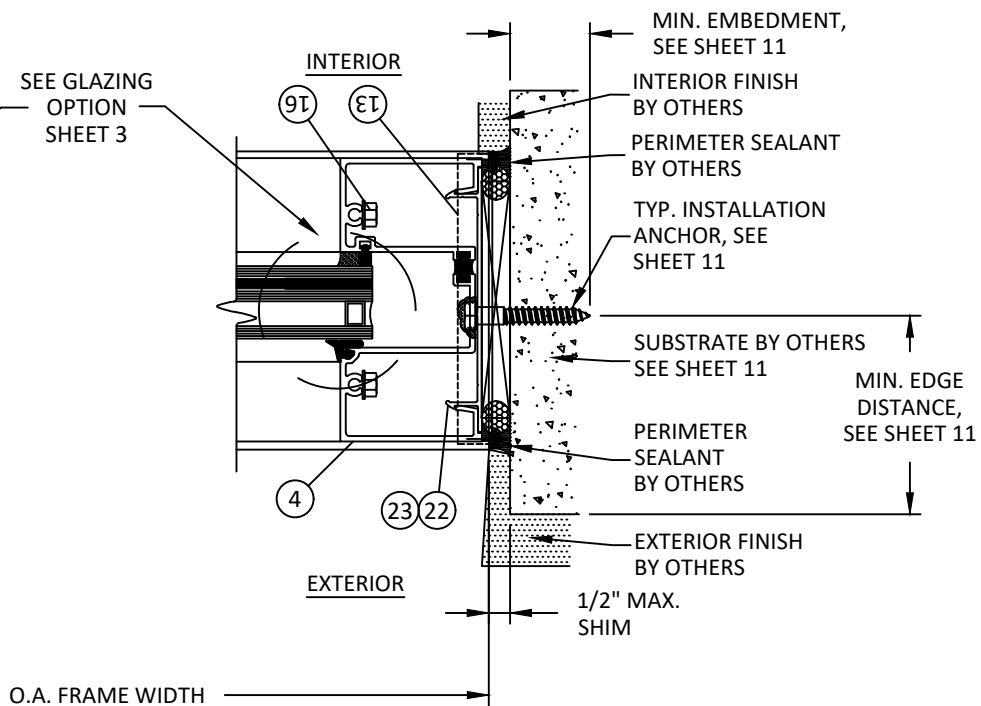

**H** **HORIZONTAL SECTION**  
**12** JAMB - J3  
 TYPICAL CONFIGURATION

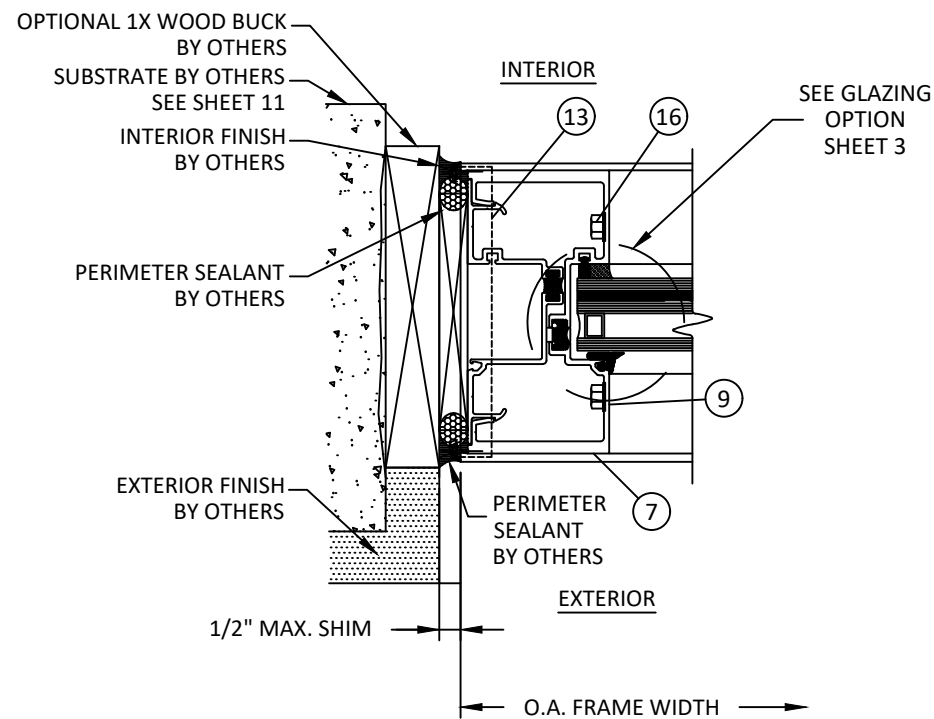

**F1** **HORIZONTAL SECTION**  
**12** JAMB - J1

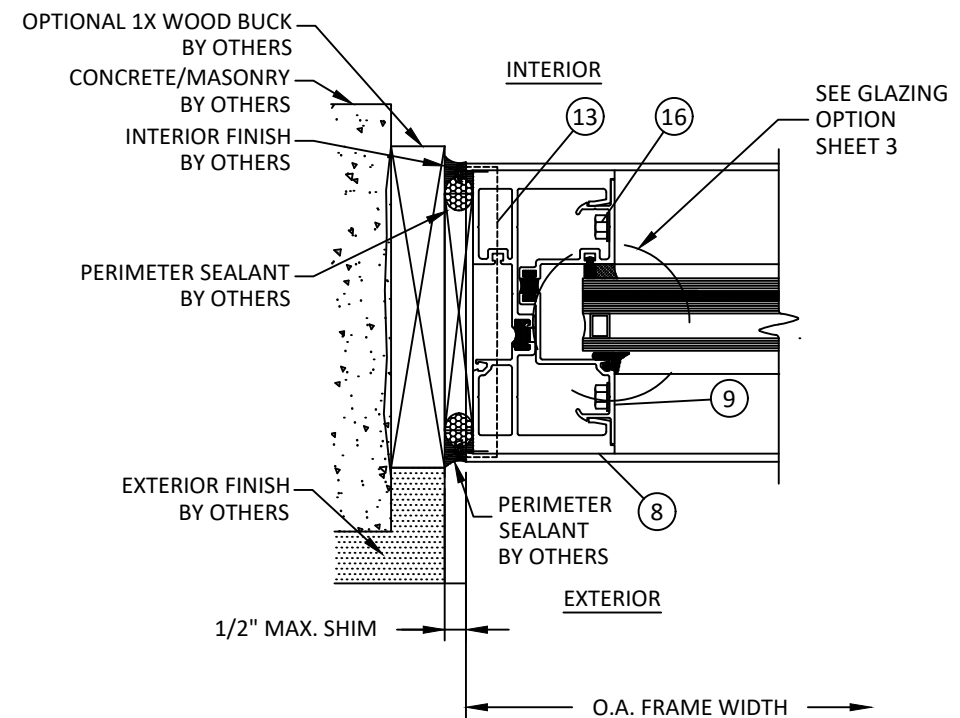

**I** **HORIZONTAL SECTION**  
**12** HEAVY JAMB - J2  
 HEAVY CONFIGURATION



**OLDCASTLE BUILDING ENVELOPE**  
 803 AIRPORT ROAD  
 TERRELL, TEXAS 75160  
 PH: (972)551-6100 WEB: OBE.ORG

**TITLE: FG-5750T STORMMAX ALUMINUM STOREFRONT SYSTEM (MISSILE LEVEL E)**  
**HORIZONTAL SECTIONS**  
**PREPARED BY: BUILDING DROPS, INC.**  
 398 E. DANIA BEACH BLVD., STE. 338  
 DANIA BEACH, FL 33004  
 PH: (954)399-8478  
 FAX: (954)744-4738  
 WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




HERMES F. NORERO, P.E.  
 TEXAS P.E. No. 118471  
 BUILDING DROPS, INC  
 398 E. DANIA BEACH BLVD. # 338  
 DANIA BEACH, FL 33004  
 TBPE FRIM No. 13734

DATE: **01.04.2023**  
 DWG. BY: **SH**      CHK. BY: **HFN**  
 SCALE: **NTS**  
 DWG. #: **OBE010**


SHEET:  
12  
 OF 14



s:\projects\oldcastle\_building\_envelope\di-21-1110.1 - tdi submittal - series fg-5750t storefront (non thermal) e1 and e3.series fg-5750t storefront (thermal) e2 and e4.dwg\obe010.dwg  
 1/5/2023 9:32 AM

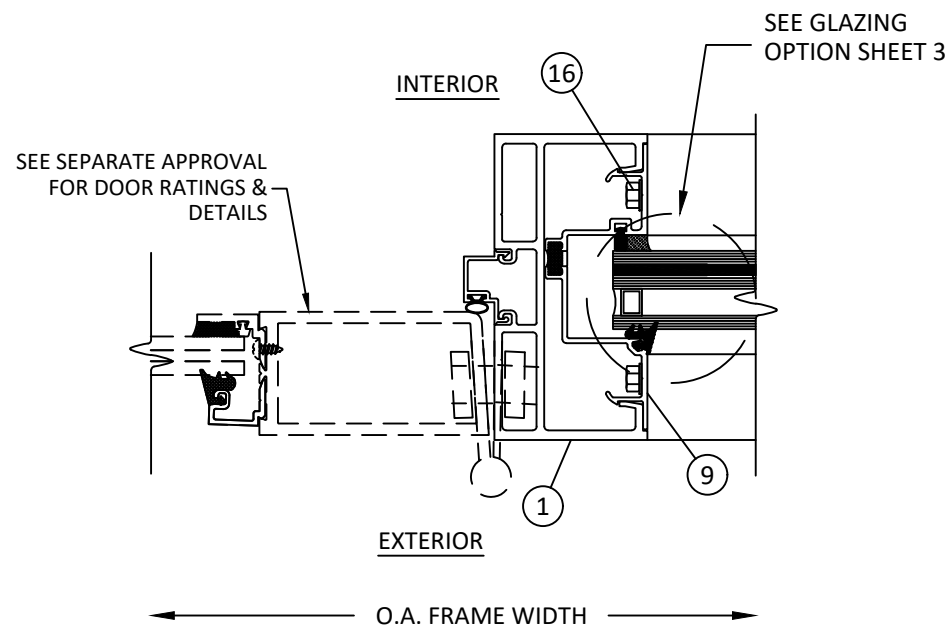

**J**  
**13** **HORIZONTAL SECTION**  
 DOOR/SIDELITE JAMB MULLION

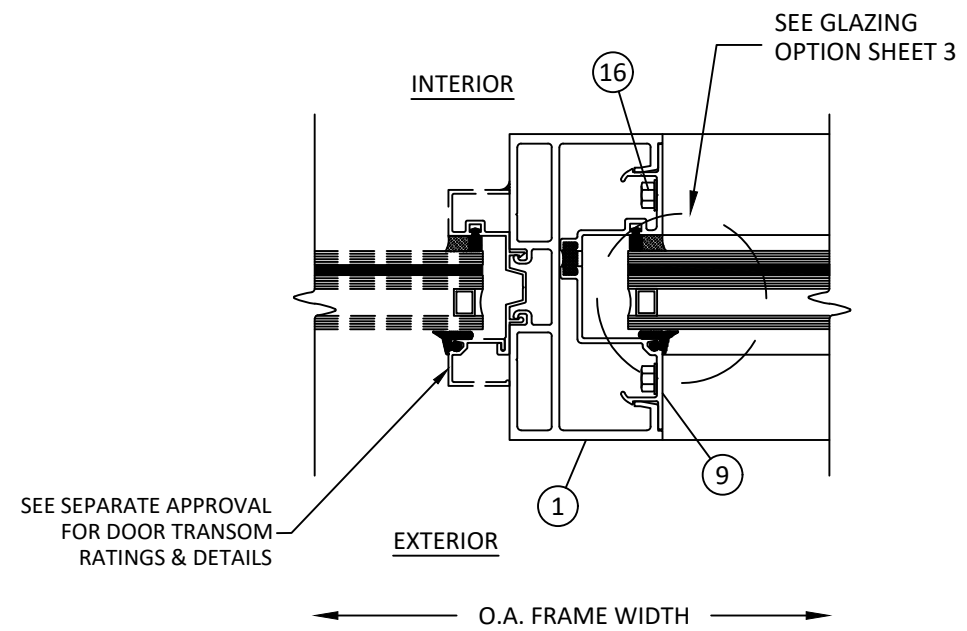

**K**  
**13** **HORIZONTAL SECTION**  
 DOOR TRANSOM/SIDELITE JAMB MULLION



**OLDCASTLE BUILDING ENVELOPE**  
 803 AIRPORT ROAD  
 TERRELL, TEXAS 75160  
 PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM  
 STOREFRONT SYSTEM  
 (MISSILE LEVEL E)  
 HORIZONTAL SECTIONS

PREPARED BY:  
**BUILDING DROPS, INC.**  
 398 E. DANIA BEACH BLVD., STE. 338  
 DANIA BEACH, FL 33004  
 PH: (954)399-8478  
 FAX: (954)744-4738  
 WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
 TEXAS P.E. No. 118471  
 BUILDING DROPS, INC  
 398 E. DANIA BEACH BLVD. # 338  
 DANIA BEACH, FL 33004  
 TBPE FRIM No. 13734

DATE: **01.04.2023**

DWG. BY: **SH**      CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **OBE010**

SHEET:


**13**

OF 14


1/5/2023 9:32 AM  
s:\projects\oldcastle building envelope\tdi-21-1110.1 - tdi submittal - series fg-5750t storefront (non thermal) e1 and e3.series fg-5750t storefront (thermal) e2 and e4.dwg\obe010.dwg

### BILL OF MATERIALS


ITEM NO.	PART NUMBER	DESCRIPTION	MATERIAL
1	FG-5717	DOOR JAMB	6063-T6 ALUMINUM
2	FG-5760	GLASS STOP	6063-T6 ALUMINUM
3	FGT-5726	SUBSILL	6063-T6 ALUMINUM
4	FGT-5770	HEAD/JAMB	6063-T6 ALUMINUM
5	FGT-5771	SILL	6063-T6 ALUMINUM
6	FGT-5772	INTERMEDIATE HORIZONTAL	6063-T6 ALUMINUM
7	FGT-5773	JAMB	6063-T6 ALUMINUM
8	FGT-5774	MULLION	6063-T6 ALUMINUM
9	FGT-5780	MULLION FILLER	6063-T6 ALUMINUM
10	FG-5736	GLAZING GASKET	70 DURO EPDM
11	FG-5731	SPACER GASKET	70 DURO SILICONE
12	FG-5743	SETTING BLOCK	85 DURO SILICONE
13	AN-104-01	END DAM	6063-T6 ALUMINUM
14	FG5790-02	WATER DIVERTER	RIGID PVC
15	FG5721-01	SETTING CHAIR	6063-T6 ALUMINUM
16	FS-8	#14 X 1" HH STS	STEEL
17	FS-23	#6 X 3/8" PPH	STEEL
18	FS-27	#12 X 1/2" PPH STS	STEEL
19	SM-5601	JOINT TAPE	BUTYL MASTIC TAPE
20	SEALANT	PERIMETER SEALANT	SILICONE
21	DOWSIL 995	GLAZING POCKET SEALANT	SILICONE
22	FG-5715	FLAT FILLER	6063-T6 ALUMINUM
23	FG-5719	FLAT FILLER	RIGID PVC

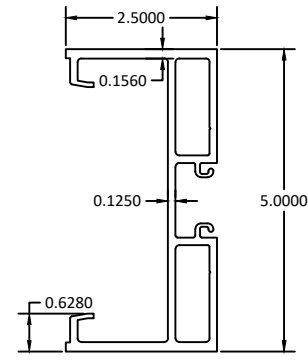


1 DOOR JAMB




2 GLASS STOP

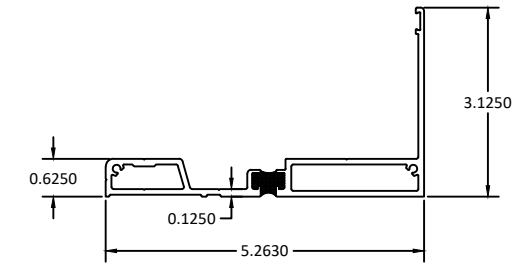


3 SUB-SILL

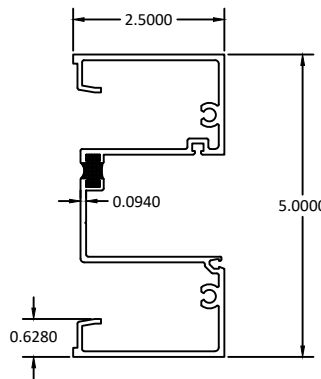


4 HEAD/JAMB

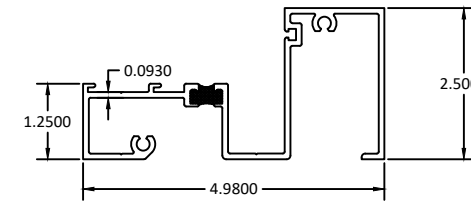


5 SILL

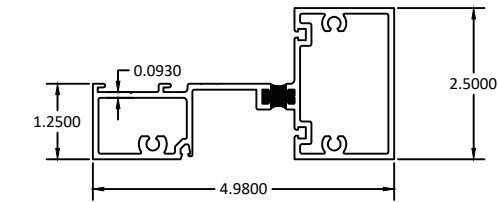


6 HORIZONTAL

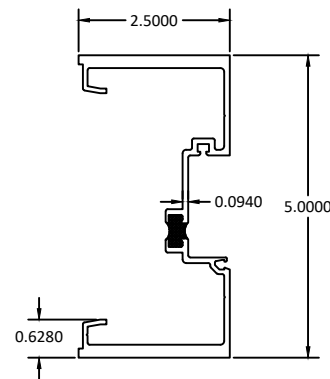


7 JAMB

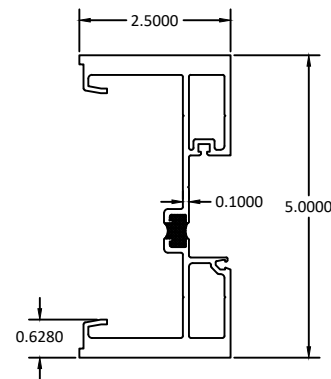


8 MULLION

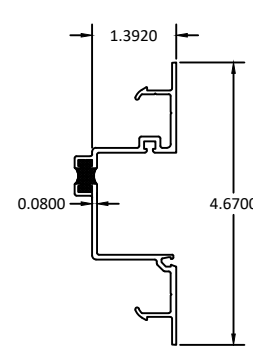


9 MULLION FILLER



14 WATER DIVERTER

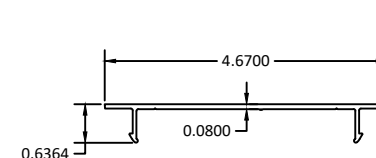

22 FLAT FILLER  
6063-T6 ALUMINUM

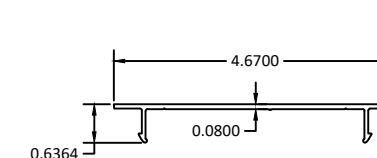

23 FLAT FILLER  
RIGID PVC



**OLDCASTLE BUILDING ENVELOPE**  
803 AIRPORT ROAD  
TERRELL, TEXAS 75160  
PH: (972)551-6100 WEB: OBE.ORG

TITLE: FG-5750T STORMMAX ALUMINUM  
STOREFRONT SYSTEM  
(MISSILE LEVEL E)  
COMPONENTS &  
BILL OF MATERIALS

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
TEXAS P.E. No. 118471  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
TBPE FRIM No. 13734

DATE: **01.04.2023**

DWG. BY: **SH**      CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **OBE010**

SHEET:

**14**

OF 14