



PERFORMANCE STANDARD

Glazed Steel Door


"NON-IMPACT"
INSWING / OUTSWING

EVALUATED FOR USE IN THE STATE OF TEXAS

The Glazed Steel Door system described herein complies with the 2006 International Residential Code (IRC), Sections R301 & R613 and the 2006 International Building Code (IBC), Sections 1405.12, 1609, 1714.5, 2403 and 2404 (including Texas revisions) subject to the following conditions:

1. Anchors shall be as listed and spaced as shown in the details. Anchor embedment to base material shall be beyond wall dressing or stucco.
2. When used in areas requiring wind-borne debris protection this product is required to be protected with an impact resistant covering that complies with Section R301.2.1.2 of the IRC and Section 1609.1.2 of the IBC.
3. Allowable design pressure requirements must be equal to or less than the design pressure rating shown in the design pressure chart, sheet 1 of this drawing.
4. Conditions not covered by this drawing are subject to further engineering analysis.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details (lip lite insert glazing)
3	Slidette panel details (lip lite insert glazing)
4	Horizontal cross sections
5	Vertical cross sections
6	Vertical cross sections
7	Frame anchoring

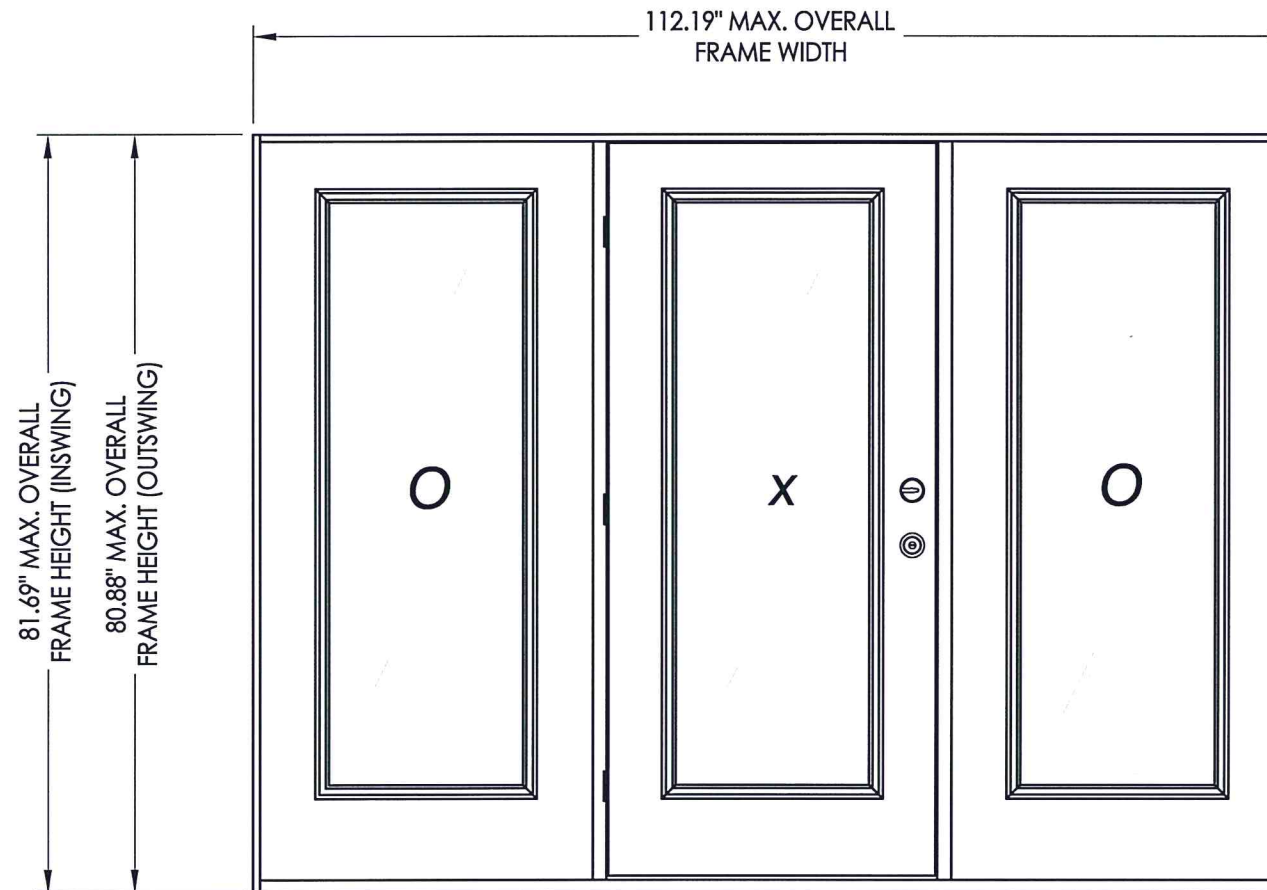

CONFIG.	MODEL	DESIGN PRESSURE (PSF)	
		POSITIVE	NEGATIVE
OXO	INSWING	+50.0	-50.0
	OUTSWING	+45.0	-45.0



Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL, 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT: ENDURA

PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

NO.	DATE	BY	REVISIONS
2	11/01/16	LFS	ADDED THRESHOLDS/REVISE D.P.
1	1/09/14	LFS	ADDED ARTICULATING SILL

DATE: 8/20/12


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: TX-4226

SHEET 1 OF 7


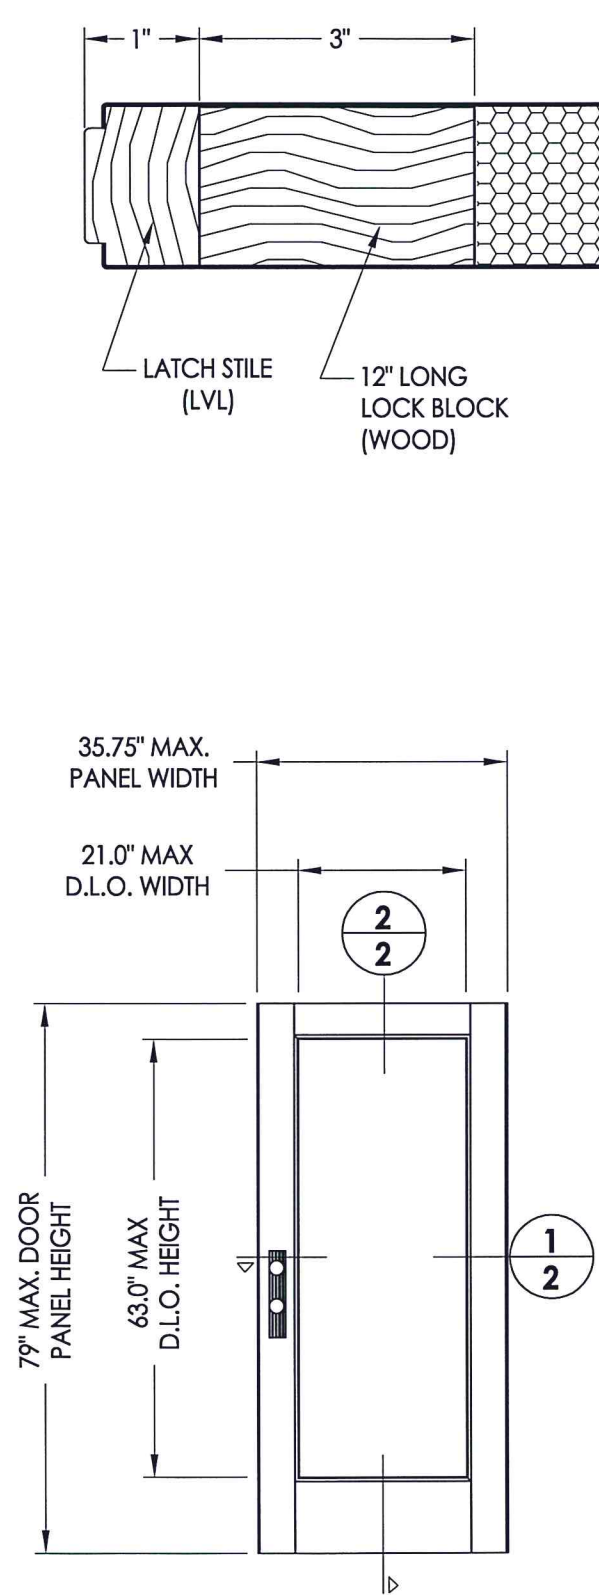


1
2 HORIZONTAL CROSS SECTION

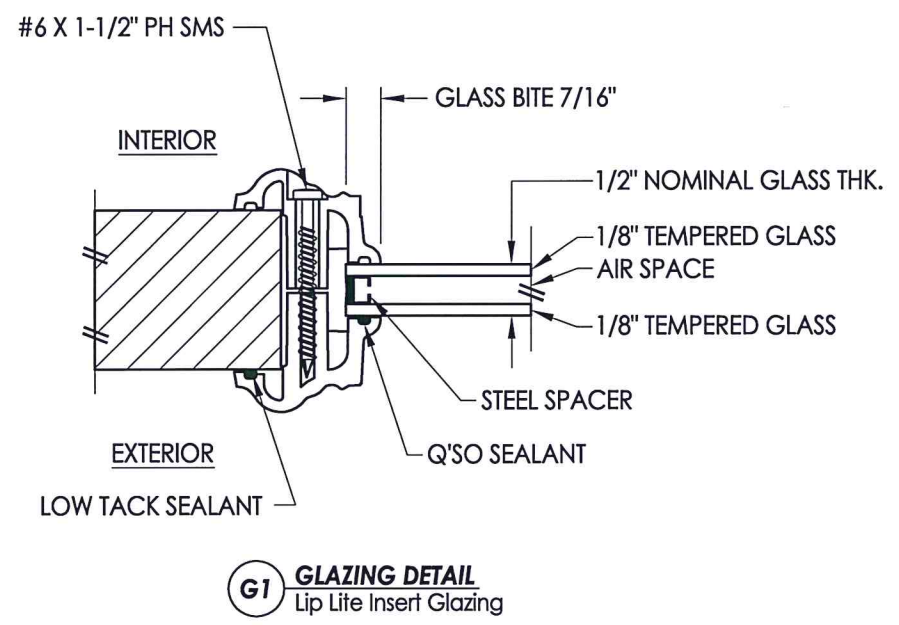


G1 GLAZING DETAIL
Lip Lite Insert Glazing

JELD-WEN
Insert Glazed
(steel)

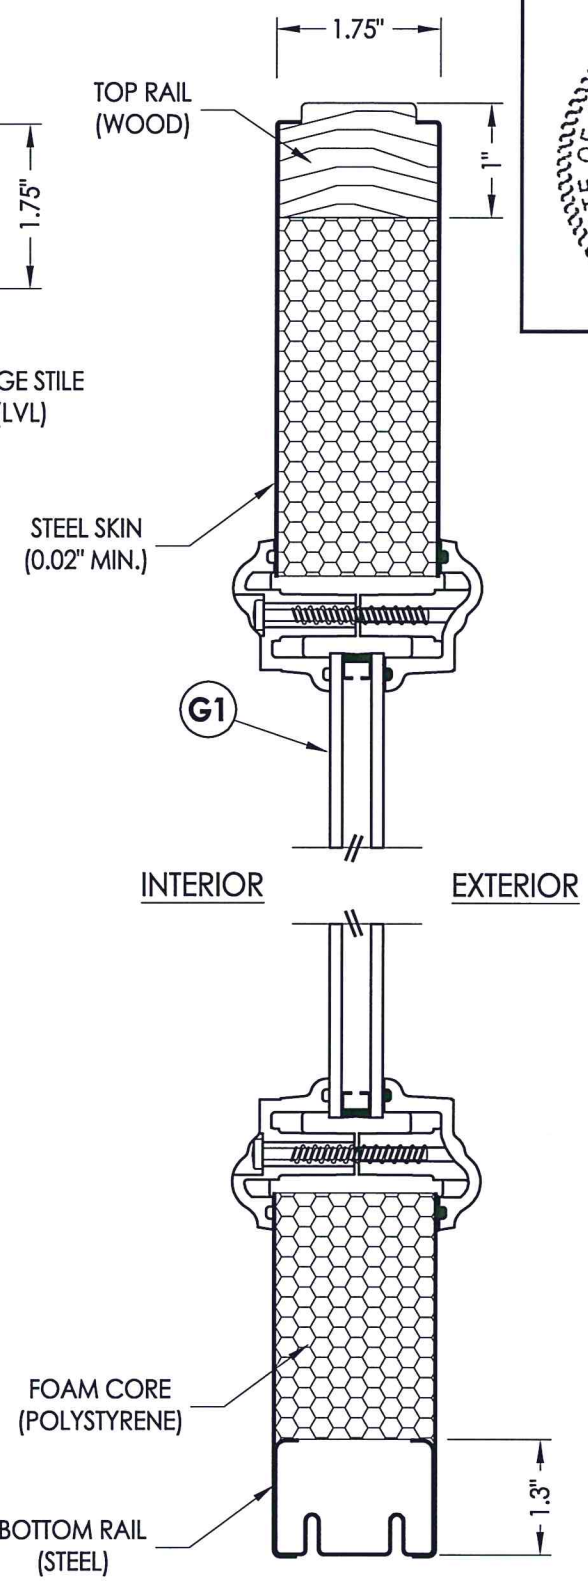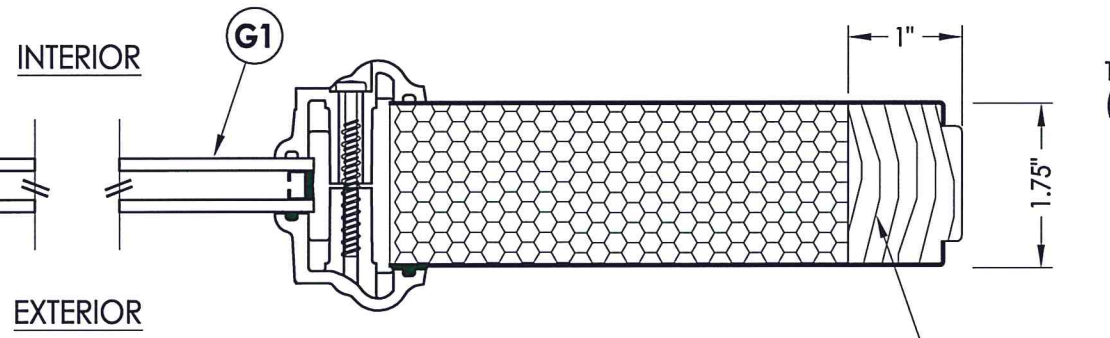

2
2 VERTICAL CROSS SECTION

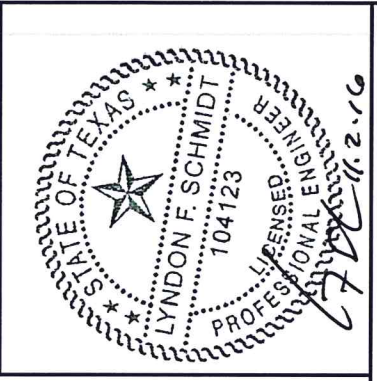


Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123


RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL, 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT:	ENDURA	
PART OR ASSEMBLY:	DOOR PANEL DETAILS (LIP LITE INSERT GLAZING)	
NO.	DATE	BY
2	11/01/16	LFS
1	1/09/14	LFS
REVISIONS		
DATE:	8/20/12	
SCALE:	N.T.S.	
DWG. BY:	JK	
CHK. BY:	LFS	
DRAWING NO.:	TX-4226	
SHEET	2	OF 7


R:\Clients\Endura PERMANENT\B - Texas Dept of Ins\TDI - 630 (Exp. 11-1-18)\C - Drawings\Current\TX-4224-27.dwg, 3.3

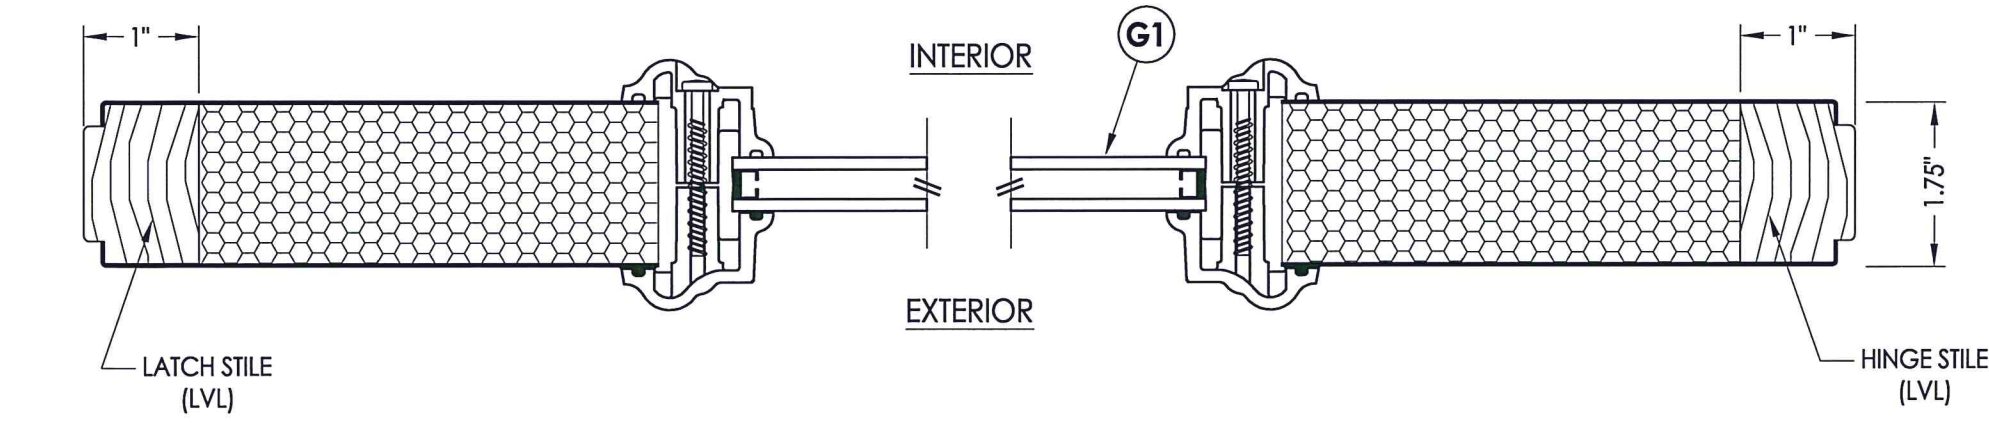


1
3 HORIZONTAL CROSS SECTION

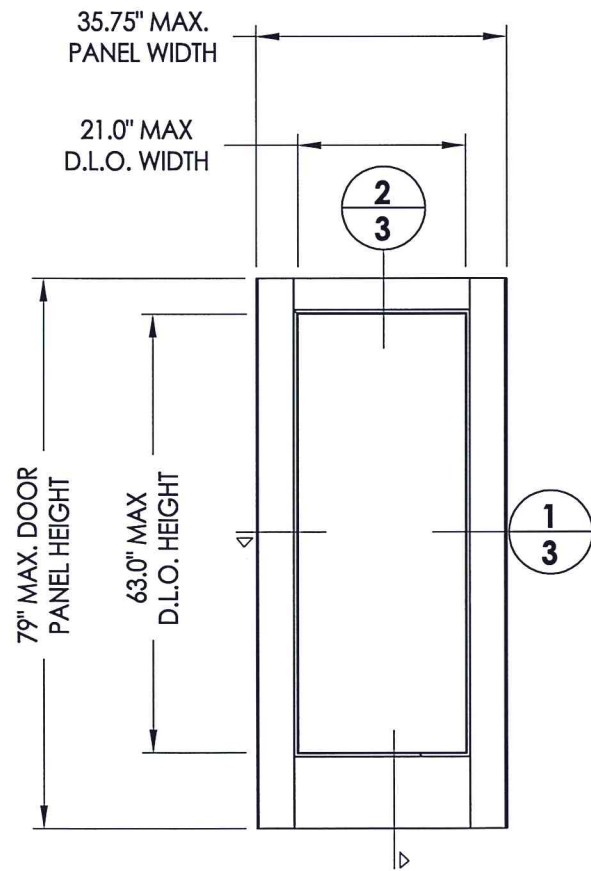


JELD-WEN
Insert Glazed
(steel)

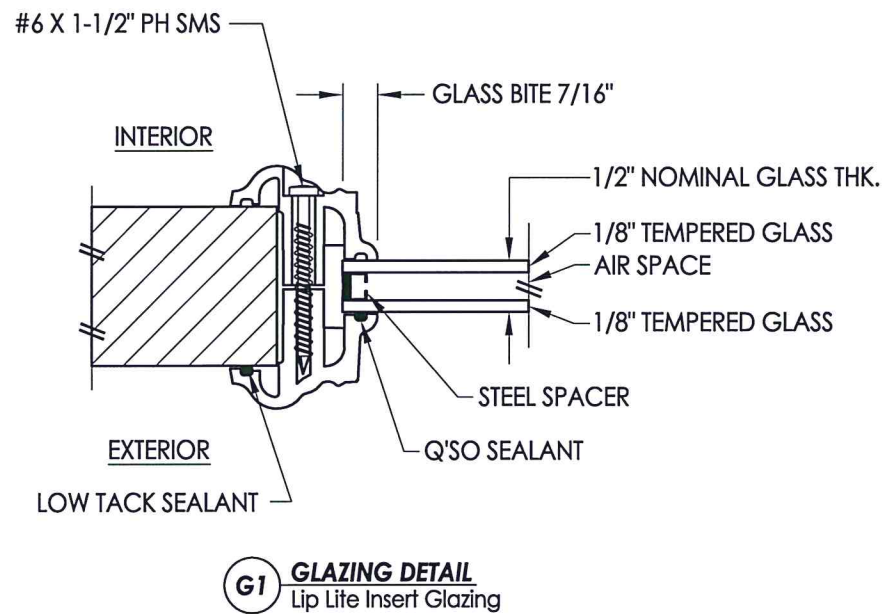

G1 GLAZING DETAIL
Lip Lite Insert Glazing

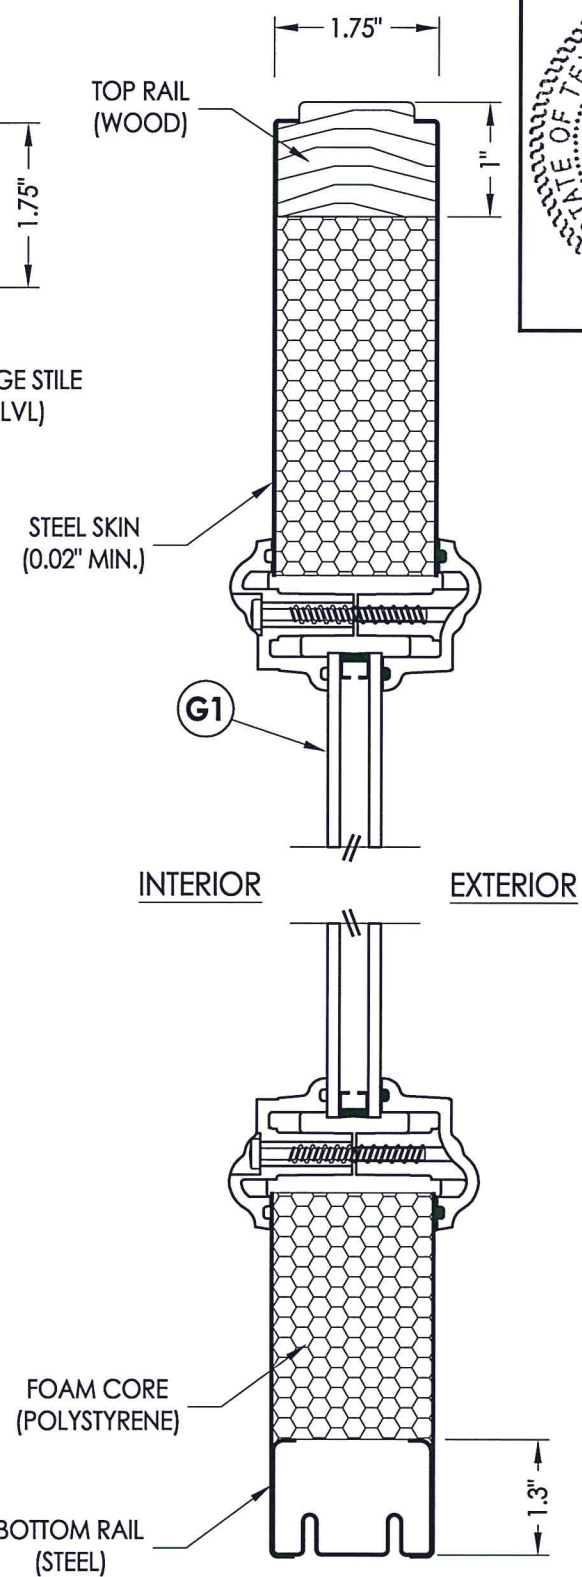



2
3 VERTICAL CROSS SECTION

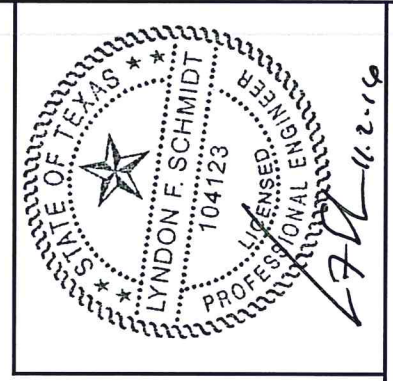



Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852


PRODUCT:	ENDURA	
PART OR ASSEMBLY:	SIDELITE PANEL DETAILS (LIP LITE INSERT GLAZING)	
NO.	DATE	BY
2	11/01/16	LFS
1	1/09/14	LFS
REVISIONS		
DATE:	8/20/12	
SCALE:	N.T.S.	
DWG. BY:	JK	
CHK. BY:	LFS	
DRAWING NO.:	TX-4226	
SHEET	3	OF 7

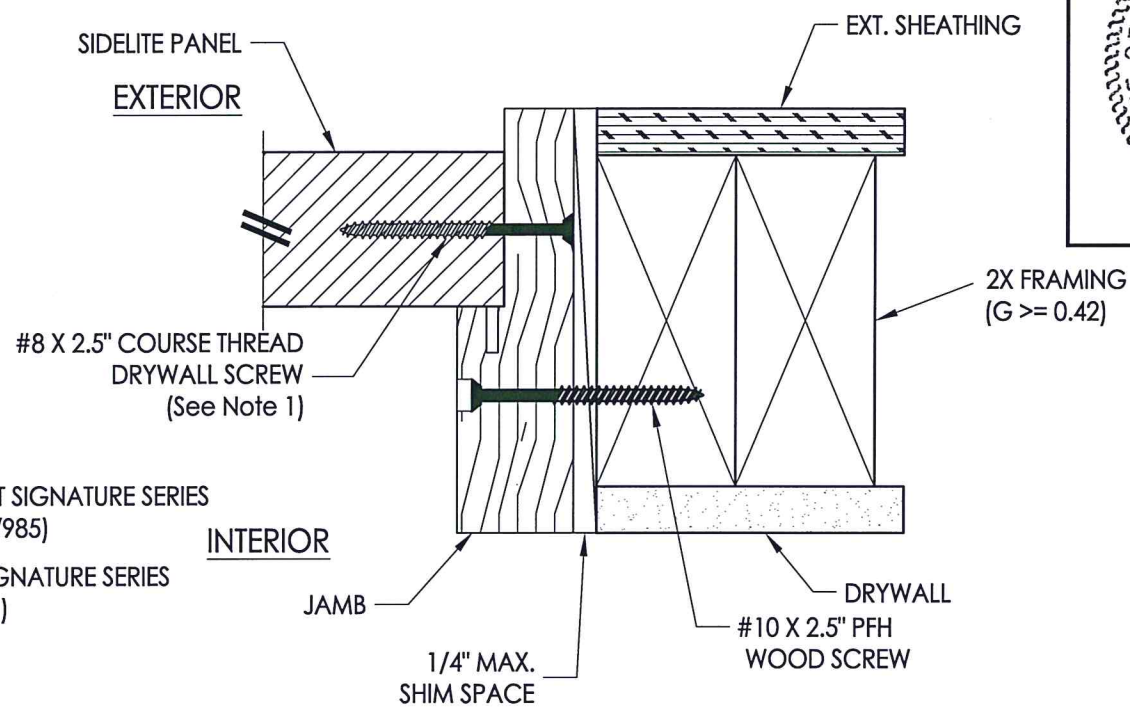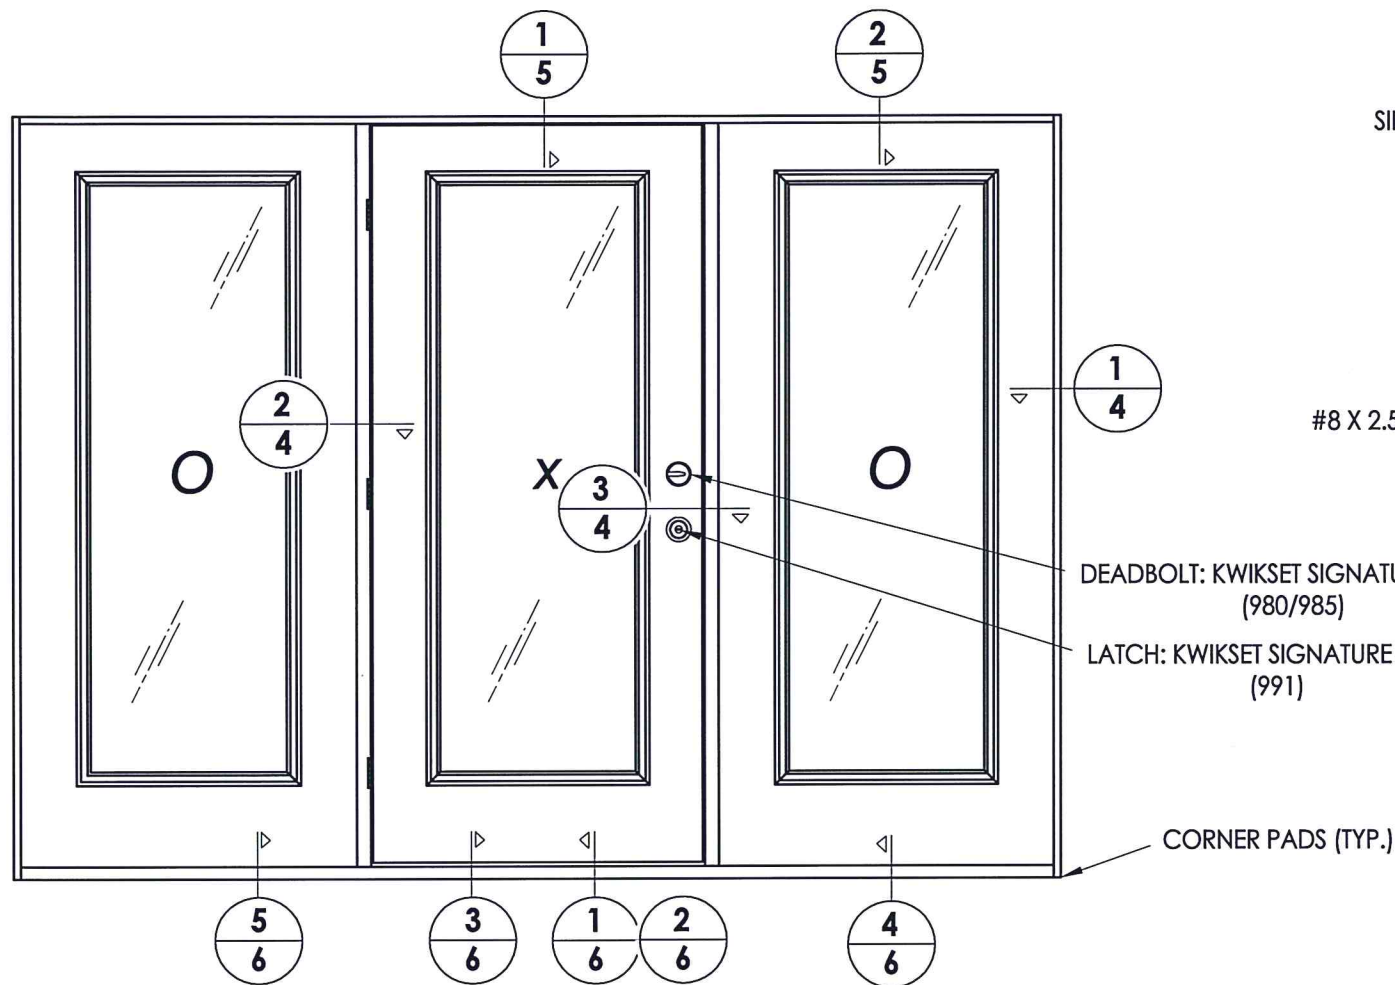

1 HORIZONTAL CROSS SECTION
4 Outswing shown - Inswing also approved

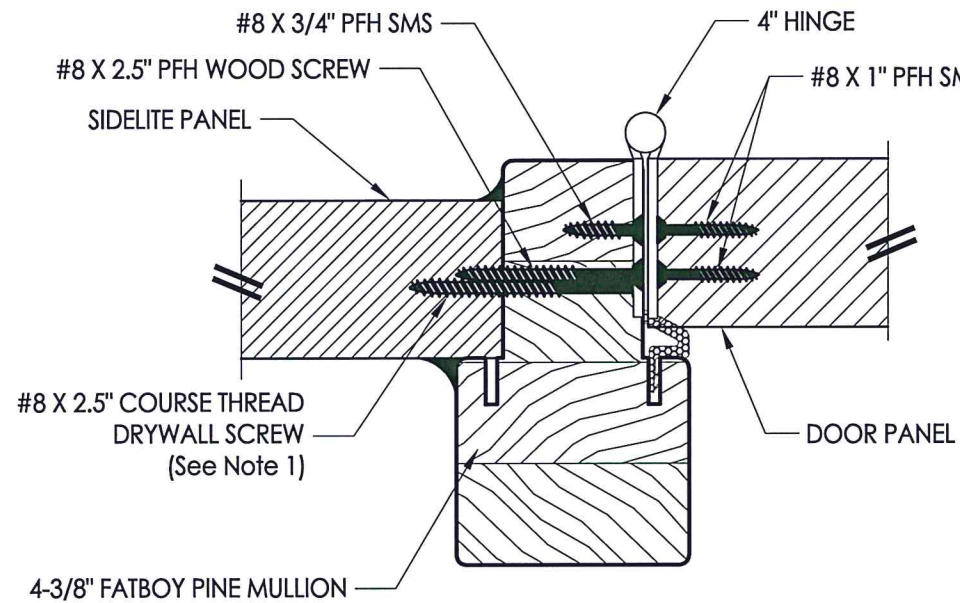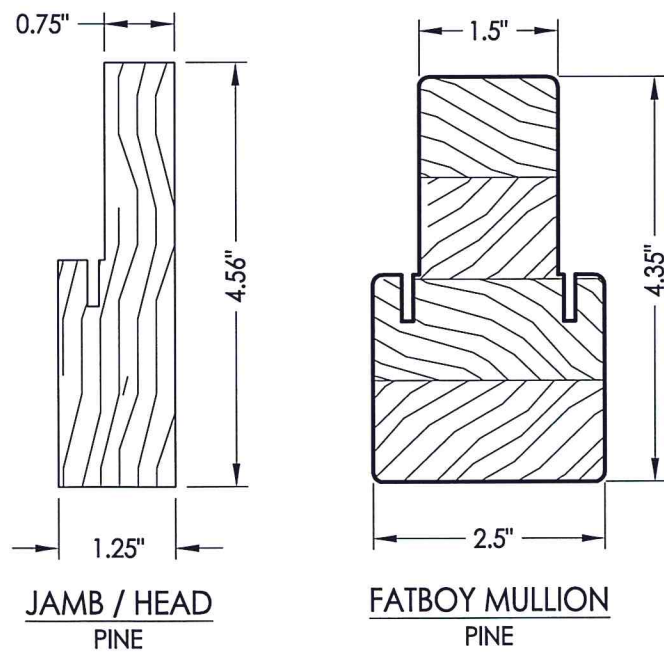


2 HORIZONTAL CROSS SECTION
4 Outswing shown - Inswing also approved

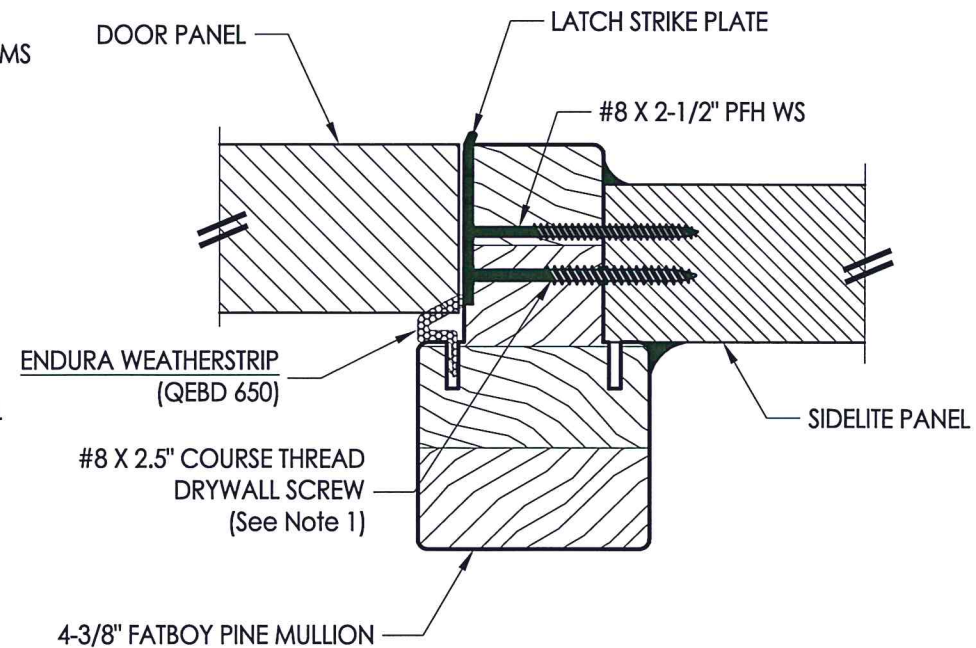

3 HORIZONTAL CROSS SECTION
4 Outswing shown - Inswing also approved

NOTE:
 1. Spacing for sidelite screws: 6.5", 38.5" and 69" from head to sill (3 total).

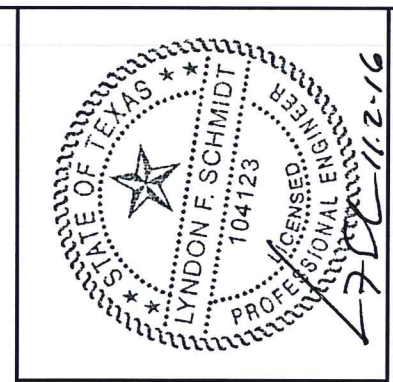


Documents Prepared By: Lyndon F. Schmidt, P.E.
 TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL, 33595
 Phone No.: 813.659.9197
 TEXAS BOARD OF PROFESSIONAL ENGINEERS
 CERTIFICATE OF REGISTRATION # F-11852


PRODUCT:	ENDURA
PART OR ASSEMBLY:	HORIZONTAL CROSS SECTIONS

NO.	DATE	BY	REVISIONS
2	11/01/16	LFS	ADDED THRESHOLDS/REVISE D.P.
1	1/09/14	LFS	ADDED ARTICULATING SILL

DATE: 8/20/12
 SCALE: N.T.S.
 DWG. BY: JK
 CHK. BY: LFS
 DRAWING NO.: TX-4226
 SHEET 4 OF 7

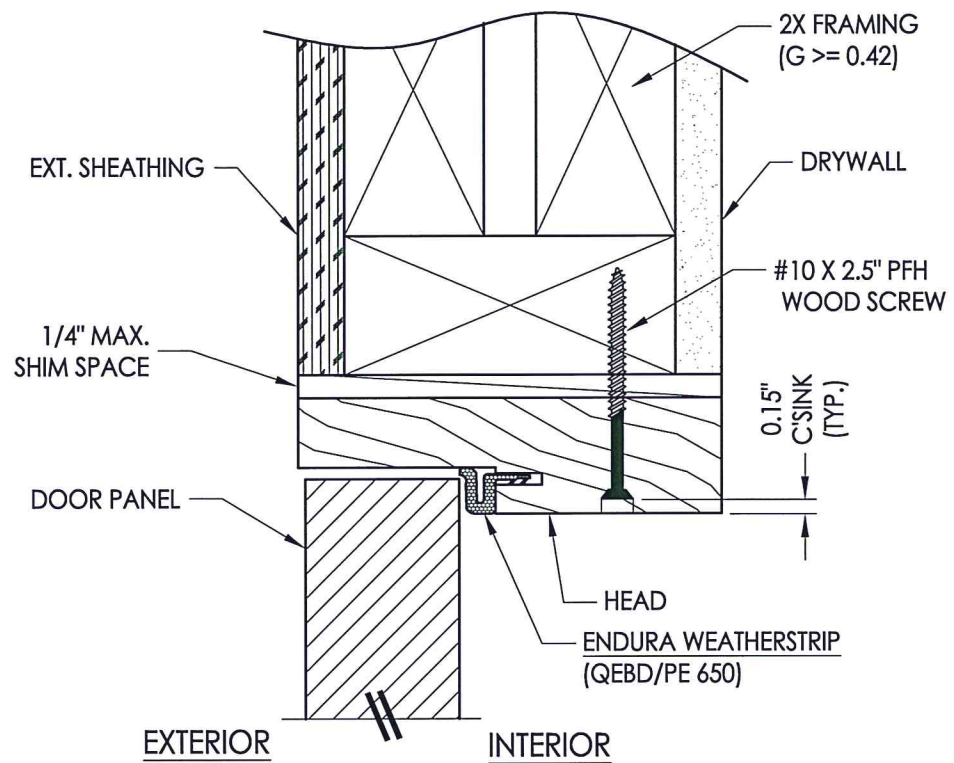


1 **VERTICAL CROSS SECTION**
5 Outwing shown - inswing also approved

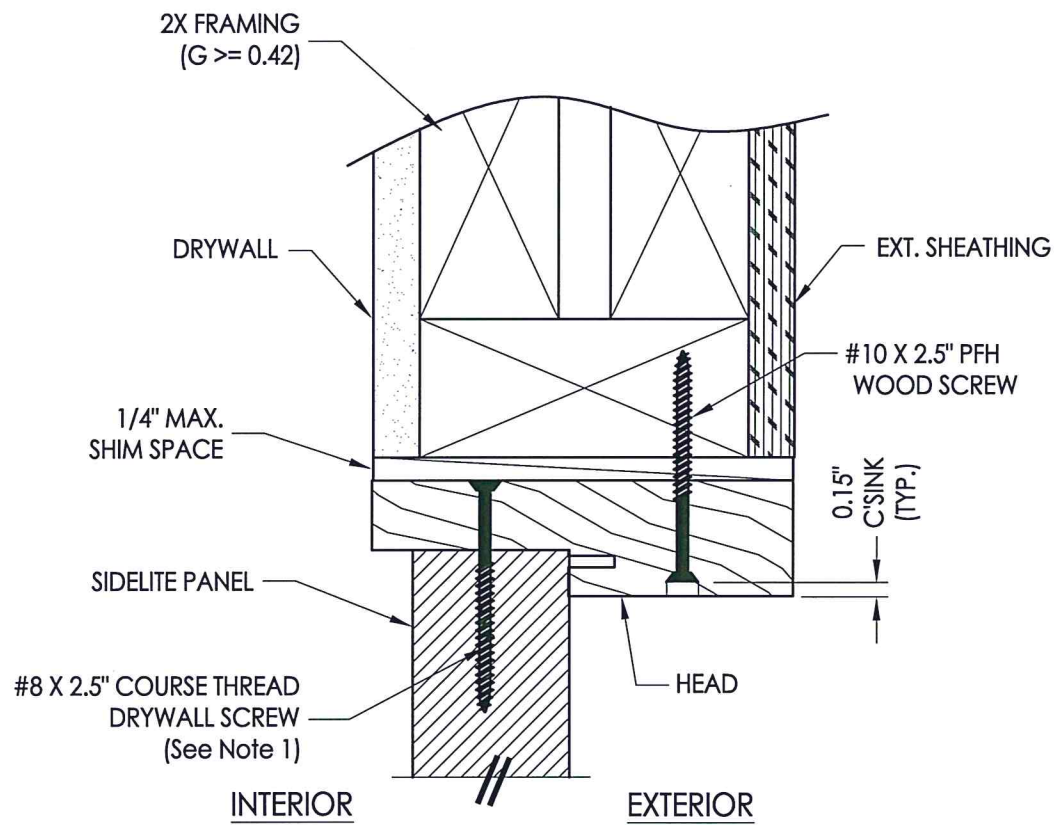

2 **VERTICAL CROSS SECTION**
5 Inswing shown - Outswing also approved

NOTE:
 1. Spacing for sidelite screws:
 6" from each end (2 total).

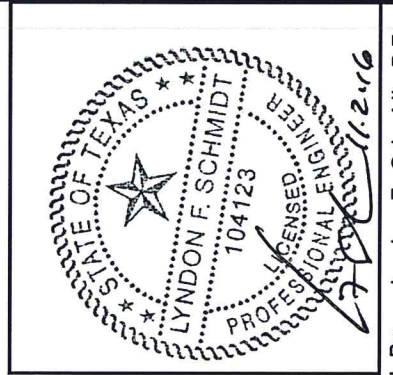


Documents Prepared By: Lyndon F. Schmidt, P.E.
 TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 TEXAS BOARD OF PROFESSIONAL ENGINEERS
 CERTIFICATE OF REGISTRATION # F-11852


PRODUCT:	ENDURA	
PART OR ASSEMBLY:	VERTICAL CROSS SECTIONS	
NO.	DATE	BY
2	11/01/16	LFS
1	1/09/14	LFS
ADDED THRESHOLDS/REVISE D.P.		
ADDED ARTICULATING SILL		
REVISIONS		

DATE:	8/20/12
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	TX-4226
SHEET	5 OF 7

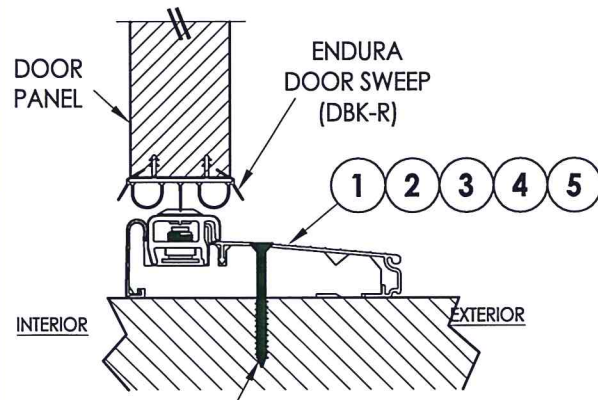


#10 X 2.5\"/>

1 VERTICAL CROSS SECTION
6 Inswing Adjustable Threshold

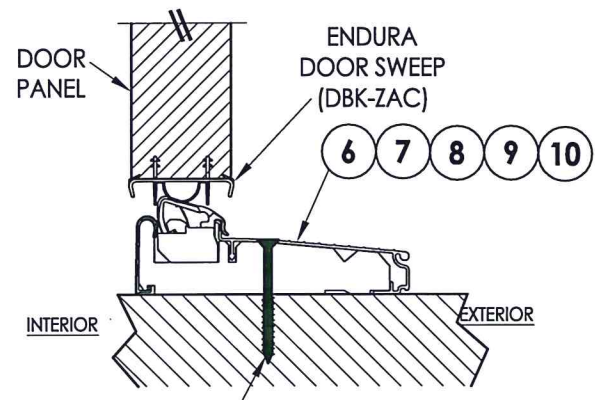


#10 X 2.5\"/>

2 VERTICAL CROSS SECTION
6 Inswing Articulating Threshold

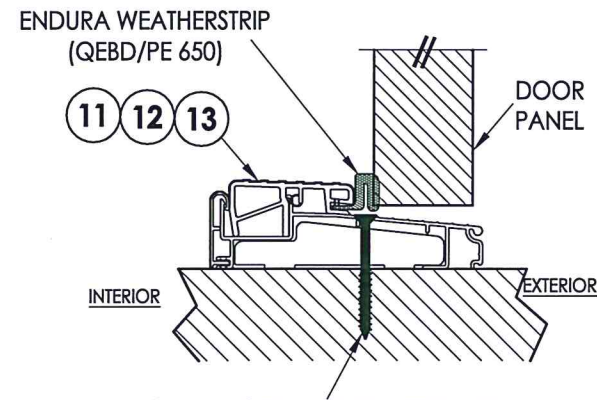

#10 X 2.5\"/>


3 VERTICAL CROSS SECTION
6 Outswing Bump Threshold

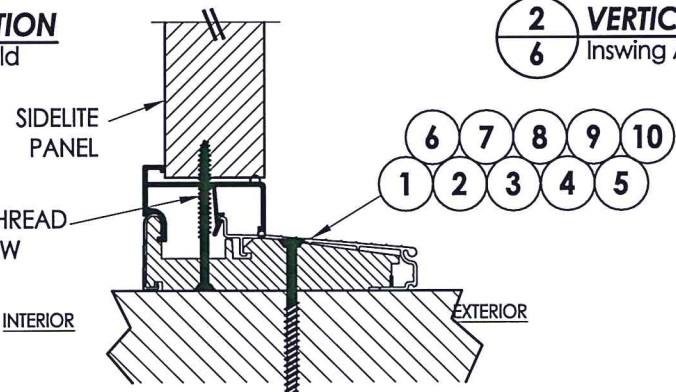

#8 X 2.5\"/>

#10 X 2.5\"/>

4 VERTICAL CROSS SECTION
6 Inswing configuration

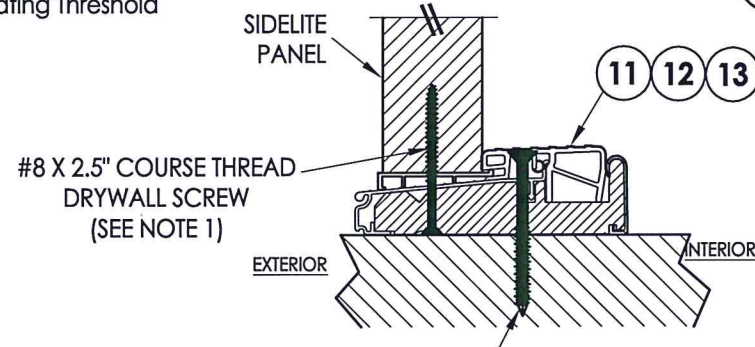


#8 X 2.5\"/>

#10 X 2.5\"/>

5 VERTICAL CROSS SECTION
6 Outswing configuration


NOTE:
1. Spacing for sidelite screws:
6\"/>

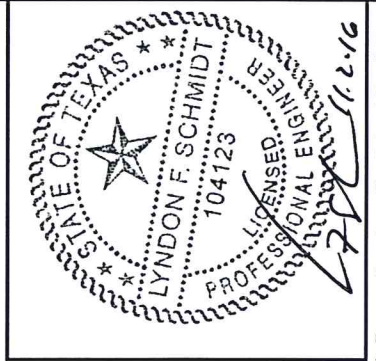


Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Vairico FL 33595
Phone No.: 813.659.9197


TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

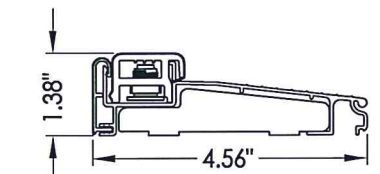


1 INSWING ADJUSTABLE THRESHOLD
ZAI4565

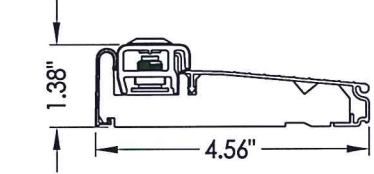


2 INSWING ADJUSTABLE THRESHOLD
ZAI4565FN

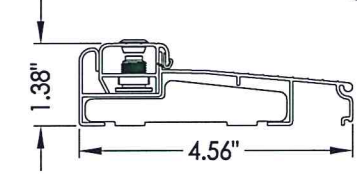


3 INSWING ADJUSTABLE THRESHOLD
ZAILAA4565

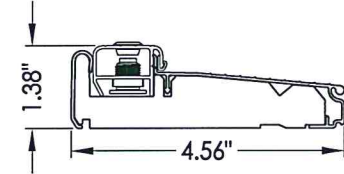


4 INSWING ADJUSTABLE THRESHOLD
ZAIAA4565FN

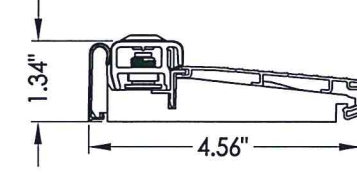


5 INSWING ADJUSTABLE THRESHOLD
ZAI4565RDS

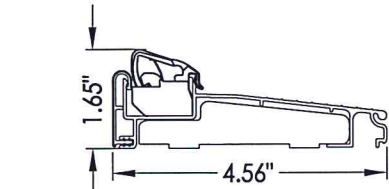


6 INSWING ARTICULATING THRESHOLD
ZACL4565

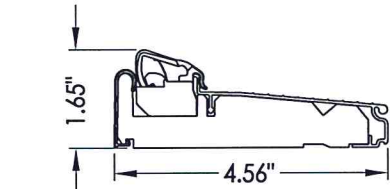


7 INSWING ARTICULATING THRESHOLD
ZAC4565FN

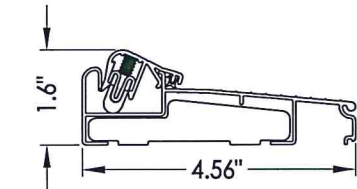


8 INSWING ARTICULATING THRESHOLD
ZACLAA4565

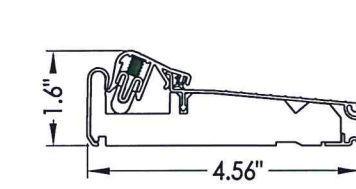


9 INSWING ARTICULATING THRESHOLD
ZACAA4565FN

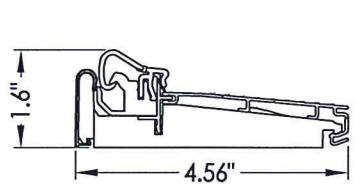


10 INSWING ARTICULATING THRESHOLD
ZAC4565RDS

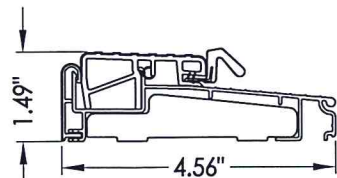

11 OUTSWING THRESHOLD
ZOBL4565

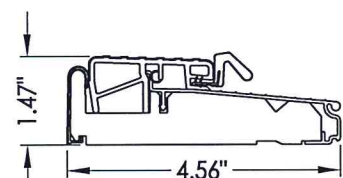

12 OUTSWING THRESHOLD
ZOB4565FN

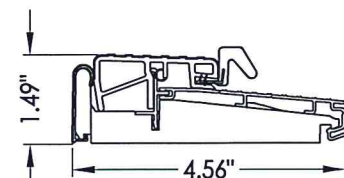

13 OUTSWING THRESHOLD
ZOB4565RDS

PRODUCT: ENDURA
FIBERGLASS DOOR
PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

REVISIONS	
NO.	DATE
2	11/01/16 ADDED THRESHOLDS/REVISE D.P.
1	1/09/14 ADDED ARTICULATING SILL
	BY

DATE: 8/20/12


SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: TX-4226

SHEET 6 OF 7

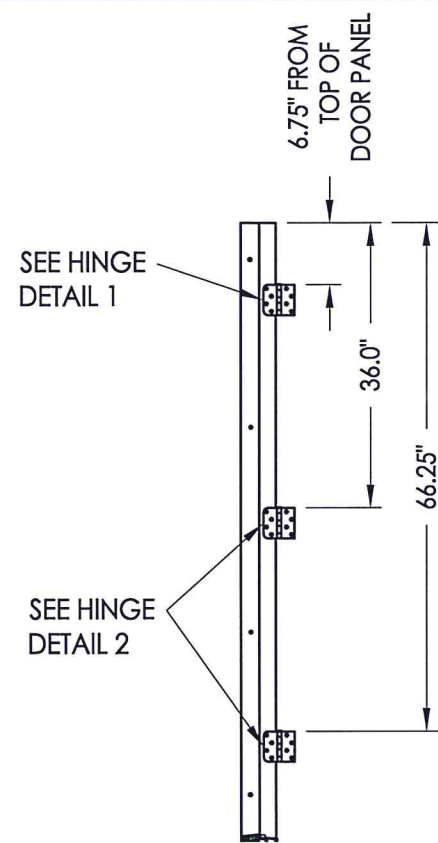


HINGE JAMB


FLOOR SUBSTRATE MATERIAL (TYP.)
CONCRETE (MIN. 3000 PSI)
WOOD (G >= 0.42)

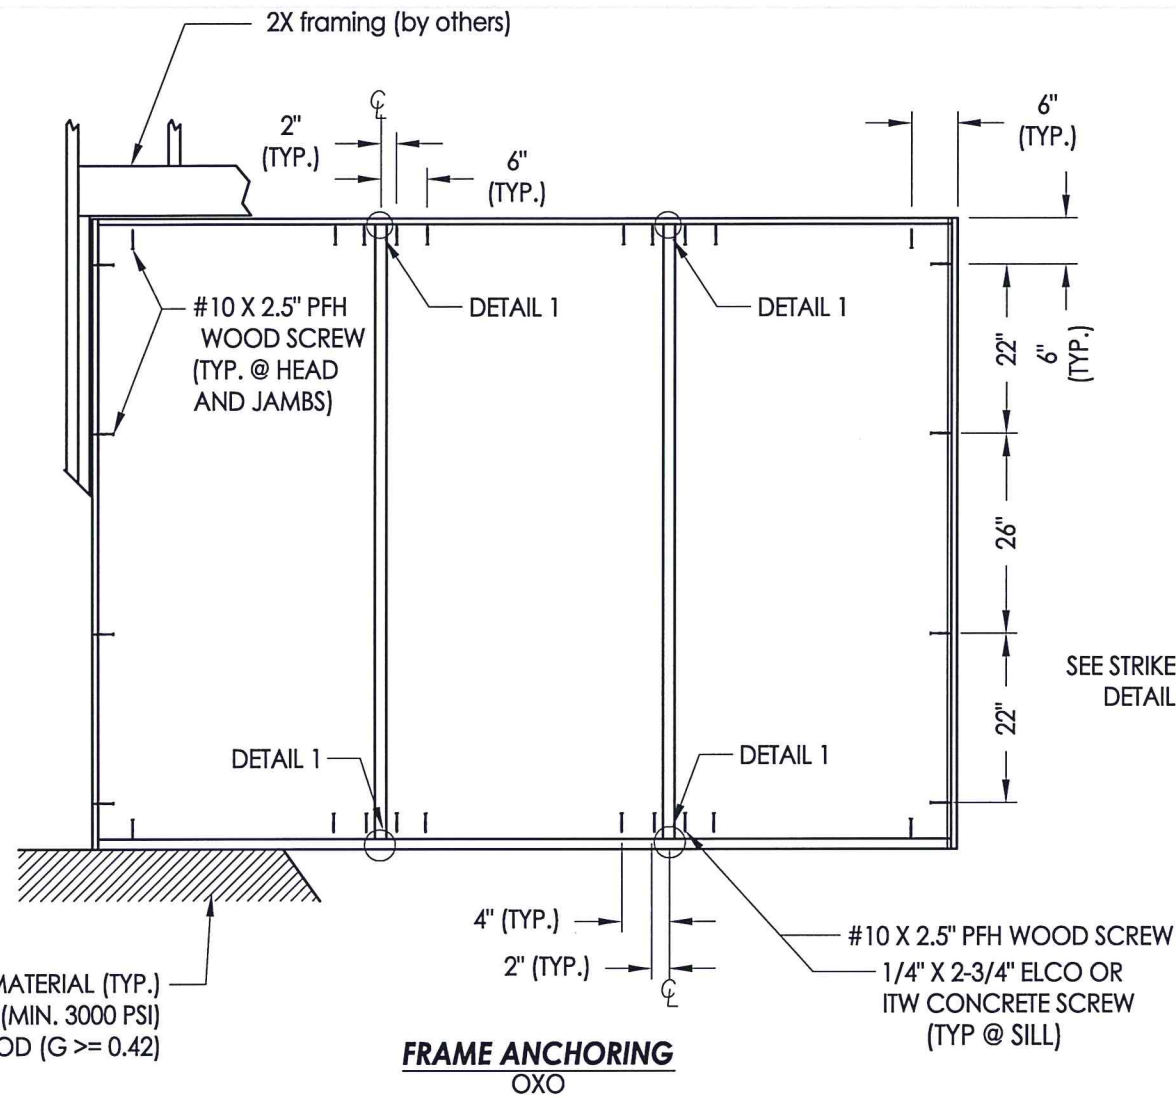


FRAME ANCHORING
OXO

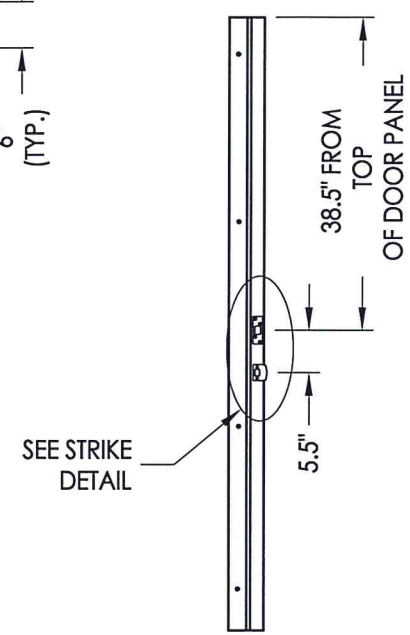


STRIKE JAMB

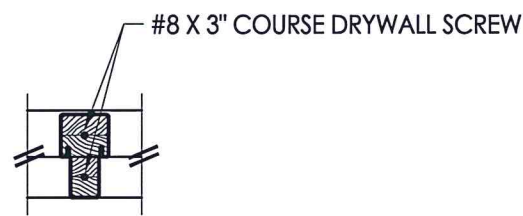


DETAIL 1
Integral mullion attachment

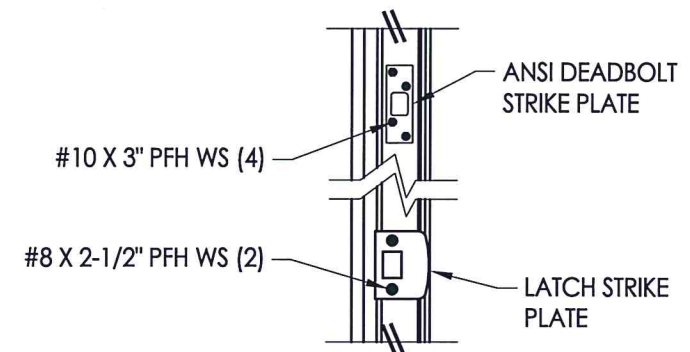

STRIKE DETAIL

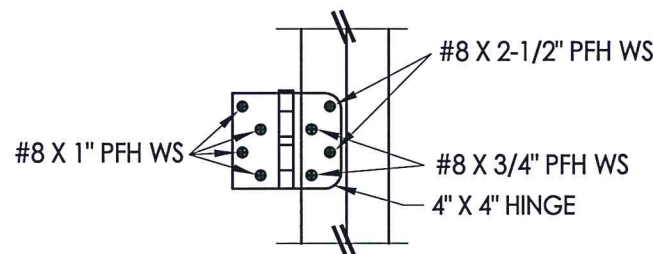

HINGE DETAIL 1

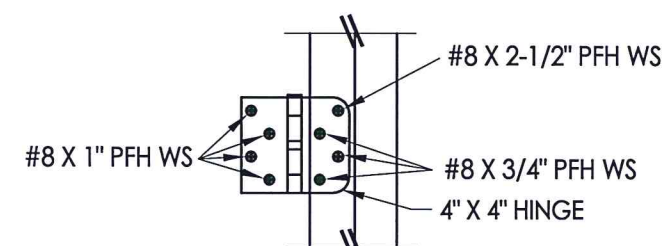

HINGE DETAIL 2

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-3/4"	2-1/2"	3"
ELCO ULTRACON®	1/4"	1-3/4"	1"	3"

Documents Prepared By: Lyndon F. Schmidt, P.E.
TEXAS P.E. #104123

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

TEXAS BOARD OF PROFESSIONAL ENGINEERS
CERTIFICATE OF REGISTRATION # F-11852

PRODUCT:	ENDURA	
PART OR ASSEMBLY:	FRAME ANCHORING	
REVISIONS		
NO.	DATE	BY
2	11/01/16	LFS
1	1/09/14	LFS
DATE: 8/20/12		
SCALE: N.T.S.		
DWG. BY: JK		
CHK. BY: LFS		
DRAWING NO.: TX-4226		
SHEET 7 OF 7		