



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

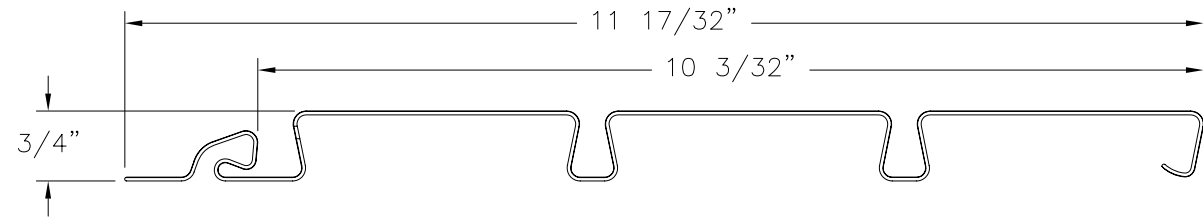

① **PPSS 10" SOFFIT SOLID**  
EXTRUDED PVC .041" THICK

DESIGN PRESSURE RATING	IMPACT RATING
+66.6/-32.2PSF	NONE

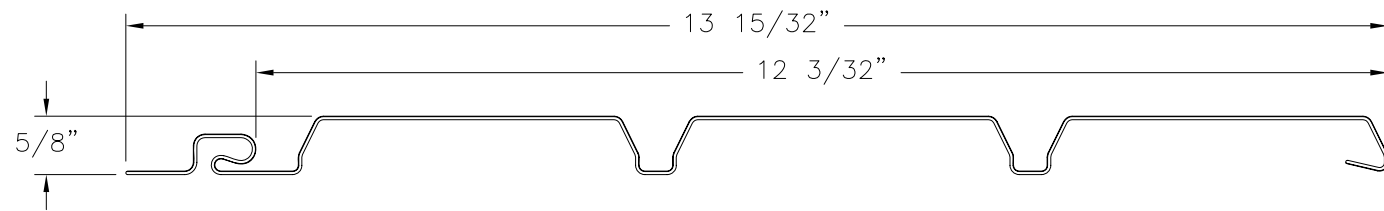

② **T4SS 12" SOFFIT SOLID**  
EXTRUDED PVC .035" THICK

DESIGN PRESSURE RATING	IMPACT RATING
+66.6/-26.6PSF	NONE

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE INTERNATIONAL BUILDING CODE AND INTERNATIONAL RESIDENTIAL CODE WITH STATE OF TEXAS MODIFICATIONS.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
4. SOFFIT MATERIAL: EXTRUDED RIGID PVC.
5. FOR ANCHORING SOFFIT INTO FURRING STRIPS USE ELECTRO-GALVANIZED ROOFING NAILS WITH 1/8" SHANK, 3/8" HEAD AND 3/4" x 1/16" WASHER. NAIL TO BE OF SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
6. ALL FASTENERS TO BE CORROSION RESISTANT.
7. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
  - A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42

SIGNED: 09/30/2012

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	PROFILES AND NOTES
2	INSTALLATION DETAILS AND COMPONENTS

<b>EXTERIOR PORTFOLIO LLC</b> 1441 UNIVERSAL RD COLUMBUS, OH 43207		
<b>SOFFIT</b> EXTRUDED RIGID PVC PROFILES AND NOTES		
DRAWN: V.L.	DWG NO. 08-01783	REV -
SCALE NTS	DATE 09/30/12	SHEET 1 OF 2





Luis R. Lomas P.E.  
TX No.: 101889

PARTS LIST

NO.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	PPSS	10" SOFFIT, SOLID	EXTERIOR PORTFOLIO	EXTRUDED PVC
2	T4SS	12" SOFFIT, SOLID	EXTERIOR PORTFOLIO	EXTRUDED PVC
3	1JNU	J-CHANNEL	EXTERIOR PORTFOLIO	EXTRUDED PVC

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

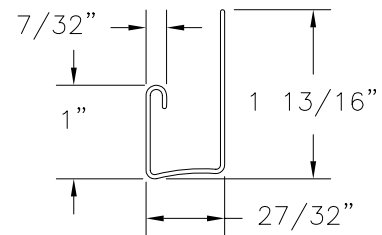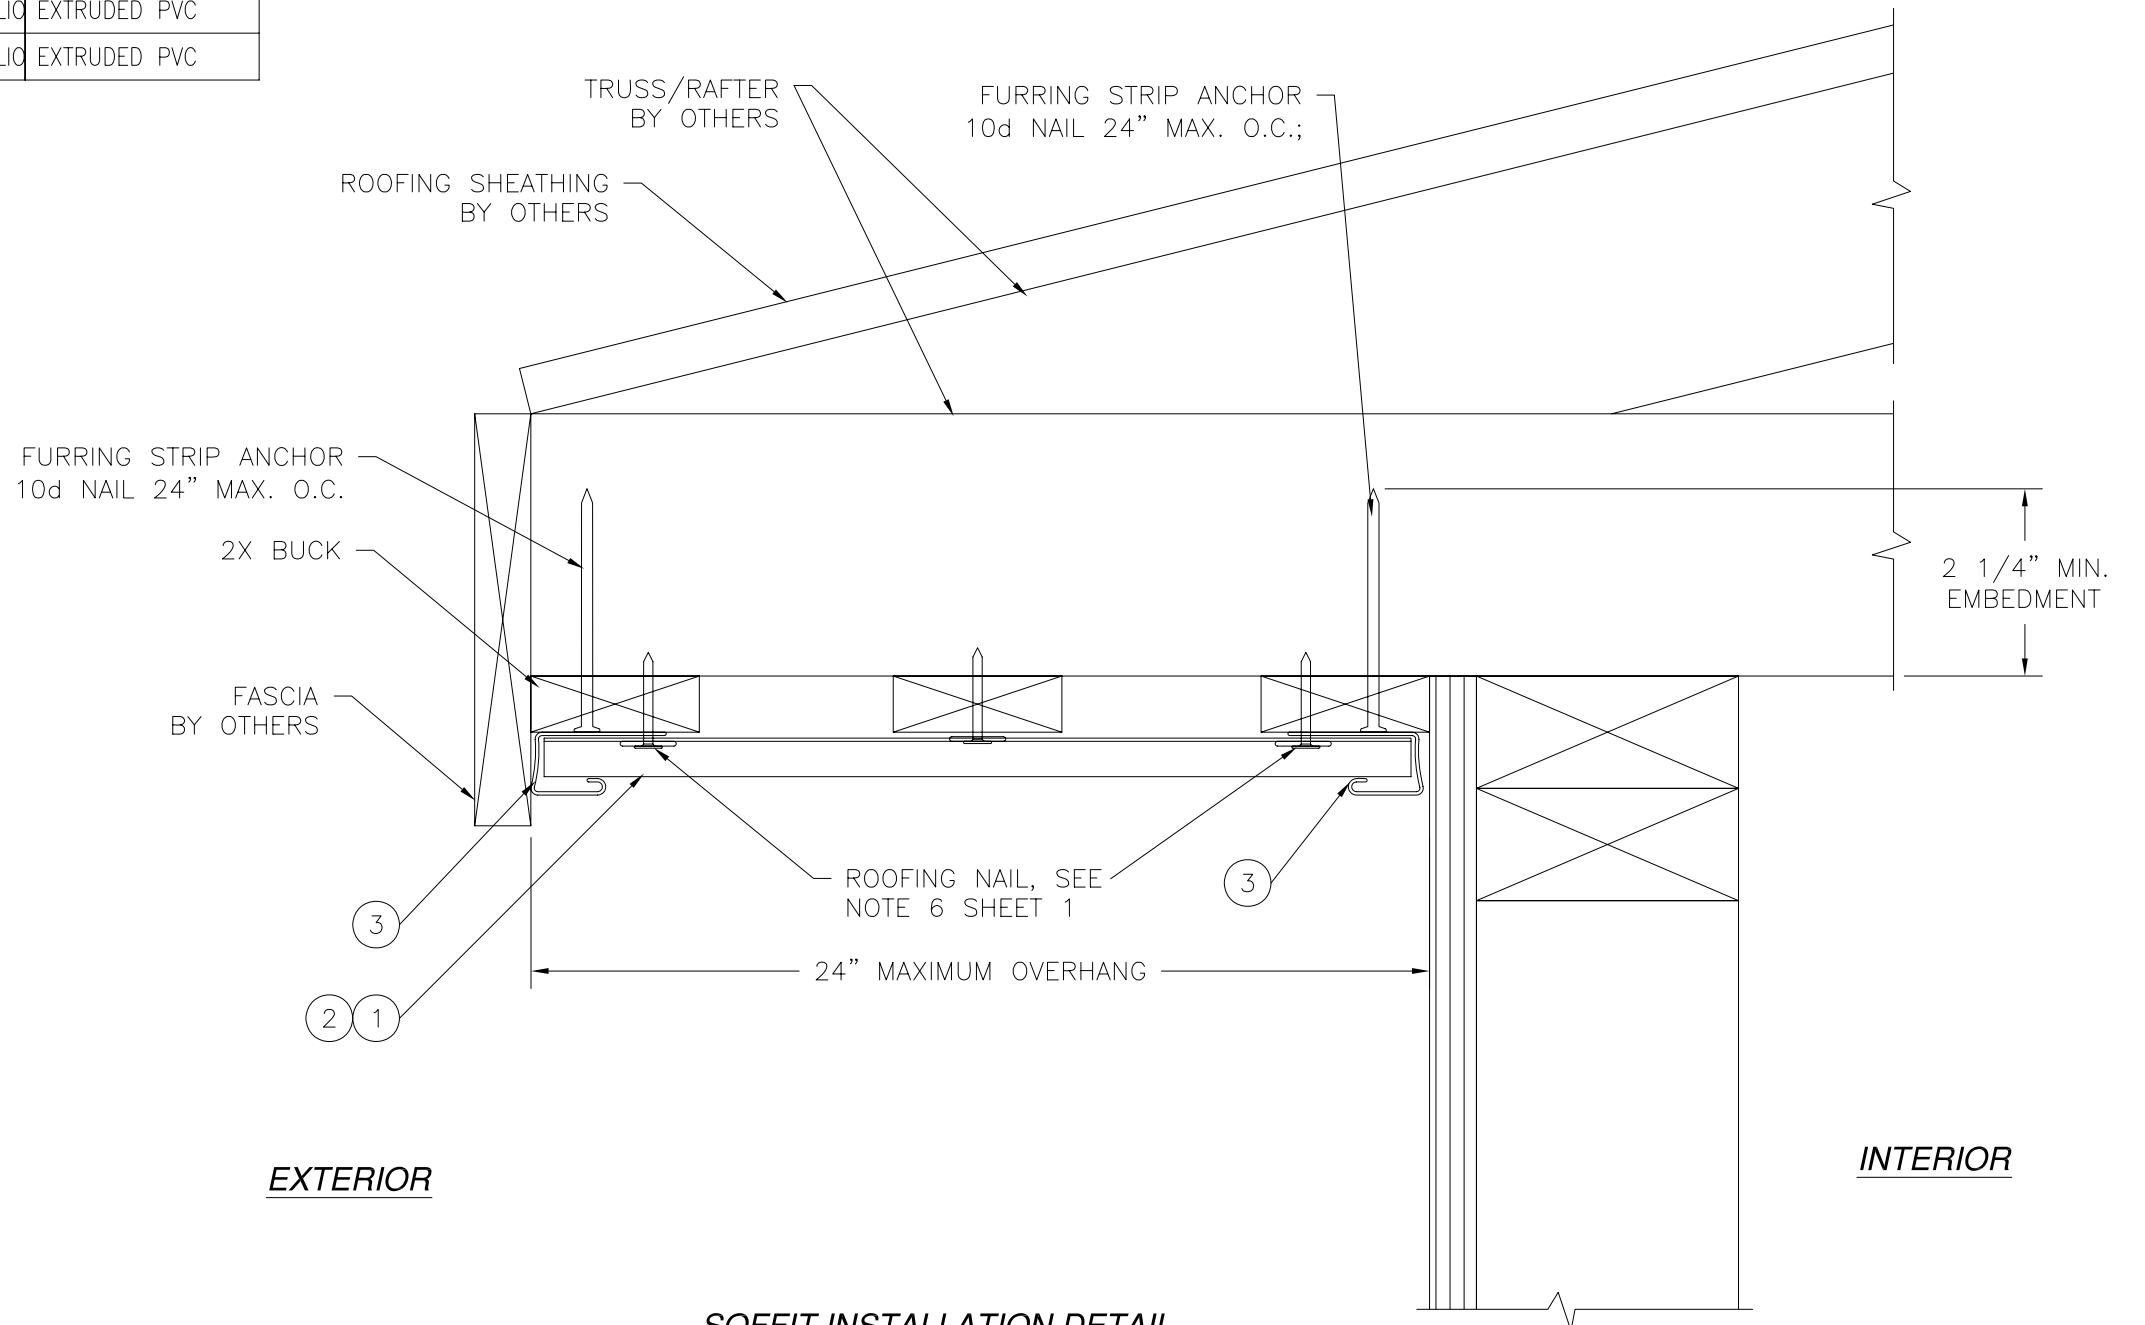

③ 1JNU J-CHANNEL  
EXTRUDED PVC .045" THICK

**SOFFIT INSTALLATION DETAIL**  
2X WOOD FRAMING OR 1X FURRING STRIP

SIGNED: 09/30/2012

EXTERIOR PORTFOLIO LLC 1441 UNIVERSAL RD COLUMBUS, OH 43207		
SOFFIT EXTRUDED RIGID PVC BOM INSTALLATION DETAILS AND COMPONENTS		
DRAWN: V.L.	DWG NO. 08-01783	REV -
SCALE NTS	DATE 09/30/12	SHEET 2 OF 2



Luis R. Lomas P.E.  
TX No.: 101889