

L'TR	REVISION	DATE	BY	E.C.O.
*	ORIGINAL ISSUE	11/20/14	TJE	1616
Α	REVISED AVAILABLE CONFIGURATIONS	04/27/16	TJE	1616
В	REVISED MAXIMUM HEIGHT NOTE	08/10/16	TJE	1616
С	REVISED TITLE BLOCK; HOOD SUPPORT UPDATE; 2018 IBC	03/09/20	MAN	2028

## **GENERAL NOTES:**

 $\frac{3}{6}$ -16 x 1" SAE GR.8

AT 18" ON CENTER

OR EQUIVALENT

(2) 2 x 2 ASTM A36 STEEL

1/8" THICK THRU 21'-5" D.B.G.

3/16" THICK OVER 21'-5" D.B.G.

OR STAINLESS STEEL

**OPTIONS:** 

(3) BOTTOM BAR DETAIL

TYPICAL SECTION

**FULL SCALE** 

WEATHERING (SHOWN) -

OR SENSING EDGE

- 1. THESE PRODUCT EVALUATION DOCUMENTS REPRESENT A ROLL-UP DOOR ASSEMBLY DESIGNED AND TESTED IN ACCORDANCE WITH THE STANDARD BUILDING CODE, THE 2018 INTERNATIONAL BUILDING CODE, AND THE FLORIDA BUILDING CODE.
- 2. THIS ROLL-UP DOOR HAS BEEN TESTED FOR UNIFORM STATIC PRESSURE IN ACCORDANCE WITH THE FBC TEST PROTOCOLS TAS 202.
- 3. A 33% INCREASE IN ALLOWABLE STRESS HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT.
- 4. DETERMINE THE POSITIVE AND NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY.
- 5. THESE PRODUCT EVALUATION DOCUMENTS ARE PREPARED BY THE PRODUCT ENGINEER AND ARE GENERIC. THEY DO NOT INCLUDE INFORMATION PREPARED FOR A SPECIFIC SITE.
- 6. THESE PRODUCT EVALUATION DOCUMENTS ARE NOT VALID FOR PERMIT WITHOUT ORIGINAL SIGNATURE, DATE AND EMBOSSED SEAL ON EACH PERMIT COPY, WHETHER OR NOT A MASTER APPROVAL DOCUMENT IS ON FILE WITH A MUNICIPALITY OR OTHER GOVERNING AGENCY.
- HEX HEAD BOLT AND NUT 7. THESE PRODUCT EVALUATION DOCUMENTS ARE SUITABLE TO BE APPLIED BY THE CONTRACTOR PROVIDED THE CONTRACTOR DOES NOT DEVIATE FROM THE CONDITIONS DETAILED HEREIN AND THE CONTRACTOR VERIFIES THE EXISTING STRUCTURE IS CAPABLE OF SUPPORTING THE SUPERIMPOSED LOADS Vx & Vy ON THE JAMBS OF THE DOOR.
  - 8. ALTERATIONS OR ADDITIONS TO THIS DOCUMENT ARE NOT PERMITTED.
  - 9. WHEN THE SITE CONDITIONS DEVIATE FROM THESE PRODUCT EVALUATION DOCUMENTS, SITE SPECIFIC DOCUMENTS SHALL BE PREPARED BY A DULY LICENSED AND REGISTERED ENGINEER OR ARCHITECT.
  - 10. IF THE DEVIATING SITE SPECIFIC DOCUMENTS ARE PREPARED BY A DELEGATED REGISTERED ENGINEER OR ARCHITECT, SAID DOCUMENTS SHALL BEAR THE DATE, SIGNATURE, AND EMBOSSED SEAL OF THE DELEGATED ENGINEER OR ARCHITECT AND SHALL BE SUBMITTED TO THE PROJECT ENGINEER FOR REVIEW.
  - 11. ALL BOLTS AND WASHERS SHALL BE GALVANIZED STEEL, PLATED STEEL, OR STAINLESS STEEL
  - 12. ALL WINDLOCK RIVETS SHALL BE 1/4" STEEL RIVETS IFI GRADE 30 WITH A MINIMUM TENSILE STRENGTH OF 1,850 Lbs., AND SHEAR STRENGTH OF 2,400 Lbs., U.O.N.. RIVETS TO BE INSTALLED IN ALL WINDLOCK HOLES.
  - 13. ENDLOCKS/WINDLOCKS SHALL BE CAST MALLEABLE IRON TYPE 32510 PER ASTM A47 OR CAST DUCTILE IRON PER ASTM A536 GRADE 65-45-12.
  - 14. ALL WELDING SHALL BE PERFORMED BY QUALIFIED WELDERS IN ACCORDANCE WITH A.W.S. SPECIFICATIONS, LATEST EDITION. ALL WELDING ELECTRODES SHALL CONFORM TO A.W.S. A5.1 GRADE E-70. MINIMUM WELDING PROCESSES SHALL BE ARC WELDING A.W.S. E7014 OR MIG WELDING A.W.S. ER70S-6.

## 15. ANCHOR NOTES:

- A. EMBEDMENT LENGTH DOES NOT INCLUDE STUCCO FINISH
- B. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS
- C. ANCHOR CAPACITY FOR THIS ROLL-UP DOOR IS BASED ON MIN. 3,000 P.S.I. CONCRETE EXCEPT WHERE NOTED..
- D. FOR MINIMUM EMBEDMENT AND MINIMUM EDGE DISTANCE, REFER TO TABLES.
- 16. DOOR MAY BE INSTALLED ON THE INSIDE OR OUTSIDE OF AN EXTERIOR WALL

17. ALL SHAPES USED FOR GUIDE ASSEMBLIES MUST CONFORM TO ASTM A36 FOR STEEL OR ASTM A276 FOR TYPES 304 OR 316 WITH A MINIMUM 36 KSI YIELD STRENGTH



24 ELMWOOD AVE 1901 S, LITCHFIELD RD MOUNTAINTOP, PA GOODYEAR, AZ

dimensions are in inches & tolerances are:

Unless otherwise specified,


0.000 = +/- 0.031


P: 800.390.8590 F: 866.448.6798 E: ADS@COOKSONDOOR.COM


FRACTIONAL = +/- 1/32 ANGLES = +/- 1/2 DEG


WIND LOAD CONFIGURATION INSULATED ROLLING STEEL DOOR CP0001/CP0651 SLAT NON-IMPACT RATED


SIZE: SCALE: SHEET: DRAWN BY: AS NOTED 2/8 TJE DWG NO:

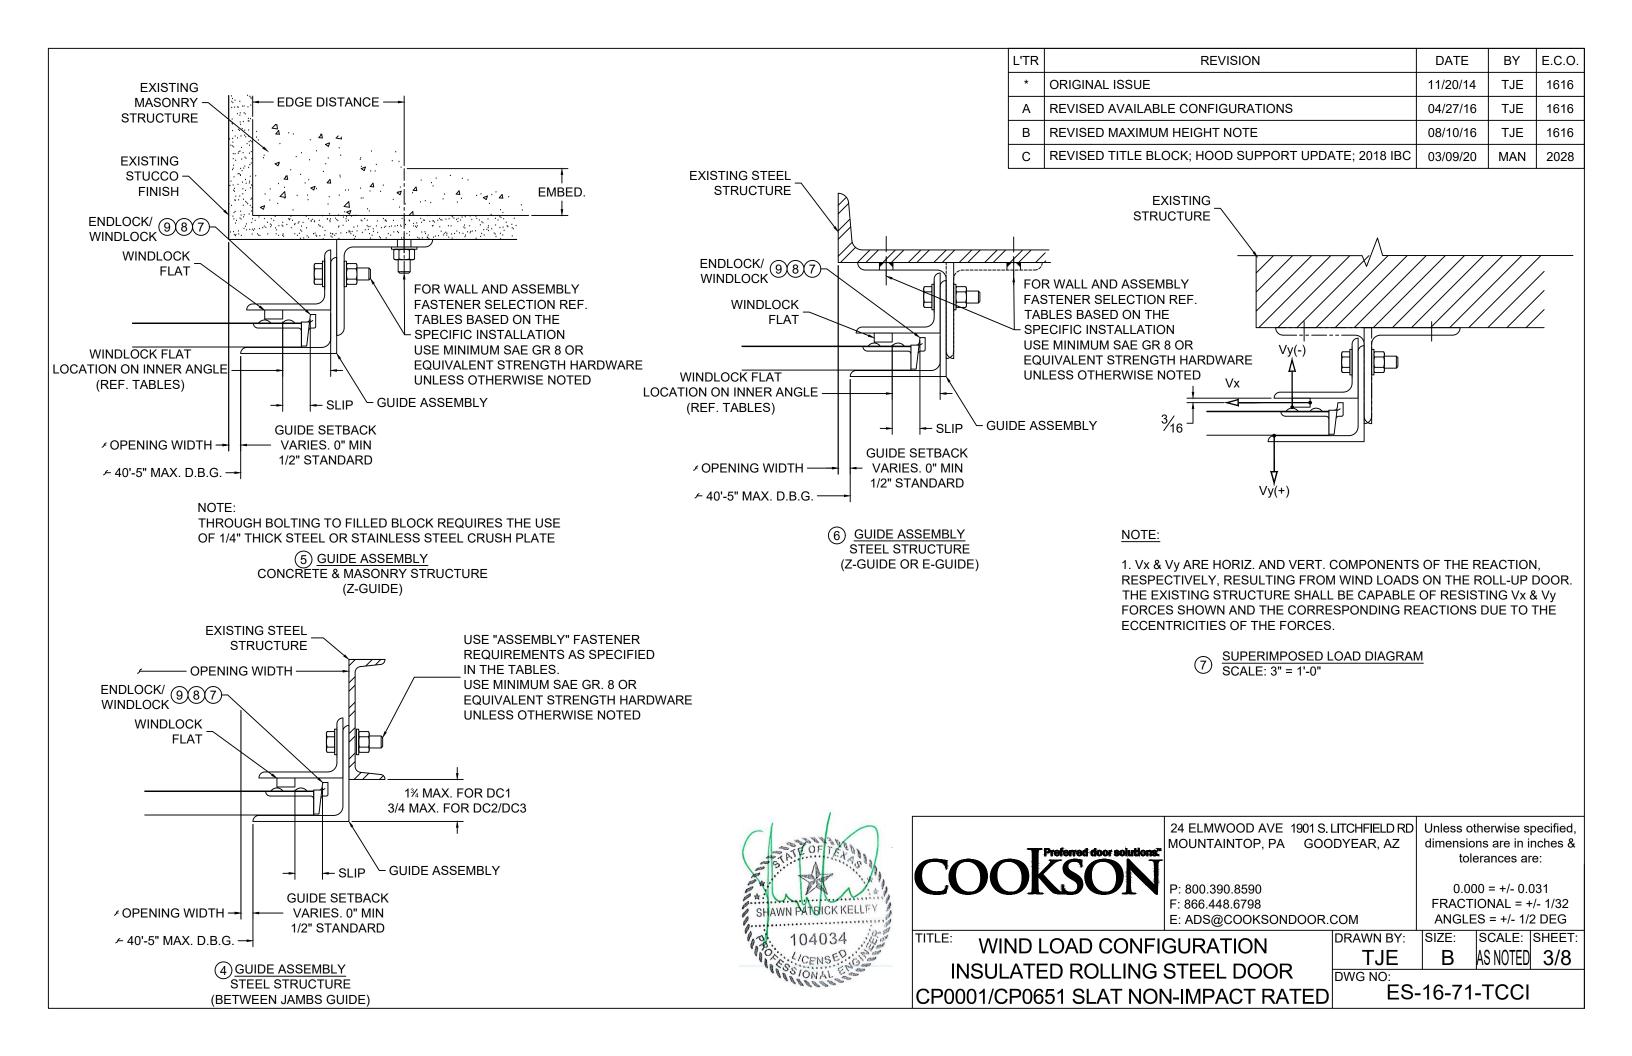


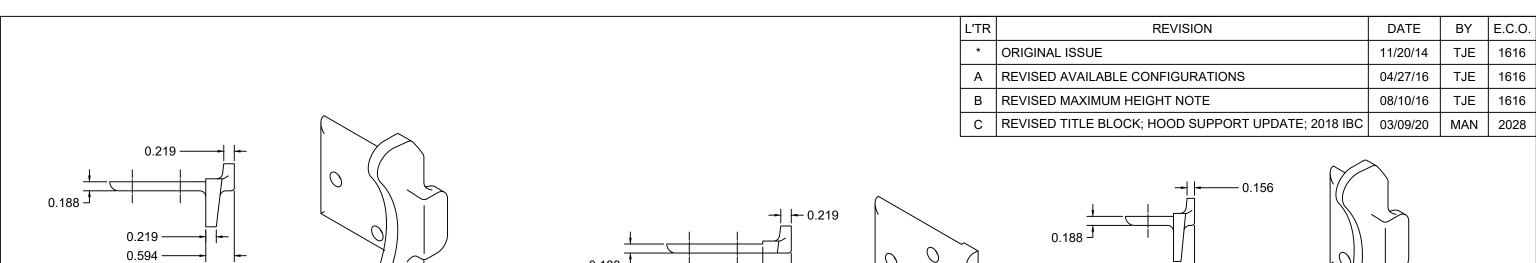


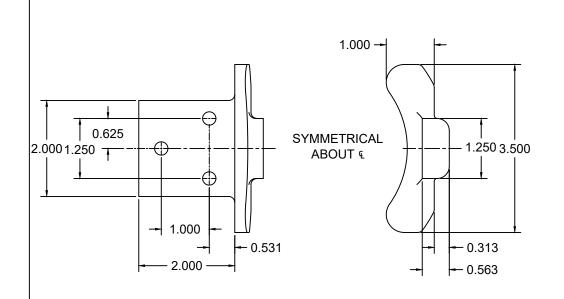


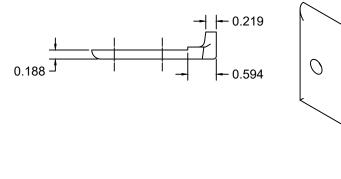





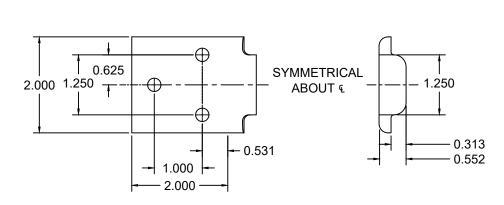

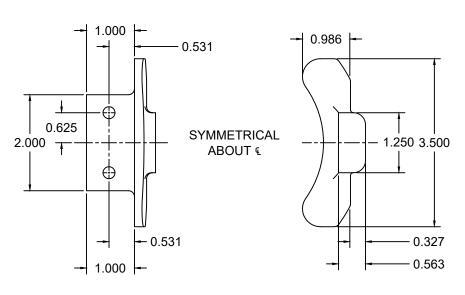

(7) CP0630 ENDLOCK / WINDLOCK DETAIL CAST MALLEABLE IRON ASTM A47, GRADE 32510, OR DUCTILE IRON PER ASTM A536 GRADE 65-45-12, GALVANIZED IN ACCORDANCE WITH ASTM A123, GRADE 85 ZINC-COATING 1/2 SCALE

(8) CP0647 WINDLOCK DETAIL CAST MALLEABLE IRON ASTM A47, GRADE 32510, OR DUCTILE IRON PER ASTM A536 GRADE 65-45-12, GALVANIZED IN ACCORDANCE WITH ASTM A123, GRADE 85 ZINC-COATING 1/2 SCALE

(9) CP0629 ENDLOCK / WINDLOCK DETAIL CAST MALLEABLE IRON ASTM A47, GRADE 32510, OR DUCTILE IRON PER ASTM A536 GRADE 65-45-12, GALVANIZED IN ACCORDANCE WITH ASTM A123, GRADE 85 ZINC-COATING 1/2 SCALE





24 ELMWOOD AVE 1901 S. LITCHFIELD RD MOUNTAINTOP, PA GOODYEAR, AZ

dimensions are in inches & tolerances are:

P: 800.390.8590 F: 866.448.6798 E: ADS@COOKSONDOOR.COM


0.000 = +/- 0.031FRACTIONAL = +/- 1/32 ANGLES = +/- 1/2 DEG

Unless otherwise specified,


WIND LOAD CONFIGURATION **INSULATED ROLLING STEEL DOOR** CP0001/CP0651 SLAT NON-IMPACT RATED

SCALE: SHEET: DRAWN BY: SIZE: TJE AS NOTED 4/8

DWG NO: ES-16-71-TCCI

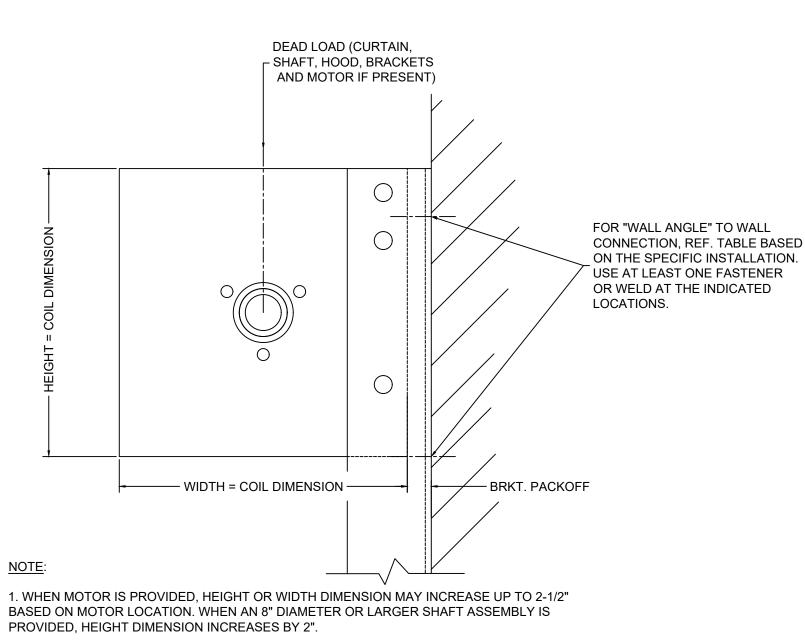

L'TF	REVISION	DATE	BY	E.C.O.
*	ORIGINAL ISSUE	11/20/14	TJE	1616
Α	REVISED AVAILABLE CONFIGURATIONS	04/27/16	TJE	1616
В	REVISED MAXIMUM HEIGHT NOTE	08/10/16	TJE	1616
С	REVISED TITLE BLOCK; HOOD SUPPORT UPDATE; 2018 IBC	03/09/20	MAN	2028

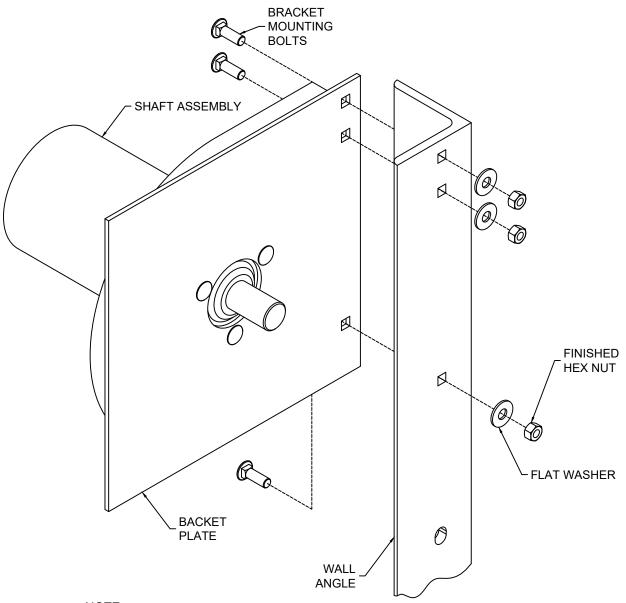

NOTE:

1. STANDARD BRACKET MOUNTING DETAIL IS DEPICTED, OTHER MOUNTINGS ARE AVAILABLE



COOKSON COOKSON

24 ELMWOOD AVE 1901 S. LITCHFIELD RD MOUNTAINTOP, PA GOODYEAR, AZ

PA GOODTEAR, AZ

P: 800.390.8590 F: 866.448.6798 E: ADS@COOKSONDOOR.COM Unless otherwise specified, dimensions are in inches & tolerances are:

0.000 = +/- 0.031 FRACTIONAL = +/- 1/32 ANGLES = +/- 1/2 DEG


SCALE: SHEET:

INSULATED ROLLING STEEL DOOR
CP0001/CP0651 SLAT NON-IMPACT RATED

DRAWN BY: SIZE: B


E B AS NOTED 5/8

DWG NO: FS-16-7

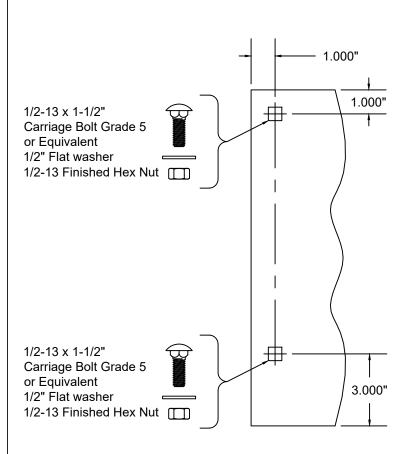



THRU 6"Ø SHAFT ASSEMBLY 14" THRU 16" COIL DIMENSION MIN. THICKNESS 0.172" ASTM A36 OR ASTM A480 STAINLESS STEEL, TYPES 304 OR 316, MINIMUM 36 KSI YIELD STRENGTH SCALE: 1-1/2" = 1'-0"

NOTE:

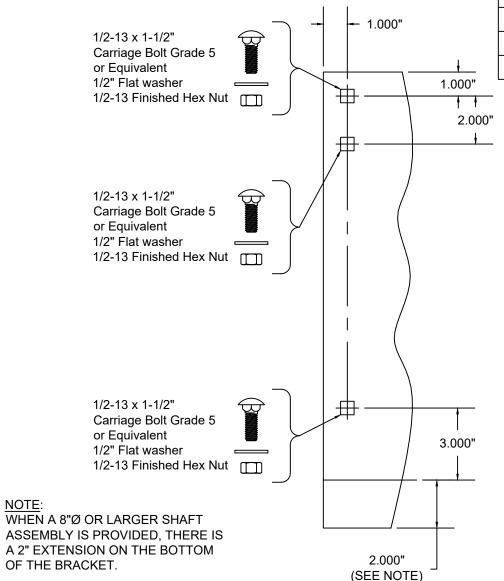

THRU 10"Ø SHAFT ASSEMBLY 17" AND LARGER COIL DIMENSION MIN. THICKNESS 0.240" ASTM A36 OR ASTM A480 STAINLESS STEEL, TYPES 304 OR 316, MINIMUM 36 KSI YIELD STRENGTH SCALE: 1-1/2" = 1'-0"

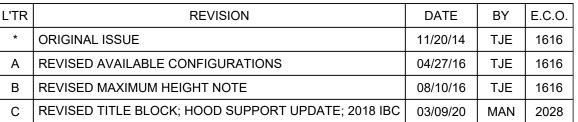

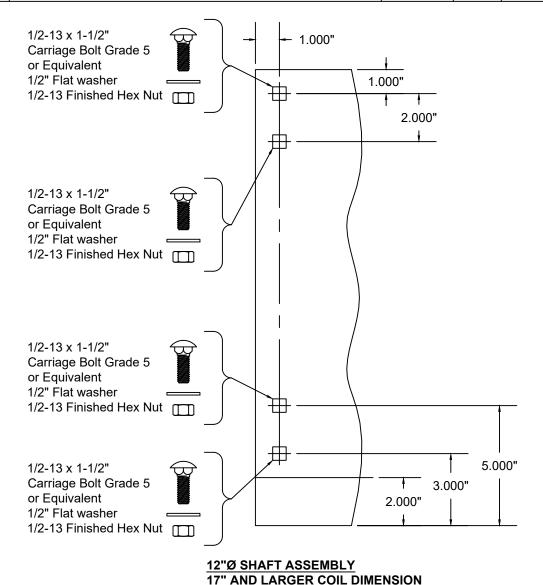



24 ELMWOOD AVE 1901 S, LITCHFIELD RD MOUNTAINTOP, PA GOODYEAR, AZ

SCALE: 1-1/2" = 1'-0"

MIN. THICKNESS 0.240" ASTM A36 **OR ASTM A480 STAINLESS STEEL** 


TYPES 304 OR 316, MINIMUM 36 KSI YIELD STRENGTH

P: 800.390.8590 F: 866.448.6798 E: ADS@COOKSONDOOR.COM Unless otherwise specified, dimensions are in inches & tolerances are:

0.000 = +/- 0.031FRACTIONAL = +/- 1/32 ANGLES = +/- 1/2 DEG

WIND LOAD CONFIGURATION INSULATED ROLLING STEEL DOOR CP0001/CP0651 SLAT NON-IMPACT RATED

DRAWN BY: SIZE: SCALE: SHEET: TJE AS NOTED 6/8 DWG NO:

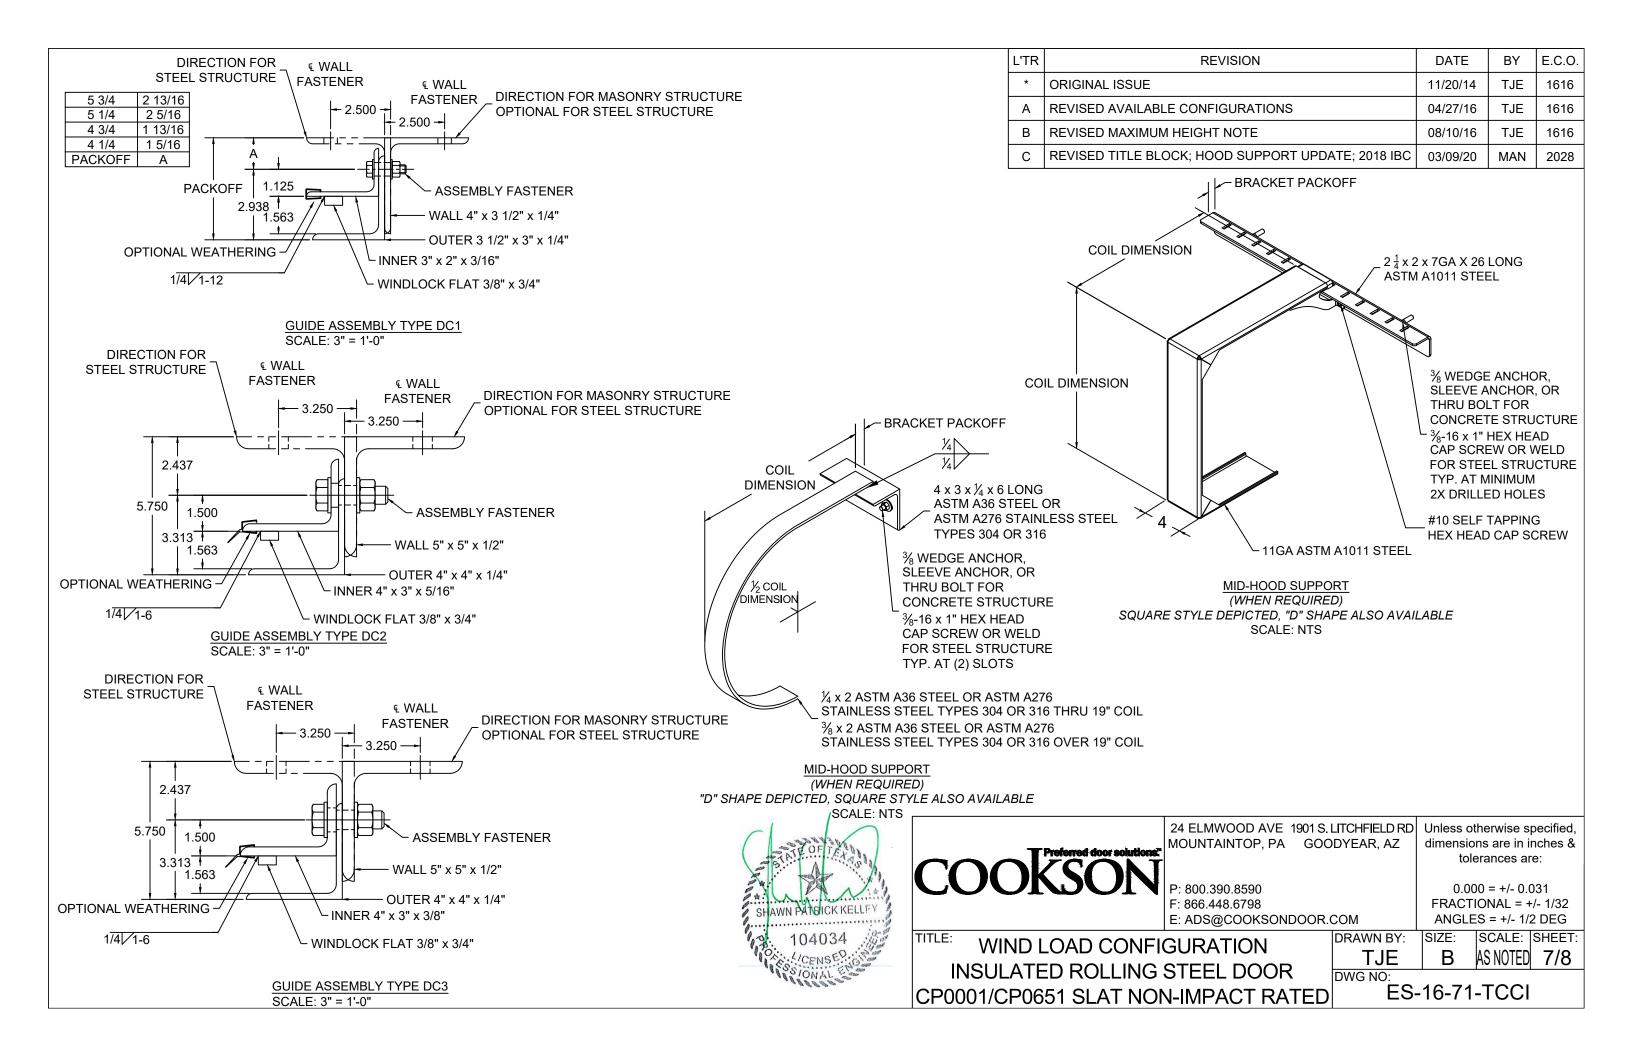

$\neg$					
	L'TR	REVISION	DATE	BY	E.C.O.
	*	ORIGINAL ISSUE	11/20/14	TJE	1616
	Α	REVISED AVAILABLE CONFIGURATIONS	04/27/16	TJE	1616
	В	REVISED MAXIMUM HEIGHT NOTE	08/10/16	TJE	1616
	С	REVISED TITLE BLOCK; HOOD SUPPORT UPDATE; 2018 IBC	03/09/20	MAN	2028

	CP0001/CP0651 -Galvanized or Stainless Steel																
									Concre	te Minimun	n 3,000 PSI C	•	Strength (And fasteners)	chors are th	ne same diam	eter as	
Door	Minimum	Maximum	Windlock			Guide Windlock Assembly A		Assembly	Hilti Kwik Bolt 3				Simpson Wedge All				
Configuration	Front Slat Thickness	Pressure	Flat Location	Slip	Windlock		Weld Pitch	Fastener Diameter	Fastener Spacing	Max O.C.	Embed	Min. Wall Thick.	Edge Dist	Max O.C.	Embed	Min. Wall Thick.	Edge Dist
DC 1	0.0296	65 PSF	1 5/16	0.532	CP0629	DC1	12	1/2	18	16	3 1/2	5 1/4	5 3/4	16	4 1/2	6 3/4	5 3/4
DC 2	0.0405	120 PSF	1 1/2	0.656	CP0630 & CP0647	DC2	6	3/4	15	11	4 3/4	7 1/8	7 1/2	11	5	7 1/2	7 1/2
DC 3	0.0405	65 PSF	2 1/2	1.656	CP0630 & CP0647	DC3	6	3/4	15	11	4 3/4	7 1/8	7 1/2	11	5	7 1/2	7 1/2

	CP0001/CP0651 - Galvanized or Stainless Steel, Cont.																			
	Filled CMU							Steel (Wa	assembly	Superimposed Loads (at Maximum										
Door		Hilti Kw	ik Bolt 3			Simpson \	Nedge-All		TI	hrough Bo	lt	Wel	lded	Through Bolt	Тар	ped		Press	sure)	
Configuration	Max O.C.	Dia.	Embed	Edge Dist	Max O.C.	Dia.	Embed	Edge Dist	Max. O.C.	Dia.	Edge Dist	Max O.C.	Slot Size	Max O.C.	Max O.C.	Min. Thickness	Vx (+)	Vy (+)	Vx (-)	Vy (-)
DC 1	8	1/2	3 1/2	5 3/4	8	1/2	4 1/2	5 3/4		N/A		18	9/16 X 3/4	18	18	1/4	566	406	517	404
DC 2		N	/A			N/	/A		8	3/4	7 1/2	15	13/16 x 1	15	15	3/8	2956	871	2881	871
DC 3		N <sub>2</sub>	/A			N/	/A		8	3/4	7 1/2	15	13/16 x 1	15	15	3/8	2861	825	2844	826

## SEE CHARTS BELOW FOR MAXIMUM PRESSURE/WIDTH COMBINATIONS FOR EACH DOOR CONFIGURATION

DC 1 Door Configuration								
DBG Up To	Maximum Pressure							
12'-5"	65 PSF (Tested)							
13'-5"	50 PSF							
14'-5"	40 PSF							
15'-5"	30 PSF							
18'-5"	20 PSF							

DC 2 Door Configuration							
DBG Up To	Maximum Pressure						
14'-5	120 PSF (Tested)						
15'-5"	100 PSF						
16'-5"	90 PSF						
17'-5"	80 PSF						
18'-5"	70 PSF						
20'-5"	60 PSF						
22'-5"	50 PSF						
25'-5"	40 PSF						
30'-5"	30 PSF						
39'-5"	20 PSF						

DC 3 Door Configuration							
DBG Up To	Maximum Pressure						
25'-5"	65 PSF (Tested)						
26'-5"	60 PSF						
29'-5"	50 PSF						
33'-5"	40 PSF						
40'-5"	30 PSF						





24 ELMWOOD AVE 1901 S. LITCHFIELD RD MOUNTAINTOP, PA GOODYEAR, AZ

P: 800.390.8590

F: 866.448.6798 E: ADS@COOKSONDOOR.COM

Unless otherwise specified, dimensions are in inches &

0.000 = +/- 0.031FRACTIONAL = +/- 1/32 ANGLES = +/- 1/2 DEG

TITLE: WIND LOAD CONFIGURATION INSULATED ROLLING STEEL DOOR CP0001/CP0651 SLAT NON-IMPACT RATED

SIZE: SCALE: SHEET: DRAWN BY: AS NOTED 8/8 TJE