



NOTES:

1. GLAZING OPTION - .125" MINIMUM DSB GLAZING MEETS UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. GLAZING SHALL HAVE A MAXIMUM HEIGHT OF 6.70" AND A MAXIMUM LENGTH OF 24.00". GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.
2. MINIMUM OF 1" OVERLAP ON BOTH JAMBS REQUIRED TO MEET NEGATIVE DESIGN PRESSURES.
3. SLIDE LOCKS OR OPERATOR REQUIRED.
4. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:
TS 200 - 26 GA EXTERIOR, 26 GA INTERIOR
TS 200-20 - 20 GA EXTERIOR, 27 GA INTERIOR
5. A 21 GA X 2-1/4" X 3-3/4" BACKUP PLATE SHALL BE LOCATED AT EACH INTERMEDIATE HINGE LOCATION.
6. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
7. TRACK CLIPS SHALL BE LOCATED WITH CENTERLINE OF BOTTOM CLIP SPACED 10" MAX FROM BOTTOM OF TRACK AND REMAINING TRACK CLIPS SPACED AT 24" O.C. MAX. SPACING BETWEEN TOP TRACK CLIP AND SPLICE PLATE SHALL BE 30" O.C. MAX.
8. WHEN MOUNTING TO WOOD, DOOR JAMB TO BE MINIMUM 2x6 NO. 2 SPF LUMBER OR BETTER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

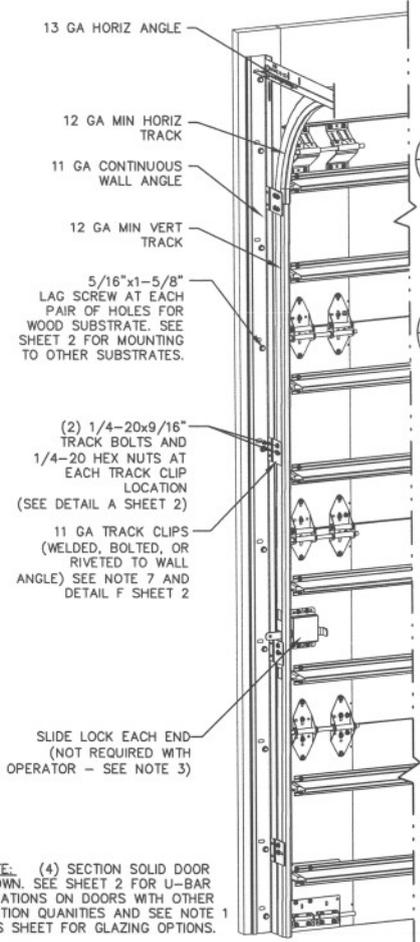

NOTE: (4) SECTION SOLID DOOR SHOWN. SEE SHEET 2 FOR U-BAR LOCATIONS ON DOORS WITH OTHER SECTION QUANTITIES AND SEE NOTE 1 THIS SHEET FOR GLAZING OPTIONS.

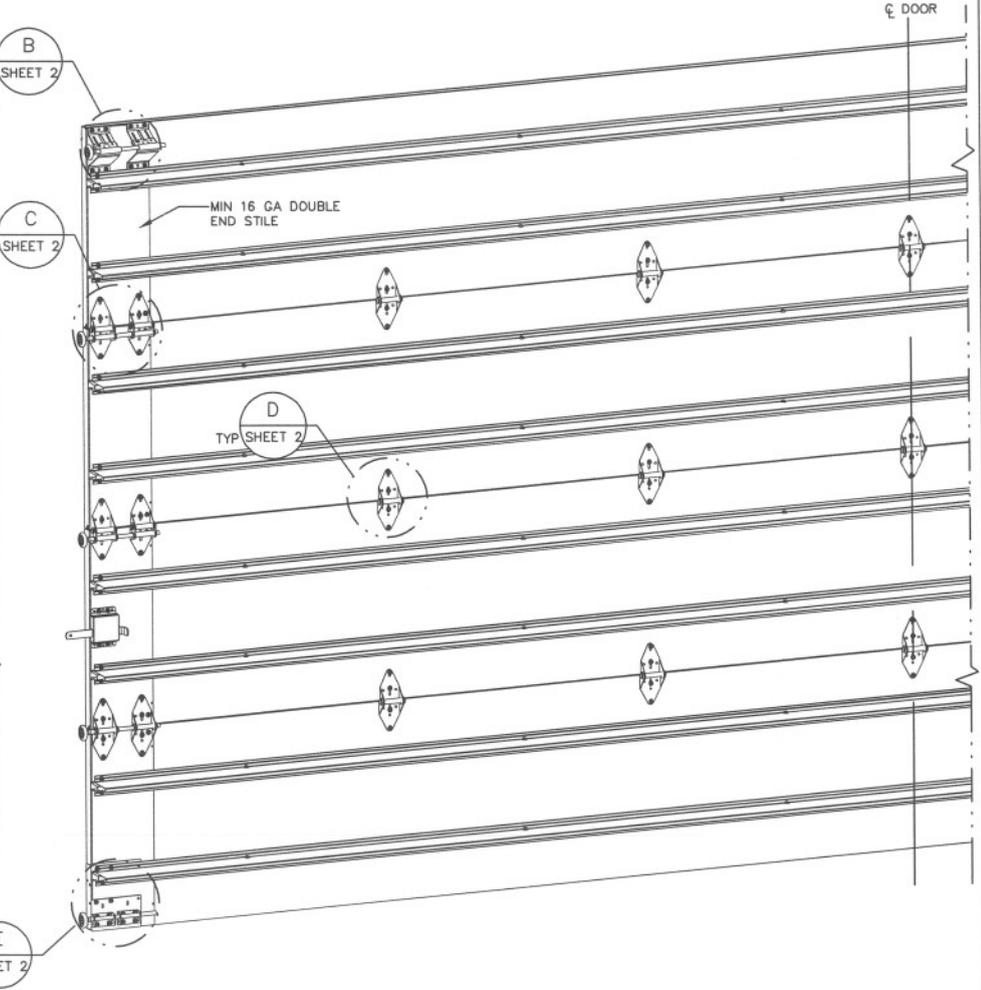

REVISIONS
P1 REMOVED SECTION LIMITATION FOR STANDARD GLAZING GRT 5/9/08

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

MAX DOOR WIDTH	DOOR HEIGHT	MAX UNIFORM LOAD EACH JAMB (PLF)
24'-2"	ALL	+169.2/-189.7


Signature
5/30/08
TX PE 93119
MARK R. BARROW, PE
FLORIDA LICENSE NO. 57389

Wayne Dalton
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+14.00/-15.70	MAX WIDTH:	24'-2"	DATE	NAME
TEST (PSF):	+21.00/-23.55	MAX HEIGHT:	24'-1"	DRAWN	9/6/07 GRT
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX SECTION HEIGHT:	24"	CHECKED	4/11/08 MRB
MODEL TS 200/200-20				SHEET 1 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 2150				DRAWING PART NO.	REV.
				332634	P1

REVISIONS

P1 REMOVED SECTION LIMITATION FOR STANDARD GLAZING GRT 5/9/08

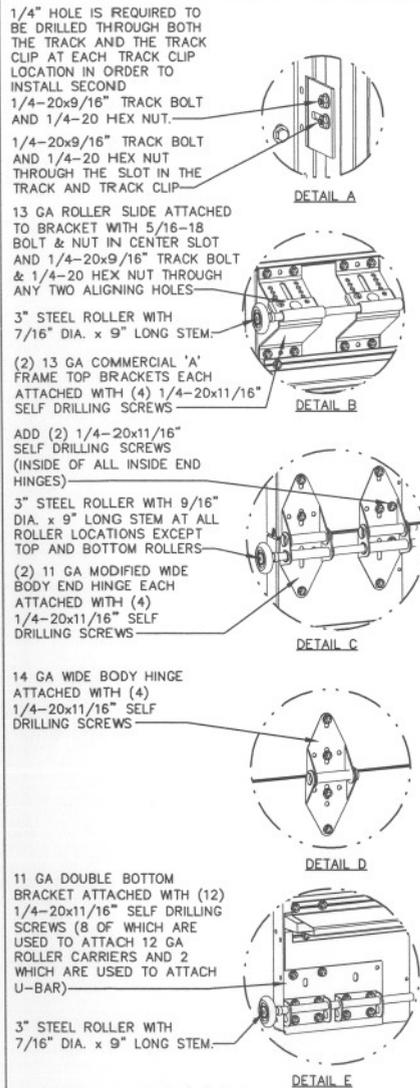


DETAIL A

DETAIL B

DETAIL C


DETAIL D

DETAIL E

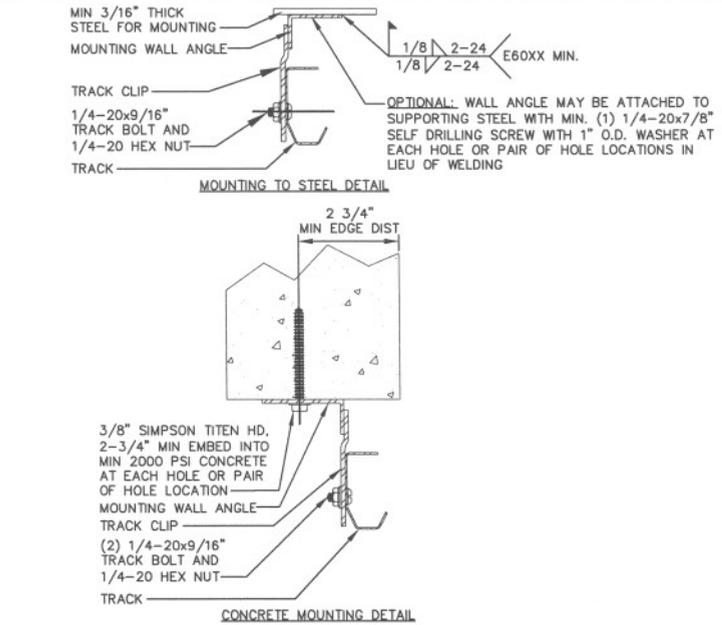


MOUNTING TO STEEL DETAIL

CONCRETE MOUNTING DETAIL

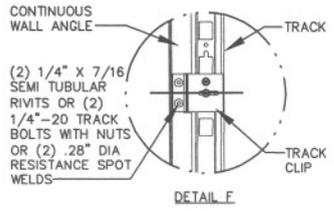

DETAIL F

U-BAR LOCATIONS

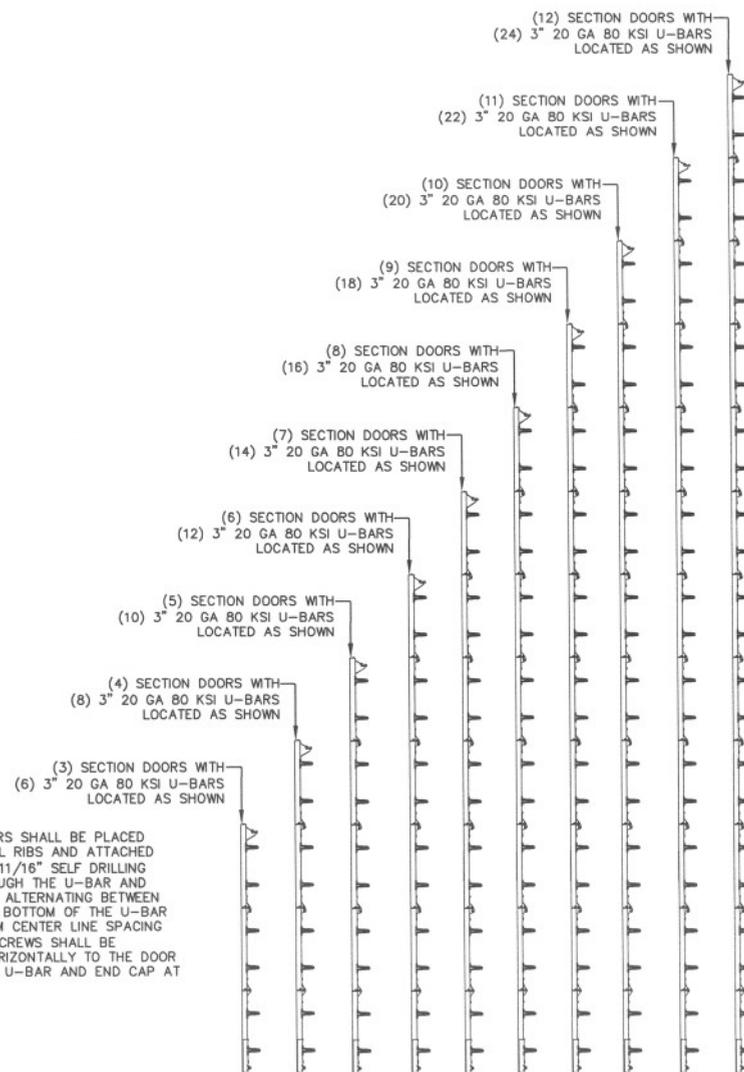

NOTE: U-BARS SHALL BE PLACED OVER INTEGRAL RIBS AND ATTACHED WITH 1/4"-20x11/16" SELF DRILLING SCREWS THROUGH THE U-BAR AND INTEGRAL RIB, ALTERNATING BETWEEN THE TOP AND BOTTOM OF THE U-BAR AT A MAXIMUM CENTER LINE SPACING OF 36". (2) SCREWS SHALL BE INSTALLED HORIZONTALLY TO THE DOOR THROUGH THE U-BAR AND END CAP AT EACH END.

5/30/08
TX PE 93119

MARK R. BARROW, PE
FLORIDA LICENSE NO. 57389



3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+14.00/-15.70	MAX WIDTH:	24'-2"	DATE	9/6/07	NAME	GRT
TEST (PSF):	+21.00/-23.55	MAX HEIGHT:	24'-1"	CHECKED	4/11/08	MRB	
IMPACT/CYCLIC RATED (YES/NO): NO				MAX SECTION HEIGHT: 24"			
MODEL TS 150/200/200-20						SHEET 2 OF 2	
WINDLOAD SPECIFICATION OPTION CODE 2150						DRAWING PART NO.	REV.
						332634	P1