



TYPICAL ELEVATION WITH FASTENER SPACING

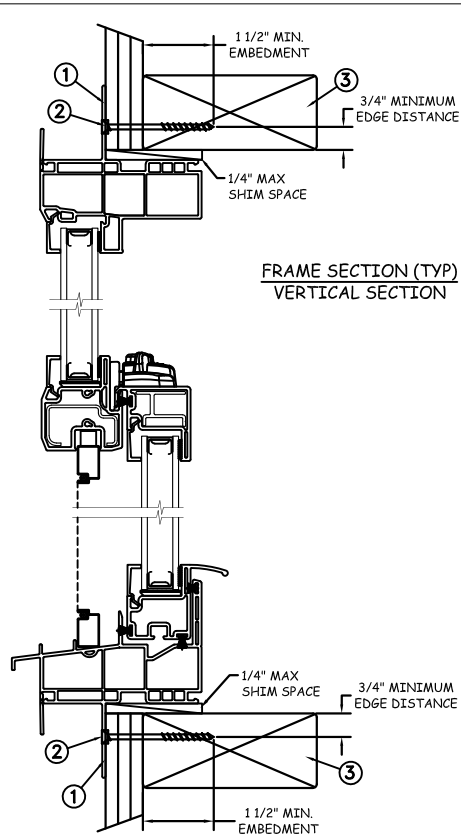

FRAME SECTION (TYP)
VERTICAL SECTION

JAMB SECTION (TYP)
HORIZONTAL SECTION

NAIL FIN INSTALLATION

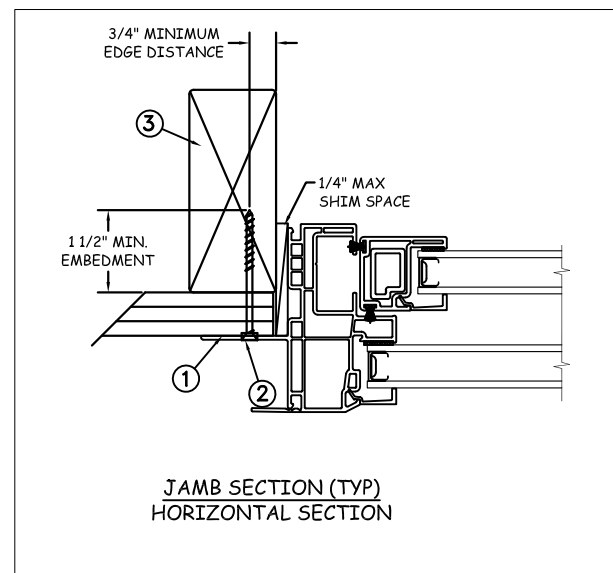

| | | |
|-----------|-----------|--------|
| Max Frame | DP RATING | IMPACT |
| 48 x 84 | +50/-55 | NO |

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #8 X PH or greater fastener through the nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the 2018 International Residential Code (IRC), the 2018 International Building Code (IBC).
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be double strength annealed insulated glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




Joseph A. Reed

2021.07.13 12:56:02 -0400
JOSEPH A. REED, P.E.
 Texas No. 100777
 5 LEIGH DRIVE
 YORK, PA. 17406
 (717) 846-1200


| | |
|------------------------------|--|
| DATE: 07/13/2021 | JELD-WEN 3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936 |
| DRAWN BY: M. HAM | |
| CHECKED BY: J. GOOSSEN | Premium Vinyl Tilt Single Hung |
| APPROVED BY: J. GOOSSEN | |
| RECORD No: D014483 | |
| REPORT No: G511704-301-47 | CAD DWG. No.: PremVinylTSH Cert |
| | REV: A |
| | SHEET 1 OF 4 |

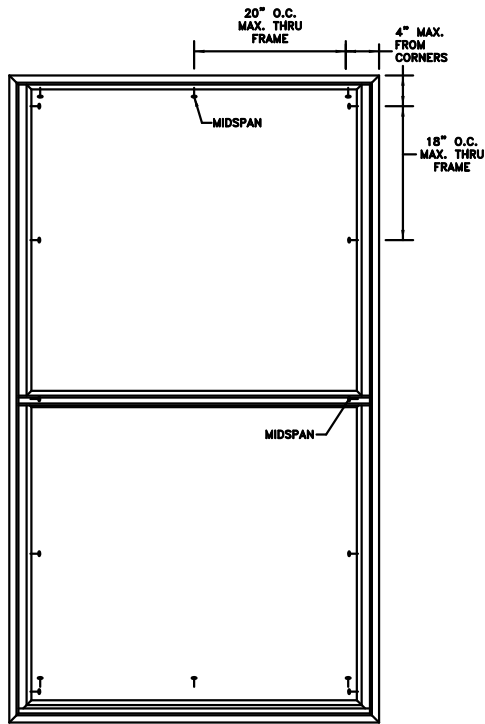

TYPICAL ELEVATION WITH FASTENER SPACING

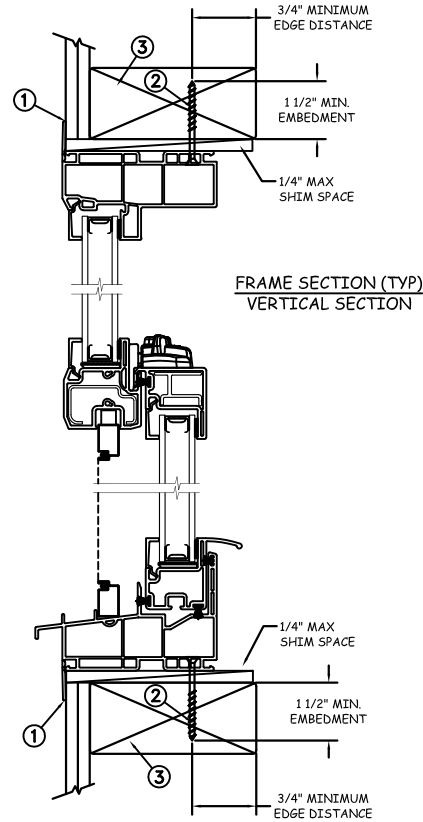

FRAME SECTION (TYP)
VERTICAL SECTION

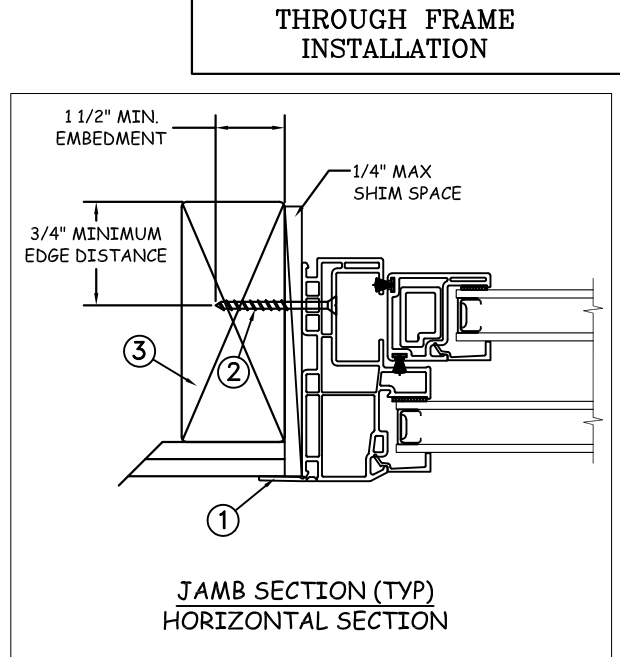

JAMB SECTION (TYP)
HORIZONTAL SECTION

| Max Frame | DP RATING | IMPACT |
|-----------|-----------|--------|
| 48 x 84 | +50/-55 | NO |

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #8 PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the 2018 International Residential Code (IRC), the 2018 International Building Code (IBC).
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be double strength annealed insulated glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




Joseph A. Reed


2021.07.13 12:56:02 -0400
JOSEPH A. REED, P.E.
 Texas No. 100777
 5 LEIGH DRIVE
 YORK, PA. 17406
 (717) 846-1200

| | | | | |
|------------------------------|--|--|-----------|-----------------|
| DATE: 07/13/2021 | | JELD-WEN 3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936 | | |
| SCALE: NTS | | | | |
| DRAWN BY: M. HAM | | Premium Vinyl Tilt Single Hung | | |
| CHECKED BY: J. GOOSSEN | | | | |
| APPROVED BY: J. GOOSSEN | | | | |
| RECORD No: D014483 | | TITLE: | | |
| REPORT No: G511704-301-47 | | CAD DWG. No.: PremVinylTSH Cert | REV: A | SHEET 2 OF 4 |


MASONRY INSTALLATION

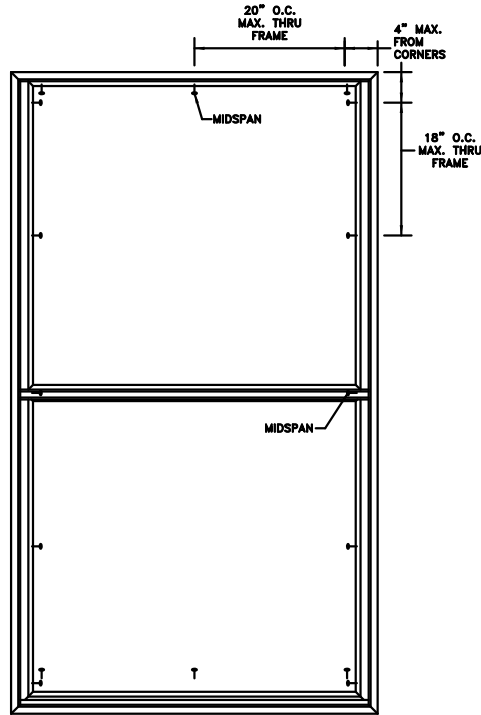

TYPICAL ELEVATION WITH FASTENER SPACING

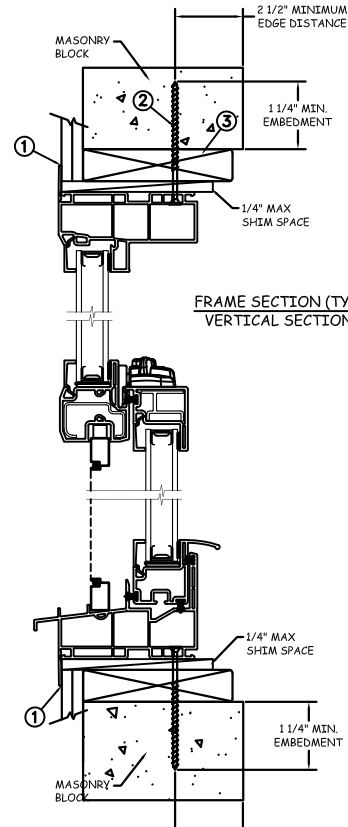

FRAME SECTION (TYP)
VERTICAL SECTION

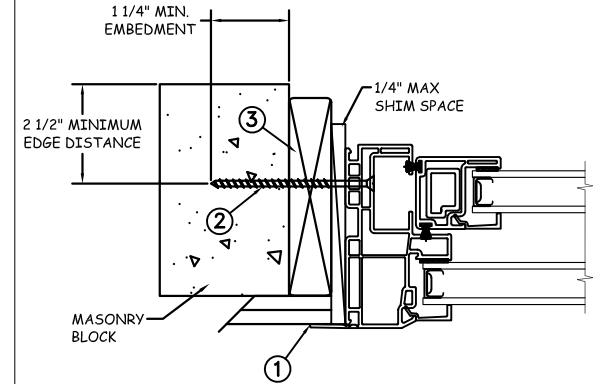

JAMB SECTION (TYP)
HORIZONTAL SECTION

| Max Frame | DP RATING | IMPACT |
|-----------|-----------|--------|
| 48 x 84 | +50/-55 | NO |

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 3/16" Tapcon or equivalent fasteners through frame with sufficient length to penetrate a minimum of 1 1/4" into concrete or masonry at each location with a 2 1/2" min from edge distance. For concrete (min. = 3000psi) or masonry (CMU shall conform to ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the 2018 International Residential Code (IRC), the 2018 International Building Code (IBC).
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be double strength annealed insulated glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




Joseph A. Reed

2021.07.13 12:56:02 -0400
JOSEPH A. REED, P.E.
 Texas No. 100777
 5 LEIGH DRIVE
 YORK, PA. 17406
 (717) 846-1200

| | | | | |
|------------------------------|------------------------------------|-----------|---|--|
| DATE: 07/13/2021 | | | 3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936 | |
| DRAWN BY: M. HAM | | | SCALE: NTS | |
| CHECKED BY: J. GOOSSEN | Premium Vinyl Tilt Single Hung | | | |
| APPROVED BY: J. GOOSSEN | | | | |
| RECORD No: D014483 | | | | |
| REPORT No: G511704-301-47 | CAD DWG. No.: PremVinylTSH Cert | REV: A | SHEET 3 OF 4 | |

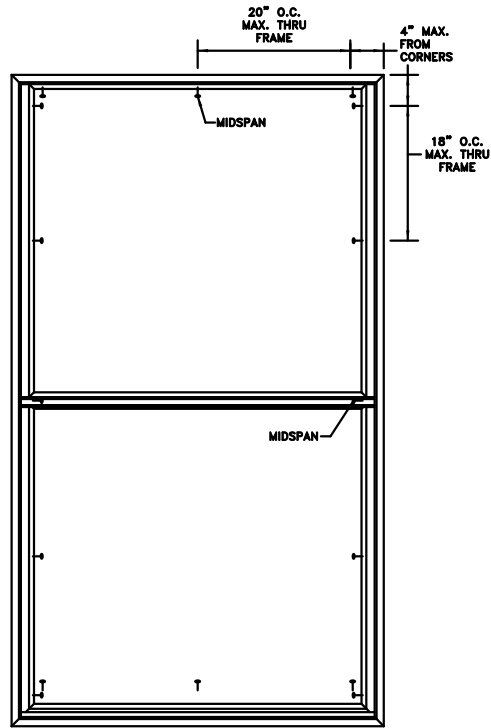


TYPICAL ELEVATION WITH FASTENER SPACING

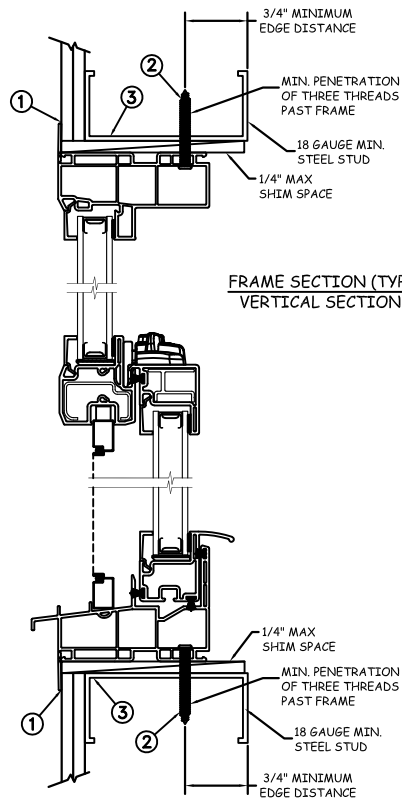

FRAME SECTION (TYP)
VERTICAL SECTION

JAMB SECTION (TYP)
HORIZONTAL SECTION

STEEL INSTALLATION

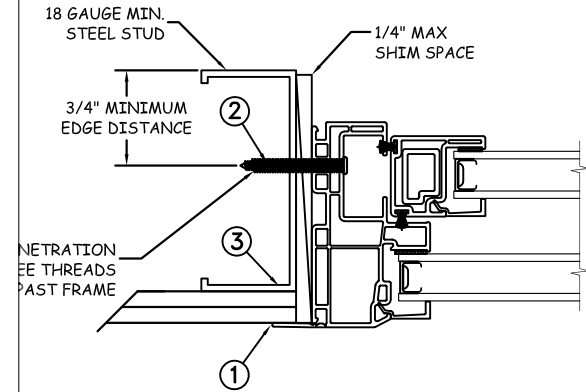

| Max Frame | DP RATING | IMPACT |
|-----------|-----------|--------|
| 48 x 84 | +50/-55 | NO |

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. For anchoring into metal framing use #10 TEK Self-Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga, fy=33ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the 2018 International Residential Code (IRC), the 2018 International Building Code (IBC).
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be double strength annealed insulated glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.



Joseph A. Reed

2021.07.13 12:56:02 -0400
JOSEPH A. REED, P.E.
 Texas No. 100777
 5 LEIGH DRIVE
 YORK, PA. 17406
 (717) 846-1200

| | | | |
|----------------------------|--|---|---------------------|
| DATE: 07/13/2021 | | 3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936 | |
| DRAWN BY: M. HAM | | SCALE: NTS | |
| CHECKED BY: J. GOOSSEN | TITLE: Premium Vinyl Tilt Single Hung | | |
| APPROVED BY: J. GOOSSEN | REPORT No.: G511704-301-47 | CAD DWG. No.: PremVinylTSH Cert | REV: A SHEET 4 OF 4 |
| RECORD No.: D014483 | | | |